


South Weber City Corporation

# Development, Design, & Construction Standards



**October 2017**  
*(Revision 1 – February 2019)*



Prepared by  
**JONES & ASSOCIATES**  
Consulting Engineers



**ORDINANCE NO. 19-02**

**AN ORDINANCE OF THE SOUTH WEBER CITY COUNCIL AMENDING CITY CODE SUBSECTIONS 11.04.020.J.6, 11.04.040.B AND 11.04.140 REGARDING STREET LIGHT INSTALLATION AND COLLECTOR STREET RIGHT OF WAY WIDTH**

WHEREAS, after extensive study by the Municipal Utilities Committee and based upon its findings and recommendation presented to the City Council on November 13, 2018, the Council determines it to be in the best interest of the City to select their own contractor to manufacture and install new street lights, rather than continuing with the practice of having the Power Company install them; and to correct the minimum collector road right of way width from 76 feet to 78 feet; and

WHEREAS, the Planning Commission held a public hearing on January 29, 2019 and recommends its approval to the City Council; and

WHEREAS, various amendments and technical changes need to be made to certain sections of the City Code to incorporate the proposals;

NOW, THEREFORE, BE IT ORDAINED by the City Council of South Weber City, State of Utah:

Section 1. Subsection Amended. Subsection 11.04.020.J.6 of the South Weber City Code is hereby amended to read:

**11.04.020 General Requirements**

...

J. Conditional Acceptance: Notwithstanding the fact that the land on which the improvements will be located is dedicated at the time of the recording of a plat, the City shall not be responsible for the improvements, their construction, or maintenance until after the one-year guarantee period has expired and there is an official acceptance of the dedicated property and improvements by the City. To begin the one-year guarantee period, the following shall be required:

...

6. Street Lights: The subdivider shall pay for all street lights required by the City Standards. Once power is installed, the subdivider shall notify the City. The street lights will be ordered by the City and installed by the City's authorized contractor. Once paid for, the subdivider shall no longer be responsible for the installation or timing of the installation.

Section 2. Subsection Amended. Subsection 11.04.040.B of the South Weber City Code is hereby amended to read:

**11.04.040 Streets, Easements and Numbers**

...

**B. Width of Public Right of Way :** The minimum width of a proposed public right of way measured from lot line to lot line shall be as shown in the general plan, or if not shown in such plan, shall be:

1. Major Streets: 110 feet;
2. Collector Streets: 78 feet; and
3. Local Streets: 70 feet;

except where existing conditions do not permit the minimum width, sidewalk requirements may be adjusted to allow a road width of not less than 41 feet from top back of curb to top back of curb.

Section 3. Section Amended. Section 11.04.140 of the South Weber City Code is hereby amended to read:

**11.04.140 Street Lighting**

- A. The subdivider shall pay for all outdoor street lighting fixtures.
- B. The placement and installation of street lighting shall be in accordance with adopted City Standards.
- C. The subdivider shall be required to get power installed into the subdivision and notify the City when power is available.
- D. The City is responsible to order the street lights. The street lights shall then be installed and maintained by the City's authorized contractor.


Section 4. General Repealer. Ordinances in conflict herewith are hereby repealed.

Section 5. Effective Date. The City Council of South Weber City, State of Utah, has determined that the public health, safety and welfare require that this ordinance take effect immediately. Therefore, this ordinance shall become effective immediately upon passage and publication as required by law.

**PASSED AND ADOPTED** by the City Council of South Weber, Davis County, on the 12<sup>th</sup> day of February 2019.

**ATTEST:**

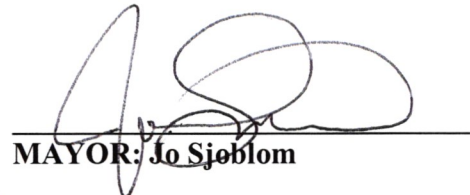

  
MAYOR: Jo Sjoblom



**Mark McRae, City Recorder**

Roll call vote is as follows:

Mr. Halverson	<input checked="" type="radio"/> Yes	<input type="radio"/> No
Mr. Hyer	<input checked="" type="radio"/> Yes	<input type="radio"/> No
Ms. Petty	<input checked="" type="radio"/> Yes	<input type="radio"/> No
Mr. Taylor	<input checked="" type="radio"/> Yes	<input type="radio"/> No
Mr. Winsor	<input checked="" type="radio"/> Yes	<input type="radio"/> No

**CERTIFICATE OF POSTING**

I hereby certify that complete copies of Ordinance 2019-02 were posted in the following locations within the City this 13<sup>th</sup> day of February, 2019:

1. South Weber Elementary, 1285 E. Lester Drive
2. South Weber Family Activity Center, 1181 E. Lester Drive
3. South Weber City Building, 1600 E. South Weber Drive




  
Mark McRae, City Recorder

DEVELOPMENT, DESIGN, AND  
CONSTRUCTION STANDARDS

for

SOUTH WEBER CITY

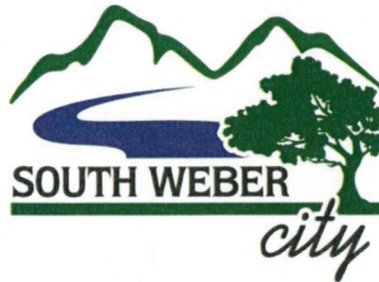


**SUBMITTED & RECOMMENDED:**



Brandon K. Jones, P.E.  
City Engineer


3/5/19  
Date

**APPROVED:**




Jolene C. Sjoblom  
Mayor

3/5/19  
Date



David J. Larson  
City Manager

3/6/19  
Date

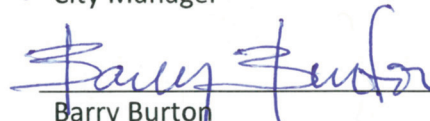


Barry Burton  
City Planner

3.5.19  
Date



Mark B. Larsen  
Public Works Director

3-5-19  
Date



Lisa Smith  
Attest, City Recorder

3/6/19  
Date

**TABLE OF CONTENTS**

SECTION 1 GENERAL..... 1

    1.01 South Weber City Municipal Code Governs..... 1

    1.02 Conformance with Federal, State, and Local Laws ..... 1

    1.03 Definitions ..... 1

    1.04 Acronyms..... 2

    1.05 Modification Process..... 2

SECTION 2 DEVELOPMENT STANDARDS ..... 4

    2.01 Approval Procedure ..... 4

    2.02 Developer Responsibilities ..... 4

    2.03 Subdivision Standards ..... 5

SECTION 3 DESIGN STANDARDS..... 6

    3.01 Required Improvements ..... 6

    3.02 Improvement Plans ..... 6

    3.03 Sanitary Sewer Design..... 7

    3.04 Water Design..... 7

    3.05 Street/Road Design ..... 7

    3.06 Storm Drain Design ..... 8

    3.07 Low Impact Development ..... 8

SECTION 4 CONSTRUCTION STANDARDS..... 9

    4.01 General Policies ..... 9

    4.02 Pre-Construction Conference..... 12

    4.03 Construction ..... 12

SECTION 5 TECHNICAL SPECIFICATIONS ..... 15

    5.01 Technical Specifications for South Weber City ..... 15

    5.02 Order of Precedence ..... 15

SECTION 6 STANDARD DRAWINGS, PLANS, AND DETAILS..... 16

    6.01 Standard Drawings, Plans, and Details for South Weber City..... 16

    6.02 Order of Precedence ..... 16

APPENDICES

    A STORM DRAIN AND DRAINAGE DESIGN STANDARDS

    B MODIFICATIONS AND ADDITIONS TO MANUAL OF STANDARD SPECIFICATIONS

    C SOUTH WEBER CITY PUBLIC WORKS STANDARD DRAWINGS

## **SECTION 1      GENERAL**

### **1.01      South Weber City Municipal Code Governs**

**Nothing in this document shall be construed to be contrary to South Weber City Municipal Code. Should a conflict exist between this document and the Ordinances, the Code shall govern.**

### **1.02      Conformance with Federal, State, and Local Laws**

**Nothing in this document shall relieve the Developer, Engineer, or Contractor from abiding by any and all Federal, State, and local laws.**

### **1.03      Definitions**

- A. Contractor – The individual, firm, co-partnership, or corporation, and his, their, or its heirs, executors, administrators, successors, and assigns, or the lawful agent of any such individual firm, partnership, covenantor, or corporation, or his, their, or its surety under the contract bond, constituting one of the principals to the contract and undertaking to perform the Work.
- B. Drawings – The City-approved construction drawings, the South Weber City Public Works Standard Drawings, and/or the Manual of Standard Drawings, as applicable.
- C. Developer – The person sponsoring construction of the improvements.
- D. Development – The subject subdivision, minor subdivision, or building.
- E. Improvements – See “Work.”
- F. Improvement Plans – See “Drawings.”
- G. Inspector – The authorized representative of the City or City Engineer assigned to make all necessary inspections of the Work performed or being performed, or of materials furnished or being furnished by the Contractor.
- H. Work – All types of work necessary to provide safe access and utility service to and within proposed subdivision or site, including, but not limited to, site grading, utility installation, and street construction. Work includes all labor, services, and documentation necessary to produce such construction; furnishing, installing, and incorporating all materials and equipment into such construction; and may include related services such as testing, start-up, and commissioning.<sup>1</sup>
- I. See also the South Weber City Municipal Code. Where definition conflicts arise between City Ordinance and this document, the definitions in this document shall take precedence when in reference to this document.

---

<sup>1</sup> From EJCDC© C-700, Standard General Conditions of the Construction Contract.



**1.04 Acronyms**

- A. BMP – Best Management Practice
- B. CFP – Capital Facilities Plan
- C. DDW – Division of Drinking Water
- D. DWQ – Division of Water Quality
- E. DWRi – Division of Water Rights
- F. FEMA – Federal Emergency Management Agency
- G. HOA – Homeowners’ Association
- H. LID – Low Impact Development
- I. RCP – Reinforced Concrete Pipe
- J. SWC – South Weber City
- K. UDEQ – Utah Department of Environmental Quality
- L. UDOT – Utah Department of Transportation
- M. UPDES – Utah Pollutant Discharge Elimination System
- N. USACE – United States Army Corps of Engineers

**1.05 Modification Process**

- A. Whenever, in the opinion of the City Public Works Department, the City Engineer, or the Superintendent having jurisdiction, a literal enforcement of these regulations may work an undue hardship or a literal enforcement of the provisions may be unnecessary to meet the goals and standards of the City, the City may modify those standards in the following manner:
- B. Modifications may be granted when there are practical difficulties involving carrying out the provisions of the Public Works Standards and Technical Specifications, and a panel consisting of the City Manager, City Planner, City Engineer, and the Public Works Director or their Representative determine that granting of a modification for an individual case will meet the goals and requirements of the City without unduly jeopardizing the public and the individual’s interest.
  - 1. The City shall first receive a written request for a modification to the standards from any interested party.
  - 2. Upon receipt of the request, the panel discussed above shall find that a special individual reason makes the strict letter of the standard impractical, and shall find the modification is in conformance with the intent and purpose of the standards and shall find that such modification does not in any way lessen the integrity of the standards.

3. When such findings of fact are made, the panel may grant such modification as it deems appropriate. The details of any action granted as modification by this panel shall be recorded and entered in the files of the City, with the specific reasons for the granting of said modification.

## **SECTION 2      DEVELOPMENT STANDARDS**

### **2.01    Approval Procedure**

**See Title 11 – Subdivision Regulations of the South Weber City Municipal Code**

### **2.02    Developer Responsibilities**

- A. Required Improvements and Guarantees – see Title 11 of South Weber City Municipal Code.
- B. Permits and Approvals
  - 1. Developer is responsible for obtaining all necessary permits and approvals for the construction of the Improvements. Copies of all applications and approved permits shall be submitted to the City. Agencies/permits that may be required include, but are not limited to:
    - a. DDW Plan Approval (pre-construction)
    - b. DDW Operating Permit (post-construction)
    - c. UPDES NOI and NOT
    - d. DWRi Stream Alteration
    - e. DWRi Dam Safety
    - f. EPA 404 Wetlands
    - g. FEMA CLOMA and/or CLOMR
    - h. UDOT
    - i. Others as applicable
- C. Improvements
  - 1. The required improvements shall include all street improvements in front of all lots along all dedicated streets to a connection with existing improvements of the same kind or to the boundary or the subdivision nearest existing improvements. Design must provide for future extension to adjacent development and to be compatible with the contour of the ground for proper drainage. All water lines, sewer lines, and any other buried conduit shall be installed to the boundary lines of the subdivision. See Chapter 11.04 for more information.
  - 2. Upsizing based on CFPs – The Developer will be required to construct/install infrastructure sized in accordance with the City’s currently adopted CFPs. The City will be responsible for paying difference in cost between the master planned infrastructure size and the minimum infrastructure size required for the development.
  - 3. Seal Coat – See Municipal Code.
  - 4. Street Lighting – See Municipal Code.

5. Street Signage – See Municipal Code.
6. Survey of Existing Improvements – Developer shall reimburse City for City Engineer’s time spent surveying in locations of new improvements.

**2.03 Subdivision Standards**

- A. The general standards for subdivision layout and development are found in Title 11 – Subdivision Regulations.
- B. See also Section 3 – Design Standards and Section 4 – Construction Standards of this document.

## SECTION 3 DESIGN STANDARDS

### 3.01 Required Improvements

- A. See Chapter 11.04 for information on the required improvements.
- B. See also Section 5 – Technical Specifications and Section 6 – Standard Drawings, Plans, and Details of this document for additional information.

### 3.02 Improvement Plans

- A. Complete and detailed, and signed and sealed (in accordance with Utah Code 58-22-602) construction plans and drawings of improvements shall be submitted to the City for the review by the City Engineer prior to receiving final plat approval and prior to commencing construction. Per Chapter 11.04, no construction shall begin until plans have been checked and approved by the City Engineer, and final approval is granted by the City Council.
- B. The following instructions are for the purpose of standardizing the preparation of drawings to obtain uniformity in appearance, clarity, size, and style. The plans and designs shall meet the standards defined in the specifications and drawings hereinafter outlined. The minimum information required on the drawings for improvements is as follows:
  - 1. All drawings and/or prints shall be clear and legible and conform to industry standard engineering and drafting practices.
  - 2. Drawings shall be legible and to a common scale when printed on 11"x17" paper.
  - 3. Both plan view and centerline profile must be shown. On subdivisions along steep cross slopes, profiles for each side of the street may be required to be shown.
  - 4. Plan and profiles shall indicate design and/or existing grades a minimum of 200 feet beyond the limits of the proposed project.
  - 5. All wet utilities (water, sewer, storm drain, irrigation) shall be shown in plan and profiles views.
- C. Each set of plans shall be accompanied by a separate sheet of details for special structures which are to be constructed and are not covered by the City Standards. All structures shall be designed in accordance with the minimum South Weber City Standards and approved by the City Engineer.
- D. Separate drawings of elements of the South Weber City Standards shall not be required to be redrawn and submitted with the construction drawings unless specific deviations from the standards are requested for approval; however, the construction drawings shall refer to the specific items of the Standards that are to be incorporated into the Work.
- E. The plan and profile construction plans shall be submitted in portable document format ("pdf"). Upon approval, the developer's engineer shall provide the City Engineer with electronic files of the final plat and improvement plans in AutoCAD or other City Engineer approved format. A hard copy of the approved construction plans bearing the signature of

the City Engineer shall be kept available at the construction site. Prior to final acceptance by the City, the developer, developer's representative, contractor, or project engineer shall submit to the City Engineer a set of "as built" drawings for permanent City file record.

### **3.03 Sanitary Sewer Design**

- A. All design shall be in accordance with Utah Administrative Code R317.
- B. All terminating sewer mains shall end with a city standard manhole.
- C. Service lateral connection shall not be allowed in sewer manholes.
- D. All sewer shall be gravity unless otherwise approved by the City.
- E. Collection lines shall be located in public rights-of-way or private road rights-of-way. Collection lines shall not be located on private property (easements) without the express written permission from the City. If such case is granted, easement shall be a minimum of 20' and shall be dedicated to the City of South Weber.

### **3.04 Water Design**

- A. All design shall be in accordance with Utah Administrative Code R309.
- B. Valves are required on all branches of tees and crosses. On unbroken lengths of water line, the maximum valve spacing is 1000-ft.
- C. At dead end lines, including temporary dead ends, provide fire hydrant at termination point.
- D. All fire lines shall meet public works standards, but shall remain privately owned and maintained.
- E. Fire hydrants are to be installed in locations as required by the fire code and approved by the Fire Marshal and City Engineer, with a minimum spacing of 500-ft.

### **3.05 Street/Road Design**

- A. Design
  - 1. Streets shall be designed in accordance with these Standards, standard engineering practices, and AASHTO and MUTCD guidelines.
  - 2. No changes of grade in excess of 1.5% shall be permitted without a vertical curve.
  - 3. Sight triangles shall be shown at the request of the City Engineer.
  - 4. Cul-de-Sacs
    - a. Length - See Municipal Code and Standard Drawings.
  - 5. Temporary Turnarounds
    - a. When turnaround cannot be constructed outside of subdivision, it shall be located on a portion of the subdivision lots (as needed) with the developer placing in escrow

an amount of money sufficient to complete the street improvements to the subdivision boundary. These funds will be used at such time the street is extended.

- b. Drainage onto adjacent property must be by written approval (easement) of adjacent property owner.
- c. The lot on which the turnaround is constructed shall be restricted as follows:
  - (i) Platted as an "R" (restricted) lot.
  - (ii) This lot cannot be sold or building permits issued until the road is extended beyond the subdivision boundary, complete with curb, gutter, and sidewalk.

6. Landscaping

- a. When landscaping is required to be designed/installed, refer to the Standard Drawings.

7. UDOT

- a. Roadway intersections with UDOT controlled streets shall be in accordance with UDOT standards. A copy of the approved UDOT Access Permit shall be submitted to the City.

**3.06 Storm Drain Design**

- A. See Appendix A for Storm Drain and Drainage Design Standards.

**3.07 Low Impact Development**

- A. [SECTION RESERVED]

## SECTION 4 CONSTRUCTION STANDARDS

### 4.01 General Policies

#### A. General Conditions

1. Permit/License: When the work is in progress, Contractor shall have at the work site a copy of the permit and his contractor's license number.
2. Private access: Temporary all weather roadways, driveways, walks, and right-of-ways for vehicles and pedestrians shall be constructed and continuously maintained where required.
3. Street excavation in winter: Excavation of City streets during the winter months (herein defined as November 15 to April 1) will be allowed only if the work is a new service connection, required maintenance or emergency, or otherwise approved by the Public Works Department. Permanent patching of City streets excavated in the winter may be delayed until April 1 with the following provisions: Within five working days from the completion of the excavation, the permittee provides/maintains a 1-1/2" thick temporary winter asphalt surface until such time as the permanent asphalt surface is installed; the permittee shall provide/maintain a temporary untreated base course surface until such time as the temporary winter asphalt surface is installed. These provisions apply regardless of whether the permittee or City crews are performing the permanent resurfacing.
4. Existing utilities: The contractor shall use extreme caution to avoid a conflict, contact, or damage to existing utilities, such as power lines, sewer lines, storm drains, street lights, telephone lines, cable television lines, water lines, gas lines, poles, or other appurtenances during the course of construction of this project. Any such conflict, contact, or damage shall be immediately communicated to said utility company and the Public Works Department. All projects shall be "Blue Staked" prior to construction.
5. Preconstruction pictures of existing public way improvements: The permittee may secure pictures of the conditions of the existing public way improvements such as curbing, sidewalk, landscaping, asphalt surfaces, etc. In the event that public way improvements are damaged and no pictures are taken, the Public Works Department will assume the correction of the damage is the responsibility of the permittee.

#### B. Licensing

1. Contractor (including all sub-contractors) must be licensed with the State of Utah: It is the policy of South Weber City that contractors desiring to perform work in the City's public way shall be properly licensed in the State of Utah, as required by the Utah Administrative Code R156-55a (Utah Construction Trades Licensing Act Rule).



2. Exceptions: A license shall not be required by the City when the permittee is a public utility company. However, subcontractors for utility companies shall have a valid contractor's license.

C. Permits

1. Developer/Contractor is responsible for obtaining all necessary permits for the construction of the Improvements prior to commencement of said Improvements. Agencies/permits required may include, but are not limited to:
2. Encroachment (City)
  - a. South Weber City's Department of Public Works issues permits to control any excavation and construction operations in the public right-of-way. All contractors, sub-contractors, and utility companies proposing to construct, repair, or replace any facility within the public right-of-way shall contact the South Weber City Building Department and complete all permit requirements prior to commencing proposed work.
  - b. Work by utility companies and their contractors in constructing facilities in new subdivision streets shall be required to post a bond with the City and will be subject to City inspection and compliance with all requirements.
  - c. Emergency Work
    - (i) Maintenance of pipelines or facilities in the public way may proceed without a permit when emergency circumstances demand the work be done immediately provided a permit could not reasonably and practicably have been obtained beforehand.
    - (ii) In the event that emergency work is commenced on or within any public way of the City, the Public Works Department shall be notified within one-half hour when the work commences or as soon as possible from the time the work is commenced. Contact shall be made to the City's "on call" personnel. If emergency work is commenced during off business hours, the Public Works Department will be notified within one (1) hour of the start of work on the first regular business day of which City offices are open after such work commences, and, at the discretion of the Public Works Department, a permit may be issued which shall be retroactive to the date when the work was begun. Before commencing the emergency work, all necessary safety precautions for the protection of the public and the direction and control of traffic shall be taken. None of the provisions of these regulations are waived for emergency situations except for the prior permit requirement.
  - d. Enforcement: Violators of these regulations of working within the Public Way shall be subject to the provisions of the applicable South Weber City Municipal Code.
3. USACE/DWRi Stream Alteration – Stream Alteration

4. UPDES
5. Dam Safety (DWRi)
6. UDOT
7. Davis County Surveyor's Monument
8. Excavation Operations
  - a. Blue Stakes: Before commencing excavation operations, the permittee shall call "Blue Stakes" at 1-800-662-4111 or 811.
9. Traffic control devices: Traffic control devices such as construction signs, barricades, and cones must be in place before excavation begins.
10. Protection of paved surfaces outside of excavation area: In order to avoid unnecessary damage to paved surfaces, backhoes, outriggers, tracked equipment, or any other construction equipment that may prove damaging to asphalt shall use rubber cleats or paving pads when operating on or crossing said surfaces.
11. Open trench limits: Open trenches will be limited to one block at a time or 660 feet, whichever is less.
12. In the event of a planned road closure, Contractor shall notify the City, Fire Department, emergency services dispatch, US Postal Service, and Davis School District a minimum of 24 hours prior to the closure. In the case of an emergency, the above listed agencies will soon be notified at the soonest possible time.
13. Environmental Controls
  - a. Dust and debris: The permittee or contractor shall keep dust and debris controlled at the work site at all times. If necessary, a container shall be provided for debris and dusty areas shall be wet down. The permittee or contractor shall be responsible for the cleanup of mud or debris from public roads deposited by vehicles or construction equipment exiting the work site. The City Engineer reserves the right to shut down the work or issue a citation if dust is not controlled.
  - b. Noise: The permittee or contractor shall keep neighborhood free of noise nuisance in accordance with the Noise Ordinance.
14. Cleanup: The permittee or contractor shall remove all equipment, material, barricades, and similar items from the right-of-way. Areas used for storage of excavated material will be smoothed and returned to their original contour. Vacuum sweeping or hand sweeping shall be required when the Building Department determines cleaning equipment is ineffective.
15. Storm Water: All Contractors working within the boundaries of South Weber City shall conform to all requirements and regulations as outlined by the South Weber City Storm

Water Management Plan. Copies of the plan are available in the South Weber City Offices.

**4.02 Pre-Construction Conference**

- A. The pre-construction conference shall not be held until the City Engineer has approved and signed the construction plans.
- B. A preconstruction conference shall be held before any excavation or other work is begun in the subdivision or Project. The meeting will include:
  - 1. City Engineer
  - 2. Developer or Project Manager
  - 3. Subdivision or Project Engineer
  - 4. All contractors and subcontractors involved with installing the subdivision or project improvements
  - 5. Representatives of affected South Weber City Departments
  - 6. Representatives of local utility companies as may be required by South Weber City.
- C. Items pertaining to the construction and inspection of the subdivision or Project improvements will be discussed.

**4.03 Construction**

- A. Specifications
  - 1. Contractor shall be responsible for constructing all improvements in accordance with the Technical Specifications, per Section 5 of this document.
  - 2. Deviations from such shall be reviewed and authorized by the City Engineer on a case-by-case basis.
- B. Plans and Details
  - 1. Contractor shall be responsible for constructing all improvements in accordance with the Drawings, Plans, and Details, per Section 6 of this document.
  - 2. Deviations from such shall be reviewed and authorized by the City Engineer on a case-by-case basis.
  - 3. In the event that as-built conditions of the improvements are found to be out of compliance with the approved improvement plans and tolerances contained in these Standards, it shall be the contractor's responsibility to remove those improvements and replace them with improvements that comply with the approved improvement plans, and are within the given tolerances. Adjacent improvements may also require replacement in order to bring all improvements into compliance.
- C. Sequence/Timing

1. All underground utility work shall be completed prior to placement and compaction of the roadway base course. Utilities, including service lines, not installed prior to roadway construction shall be bored as approved by the Public Works Director.
2. All concrete collars shall be installed within fourteen (14) days of asphalt placement.

D. Inspection

1. All construction work involving the installation of improvements in the subdivision or project shall be subject to inspection by the City. It shall be the responsibility of the person responsible for construction to insure that inspections take place where and when required. Certain types of construction shall have continuous inspection, while others may have only periodic inspections.

E. Requests for Inspections

1. Requests for inspections shall be made to the Public Works Department by the person responsible for the construction.
2. Requests for inspection on work requiring continuous inspection shall be made three (3) working days prior to the commencing of the work.
3. Notice shall also be given one (1) day in advance of the starting of work requiring periodic inspection, unless specific approval is given otherwise by the City Engineer, or his duly authorized representatives.

F. Continuous Inspection

1. May be required on (but not limited to) the following types of work:
  - a. Laying of street surfacing
  - b. Placing of concrete for curb and gutter, sidewalks, and other structures
  - c. Laying of sewer pipe, irrigation pipe, drainage pipe, water mains, water service laterals and testing.
2. On construction requiring continuous inspection, no work shall be done except in the presence or by permission of the City Engineer or authorized city representative.

G. Periodic inspections

1. Shall be required on (but not limited to) the following types of work:
  - a. Street grading and gravel base
  - b. Excavations for curb and gutter and sidewalks
  - c. Excavations for structures
  - d. Trenches for laying pipe
  - e. Forms for curb and gutter, sidewalks and structures

H. Substantial and Final Completion Inspections

1. A substantial completion inspection shall be requested by the Contractor and made by the City Engineer or authorized representative after all construction work is completed. Any faulty or defective work shall be corrected by the persons responsible for the work within a period of thirty (30) days of the date of the City Engineer's or authorized representative's Punchlist defining the faulty or defective work.
2. A final completion inspection shall be requested by the Contractor and made by the City Engineer or authorized representative after all faulty and defective work has been corrected.

I. Testing

1. Contractor shall be responsible for all testing in accordance with the Technical Specifications per Section 5 of this document.
2. Testing shall be performed by a licensed and qualified testing firm. Contractor shall submit qualifications to City for approval of firm prior to beginning Work.
3. Testing reports shall be submitted to City weekly for review. Areas with failed tests shall be corrected and retested.
4. Failure to submit testing reports to the City shall be cause for work stoppage or rejection by City.

J. Safety

1. Contractor is solely responsible for jobsite safety.
2. Contractor shall comply with all local, state, and federal rules and regulations regarding jobsite safety.
3. City and/or its authorized representatives shall have the authority to shut down a job when unsafe working conditions are found.

## **SECTION 5      TECHNICAL SPECIFICATIONS**

### **5.01      Technical Specifications for South Weber City**

- A. Adoption of Divisions 01 through 34 of the Manual of Standard Specifications, as published by Utah LTAP Center, Utah State University, Logan, Utah, current edition, with all published amendments.
- B. Modifications and Additions to Manual of Standard Specifications (see Appendix B)

### **5.02      Order of Precedence**

- A. Approved project-specific specifications (when applicable)
- B. Modifications and Additions to Manual of Standard Specifications
- C. Manual of Standard Specifications, current edition, with all published amendments

## **SECTION 6      STANDARD DRAWINGS, PLANS, AND DETAILS**

### **6.01      Standard Drawings, Plans, and Details for South Weber City**

- A. South Weber City Public Works Standard Drawings, current edition (See Appendix C)
- B. Adoption of Manual of Standard Plans, published by Utah LTAP Center, Utah State University, Logan, Utah, current edition, with all published amendments.

### **6.02      Order of Precedence**

- A. Approved project-specific drawings and details (when applicable)
- B. South Weber City Public Works Standard Drawings, current edition
- C. Manual of Standard Plans, current edition, with all published amendments, when not covered by one of the aforementioned items

## **APPENDIX A – STORM DRAIN AND DRAINAGE DESIGN STANDARDS**



## APPENDIX A

### STORM DRAIN AND DRAINAGE DESIGN STANDARDS

#### A1. General Provisions

- A. South Weber faces unique storm water challenges because the City is surrounded on two sides by mountains and has the potential to receive a large amount of runoff in a short time. South Weber also has a relatively large amount of property that has not yet developed, but is likely to develop into residential housing, commercial, or industrial uses, thus increasing the amount of impervious surfaces leading to increased runoff.
- B. This document represents the design and construction standards for private and public design and construction as it relates to storm drainage within the City. All efforts have been made for this policy to conform to the requirements of the Clean Water Act, Phase II; and the Storm Water Management Plan of the City.
- C. The following information is organized in such a way to follow the natural flow of storm water – from the initial rainfall hydrology (A2), to conveyance of the rain water (A3) to a basin (A4), then discharge to a natural outlet location (A5).

#### A2. Rainfall Hydrology

- A. All storm drain systems shall be designed to carry the 100-year storm, unless otherwise stated.
- B. Storm Specifications
  - 1. Local storm drain piping shall be designed for the 10-year storm, where the road or other above ground conveyance will carry the difference to the 100-year storm.
  - 2. All basins regardless of local or regional, or retention or detention, shall be designed to accommodate a 100-year storm event, including all piping into the basin.
  - 3. The storm duration used for the sizing of basins shall be based upon the worst case scenario and not the time of concentration.
  - 4. Volume in pipes, ditches, or roadside swales shall not be considered in the volume calculation for detention and retention basins.
- C. Rainfall Intensity – When using the Rational Method, use the rainfall intensity table included as Exhibit 1 to this document.
- D. Calculation Basis – For developments less than 20 acres, the Rational Method may be used. For developments larger than 20 acres, a City Engineer-approved computer model shall be used.
- E. Rainfall Pattern and Depth – For the use of computer models, the following rainfall pattern shall be used. This pattern is based on the Farmer-Fletcher Distribution. This pattern is for a

1-inch unit storm and must be multiplied by rainfall depth for storms of other magnitudes, as provided in Exhibit 2.

### Farmer-Fletcher Distribution

#### Unit Storm

Time (Min.)	Depth (inches)	Time (Min.)	Depth (inches)	Time (Min.)	Depth (inches)	Time (Min.)	Depth (inches)	Time (Min.)	Depth (inches)	Time (Min.)	Depth (inches)
1	0	11	0.004	21	0.033	31	0.052	41	0.012	51	0.005
2	0	12	0.005	22	0.034	32	0.045	42	0.011	52	0.005
3	0.002	13	0.008	23	0.035	33	0.04	43	0.01	53	0.004
4	0.002	14	0.009	24	0.038	34	0.035	44	0.009	54	0.004
5	0.002	15	0.009	25	0.039	35	0.03	45	0.009	55	0.004
6	0.002	16	0.013	26	0.045	36	0.022	46	0.008	56	0.003
7	0.002	17	0.017	27	0.052	37	0.02	47	0.006	57	0.003
8	0.002	18	0.02	28	0.054	38	0.018	48	0.006	58	0.002
9	0.003	19	0.024	29	0.054	39	0.016	49	0.005	59	0.002
10	0.003	20	0.029	30	0.054	40	0.014	50	0.005	60	0.001

### A3. Storm Drain System

#### A. Independent System

1. Storm waters shall not be conveyed in irrigation ditches.
2. Irrigation waters shall not be conveyed in storm drain systems.

B. Piping – Storm drain lines shall be reinforced concrete pipe (RCP), of appropriate class. Minimum size for storm sewer mains shall be 15-inch diameter. Pipe specifications are included in the Section 5 of the Development, Design, and Construction Standards. Where determined by the City Engineer and/or the Storm Drain Capital Facilities Plan, larger drain lines shall be installed to accommodate future development. The cost to provide adequate storm drainage to a development shall be paid for by the Developer. Upsizing will be coordinated at the time of development. The cost of upsizing will be the responsibility of the City.

C. Access – Storm drain lines shall have cleanout boxes, inlets, or manholes installed at all changes in grade or alignment, with a maximum distance of 400 feet between accesses. Structures shall be installed in accordance with the standard specifications and standard drawings.

D. Sump Drains are not allowed except as approved by the City Engineer on a case-by-case basis. Proper permitting is required.

**A4. Detention and Retention Basins****A. Definitions**

1. Detention Basin – An open water storage pond designed to store a volume of water that reduces the post-development peak runoff of a storm to the pre-development runoff rate or other rate as defined by the governing body. This is accomplished by the use of an outlet control which controls the rate of flow out of the pond into the receiving storm drain or water body. The basin is intended to drain the storm water within a period of time to make the volume available for the next storm event.
2. Retention Basin - An open water storage pond designed to store the runoff volume of a storm. The basin is intended to dispose of water through infiltration and evaporation within a period of time to make the volume available for the next storm event.

B. Storm drainage basins are required for all development; however, developments less than one (1) acre are not required to have detention except when determined by the City Engineer.

C. Location – Detention basins shall be located with convenient access for maintenance and repair by maintenance personnel. This generally means that the basin property has frontage along a public roadway.

D. Parking lots – Storage of water shall not be allowed in parking lots.

E. Underground Storage – Underground storage will be considered for private basins only.

F. All detention basin designs and calculations shall be reviewed by the City Engineer for approval.

**G. Maintenance and Ownership**

1. Private Basins – When approved, private detention basins shall be owned and maintained by the property owner.
2. Local Public Basins – Local detention basins shall be constructed by the developer. Following acceptance of the construction, the ownership, operation, and maintenance shall be conveyed to the City.
3. Regional Detention Basins – Regional basins shall be owned and maintained by the City, constructed according to the criteria herein, and approved of the City Engineer. Actual ownership and responsibility shall be specifically defined in the Owner’s Dedication Certificates, Development Agreements, or by Deed.

**H. Basin Easement and Access**

1. Public Basins – The developer shall provide the City permanent access to any public basin.
2. Private Basin – The City shall be provided an easement for emergency access, operation, and/or repair for a private basin.

3. Access – Each basin shall be constructed with sufficient drivable access, outside of the basin, to any structure from a city street.
- I. Detention and Retention Basin Elements
    1. Side slopes – Side slopes shall not be steeper than 4:1 (horizontal to vertical).
    2. Bottom Slope – The basin floor shall be designed so as to prevent the permanent ponding of water. The slope of the floor of the basin shall not be less than 1% to provide drainage of water to the outlet grate and prevent prolonged wet, soggy, or unstable soil conditions. The preferred minimum slope is 2%.
    3. Freeboard – At least one (1) foot of freeboard is required (berm above the high water mark).
    4. Spillways
      - a. The spillway shall be designed to carry the 200-year storm flow minus the 100-year storm flow which is handled by the outlet control structure.
      - b. Spillways shall introduce flows back into the pipe or stream downstream of the outlet control.
      - c. Spillways shall include a maintained swale and drainage easement to a safe location.
      - d. The spillway shall be designed to prevent erosion.
      - e. All spillways shall be designed to protect adjacent embankments, nearby structures, and surrounding properties.
    5. Ground Covers – The surface area of the basin shall be sodded. A minimum of 4-inches of top soil must be installed prior to sod placement. The basin shall be provided with an automated sprinkler system approved by the City Engineer.
    6. Embankment (Fill) Construction – If a raised embankment is constructed for a basin (constructed with granular materials), it shall be provided with a minimum of 6-inches of clay cover on the inside of the berm to prevent water passage through the soil.
    7. Excavation (Cut) Construction – If the basin is constructed primarily by excavation, then it may be necessary to provide an impermeable liner and land drain system when constructed in the proximity of basements or other below grade structures as determined by a geotechnical evaluation.
    8. Multi-Use Basins – Basins may be designed as multi-use facilities when appropriate precautions are incorporated into the design. If amenities such as pavilions, playground equipment, volleyball courts, etc. are to be constructed within the water detention area of a basin, they shall be designed appropriately. Structures shall be designed for saturated soil conditions and bearing capacities are to be reduced accordingly. Restrooms shall not be located in areas of inundation. Inlet and outlet structures should

be located as far as possible from all facilities. No wood chips or floatable objects may be used in the area that will be inundated.

J. Detention Basins

1. Percolation – No reduction due to percolation for detention basins volumes shall be permitted.
2. Outlet Control – Private detention basins may have a calculated fixed orifice plate mounted on the outlet of the basin. Public detention basins shall have movable, screw-type head gates set at the calculated opening height with a stop block required to carry the maximum allowable discharge.
3. Low Flow Piping – The inlet and outlet structures may be located in different areas of the basin, requiring a buried pipe to convey any base flows that enter and exit the basin. (Cross gutters and surface flows are prohibited.)

K. Retention Basins

1. Retention basins must be specifically approved by the City Engineer.
2. Retention basins shall not be permitted within zones 1, 2, or 3 of any Drinking Water Source Protection Zone of any drinking water source.
3. An approved oil/sediment separator shall be installed upstream of retention basin.
4. Volume shall be based upon the 100-year, 3 hour storm. See Exhibits 1 and 2 for rainfall data.
5. Retention Basin Criteria – Retention basins may be permitted if the following conditions apply:
  - a. The distance between the nearest City storm drain and the boundary of the development is greater than:
    - i. 500 feet for subdivisions or 10 lots or less;
    - ii. 1,000 feet for subdivisions greater than 10 lots.
  - b. The basin is not located within a Hazardous Area (such as a steep slope ) or some other sensitive area (such as a Drinking Water Source Protection Zone).
  - c. Recommendation by the City Engineer.
6. Percolation Rate for Retention Basins
  - a. A percolation test shall be performed by a licensed tester. The percolation test shall be performed at the elevation of the proposed grade of the bottom of the retention basin.
  - b. Due to degradation of soils ability to percolate over time, only 80% of the percolation rate shall be used in the calculations for the retention basins.

7. Retention basins shall be designed to completely drain within 48 hours of the primary storm event.

**A5. Discharge**

A. Allowable Discharge Design

1. Calculations shall be based on the 100-year storm event.
2. Calculations shall be based on the total acreage of the development draining to the basin.
3. Pass-through of offsite drainage through the development will be allowed.
4. Discharge shall not exceed pre-development runoff with pre-development meaning the condition of the land prior to settlement.
5. Alternatively, a standard discharge rate of 0.1 cubic feet per second per total acre may be used.
6. Controlled discharge will be established as described in A4.H.5 of this document.

B. Water Quality

1. Long-term Best Management Practices (BMPs) shall be used to maintain, to the maximum extent practical, the quality of the water to the pre-developed condition.
2. Construction BMPs shall be implemented per the City's Storm Water Management Plan.

- C. Discharge to Irrigation Ditches – No discharge shall be permitted to irrigation ditches and canals unless express written permission is obtained from the responsible ditch company or ditch owners.

**EXHIBIT 1 – NOAA POINT PRECIPITATION FREQUENCY ESTIMATES - INTENSITY**



**NOAA Atlas 14, Volume 1, Version 5**  
**Location name: Ogden, Utah, USA\***  
**Latitude: 41.1331°, Longitude: -111.9381°**  
**Elevation: 4511.67 ft\*\***  
\* source: ESRI Maps  
\*\* source: USGS



**POINT PRECIPITATION FREQUENCY ESTIMATES**

Sanja Perica, Sarah Dietz, Sarah Heim, Lillian Hiner, Kazungu Maitaria, Deborah Martin, Sandra Pavlovic, Ishani Roy, Carl Tryppaluk, Dale Unruh, Fenglin Yan, Michael Yekta, Tan Zhao, Geoffrey Bonnin, Daniel Brewer, Li-Chuan Chen, Tye Parzybok, John Yarchoan

NOAA, National Weather Service, Silver Spring, Maryland

[PF\\_tabular](#) | [PF\\_graphical](#) | [Maps\\_&\\_aerials](#)

**PF tabular**

<b>PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches/hour)<sup>1</sup></b>										
<b>Duration</b>	<b>Average recurrence interval (years)</b>									
	<b>1</b>	<b>2</b>	<b>5</b>	<b>10</b>	<b>25</b>	<b>50</b>	<b>100</b>	<b>200</b>	<b>500</b>	<b>1000</b>
<b>5-min</b>	<b>1.73</b> (1.50-2.02)	<b>2.17</b> (1.90-2.54)	<b>2.95</b> (2.56-3.46)	<b>3.67</b> (3.16-4.31)	<b>4.84</b> (4.06-5.71)	<b>5.93</b> (4.82-7.08)	<b>7.21</b> (5.68-8.70)	<b>8.74</b> (6.62-10.8)	<b>11.2</b> (8.04-14.2)	<b>13.6</b> (9.24-17.6)
<b>10-min</b>	<b>1.31</b> (1.13-1.54)	<b>1.65</b> (1.45-1.94)	<b>2.25</b> (1.94-2.63)	<b>2.80</b> (2.40-3.28)	<b>3.68</b> (3.08-4.35)	<b>4.51</b> (3.67-5.38)	<b>5.48</b> (4.31-6.62)	<b>6.65</b> (5.04-8.19)	<b>8.54</b> (6.11-10.8)	<b>10.3</b> (7.03-13.4)
<b>15-min</b>	<b>1.08</b> (0.936-1.27)	<b>1.36</b> (1.19-1.60)	<b>1.86</b> (1.61-2.18)	<b>2.31</b> (1.98-2.71)	<b>3.04</b> (2.55-3.60)	<b>3.72</b> (3.03-4.45)	<b>4.53</b> (3.56-5.47)	<b>5.50</b> (4.16-6.77)	<b>7.06</b> (5.05-8.96)	<b>8.52</b> (5.81-11.1)
<b>30-min</b>	<b>0.730</b> (0.632-0.854)	<b>0.918</b> (0.802-1.08)	<b>1.25</b> (1.08-1.46)	<b>1.56</b> (1.33-1.82)	<b>2.05</b> (1.72-2.42)	<b>2.51</b> (2.04-3.00)	<b>3.05</b> (2.40-3.68)	<b>3.70</b> (2.80-4.56)	<b>4.75</b> (3.40-6.03)	<b>5.74</b> (3.91-7.46)
<b>60-min</b>	<b>0.452</b> (0.391-0.529)	<b>0.568</b> (0.496-0.668)	<b>0.773</b> (0.670-0.906)	<b>0.962</b> (0.826-1.13)	<b>1.27</b> (1.06-1.50)	<b>1.55</b> (1.26-1.85)	<b>1.89</b> (1.49-2.28)	<b>2.29</b> (1.74-2.82)	<b>2.94</b> (2.11-3.73)	<b>3.55</b> (2.42-4.62)
<b>2-hr</b>	<b>0.294</b> (0.259-0.338)	<b>0.367</b> (0.324-0.422)	<b>0.474</b> (0.416-0.544)	<b>0.575</b> (0.499-0.663)	<b>0.742</b> (0.630-0.863)	<b>0.896</b> (0.742-1.05)	<b>1.08</b> (0.865-1.28)	<b>1.30</b> (1.00-1.57)	<b>1.65</b> (1.20-2.06)	<b>1.97</b> (1.37-2.53)
<b>3-hr</b>	<b>0.226</b> (0.203-0.256)	<b>0.279</b> (0.250-0.317)	<b>0.348</b> (0.310-0.395)	<b>0.414</b> (0.365-0.470)	<b>0.520</b> (0.450-0.595)	<b>0.619</b> (0.524-0.716)	<b>0.739</b> (0.610-0.867)	<b>0.881</b> (0.705-1.05)	<b>1.12</b> (0.848-1.39)	<b>1.33</b> (0.971-1.70)
<b>6-hr</b>	<b>0.152</b> (0.139-0.168)	<b>0.186</b> (0.170-0.206)	<b>0.224</b> (0.204-0.248)	<b>0.259</b> (0.234-0.288)	<b>0.312</b> (0.278-0.348)	<b>0.356</b> (0.313-0.400)	<b>0.409</b> (0.353-0.466)	<b>0.469</b> (0.395-0.542)	<b>0.586</b> (0.477-0.702)	<b>0.692</b> (0.547-0.861)
<b>12-hr</b>	<b>0.097</b> (0.089-0.107)	<b>0.119</b> (0.108-0.131)	<b>0.143</b> (0.130-0.158)	<b>0.164</b> (0.148-0.181)	<b>0.196</b> (0.175-0.218)	<b>0.223</b> (0.196-0.250)	<b>0.251</b> (0.218-0.285)	<b>0.282</b> (0.239-0.325)	<b>0.332</b> (0.273-0.391)	<b>0.373</b> (0.299-0.448)
<b>24-hr</b>	<b>0.060</b> (0.056-0.064)	<b>0.073</b> (0.068-0.079)	<b>0.087</b> (0.081-0.094)	<b>0.099</b> (0.092-0.107)	<b>0.115</b> (0.106-0.124)	<b>0.127</b> (0.118-0.137)	<b>0.140</b> (0.129-0.151)	<b>0.153</b> (0.140-0.165)	<b>0.170</b> (0.155-0.198)	<b>0.189</b> (0.165-0.227)
<b>2-day</b>	<b>0.036</b> (0.033-0.039)	<b>0.044</b> (0.041-0.047)	<b>0.052</b> (0.048-0.056)	<b>0.059</b> (0.055-0.064)	<b>0.068</b> (0.063-0.074)	<b>0.075</b> (0.070-0.081)	<b>0.083</b> (0.076-0.089)	<b>0.090</b> (0.082-0.097)	<b>0.099</b> (0.090-0.108)	<b>0.107</b> (0.096-0.116)
<b>3-day</b>	<b>0.026</b> (0.024-0.028)	<b>0.032</b> (0.030-0.035)	<b>0.038</b> (0.036-0.041)	<b>0.044</b> (0.041-0.047)	<b>0.051</b> (0.047-0.054)	<b>0.056</b> (0.052-0.060)	<b>0.062</b> (0.057-0.067)	<b>0.067</b> (0.062-0.073)	<b>0.075</b> (0.068-0.081)	<b>0.081</b> (0.073-0.088)
<b>4-day</b>	<b>0.022</b> (0.020-0.023)	<b>0.026</b> (0.025-0.028)	<b>0.032</b> (0.029-0.034)	<b>0.036</b> (0.033-0.039)	<b>0.042</b> (0.039-0.045)	<b>0.046</b> (0.043-0.050)	<b>0.051</b> (0.047-0.055)	<b>0.056</b> (0.051-0.061)	<b>0.063</b> (0.057-0.068)	<b>0.068</b> (0.061-0.074)
<b>7-day</b>	<b>0.015</b> (0.014-0.016)	<b>0.018</b> (0.017-0.020)	<b>0.022</b> (0.020-0.023)	<b>0.025</b> (0.023-0.026)	<b>0.029</b> (0.027-0.031)	<b>0.032</b> (0.029-0.034)	<b>0.035</b> (0.032-0.038)	<b>0.038</b> (0.035-0.041)	<b>0.042</b> (0.038-0.046)	<b>0.045</b> (0.041-0.050)
<b>10-day</b>	<b>0.012</b> (0.011-0.013)	<b>0.015</b> (0.014-0.016)	<b>0.017</b> (0.016-0.019)	<b>0.020</b> (0.018-0.021)	<b>0.022</b> (0.021-0.024)	<b>0.025</b> (0.023-0.026)	<b>0.027</b> (0.025-0.029)	<b>0.029</b> (0.026-0.031)	<b>0.031</b> (0.029-0.034)	<b>0.033</b> (0.030-0.036)
<b>20-day</b>	<b>0.008</b> (0.007-0.008)	<b>0.010</b> (0.009-0.010)	<b>0.011</b> (0.011-0.012)	<b>0.013</b> (0.012-0.014)	<b>0.014</b> (0.014-0.015)	<b>0.016</b> (0.015-0.017)	<b>0.017</b> (0.016-0.018)	<b>0.018</b> (0.017-0.019)	<b>0.019</b> (0.018-0.021)	<b>0.020</b> (0.019-0.022)
<b>30-day</b>	<b>0.006</b> (0.006-0.007)	<b>0.008</b> (0.007-0.008)	<b>0.009</b> (0.009-0.010)	<b>0.010</b> (0.010-0.011)	<b>0.012</b> (0.011-0.012)	<b>0.013</b> (0.012-0.013)	<b>0.014</b> (0.013-0.014)	<b>0.014</b> (0.013-0.015)	<b>0.015</b> (0.014-0.017)	<b>0.016</b> (0.015-0.017)
<b>45-day</b>	<b>0.005</b> (0.005-0.006)	<b>0.007</b> (0.006-0.007)	<b>0.008</b> (0.007-0.008)	<b>0.009</b> (0.008-0.009)	<b>0.010</b> (0.009-0.010)	<b>0.011</b> (0.010-0.011)	<b>0.011</b> (0.011-0.012)	<b>0.012</b> (0.011-0.013)	<b>0.013</b> (0.012-0.014)	<b>0.014</b> (0.013-0.015)
<b>60-day</b>	<b>0.005</b> (0.004-0.005)	<b>0.006</b> (0.005-0.006)	<b>0.007</b> (0.006-0.007)	<b>0.008</b> (0.007-0.008)	<b>0.009</b> (0.008-0.009)	<b>0.009</b> (0.009-0.010)	<b>0.010</b> (0.009-0.011)	<b>0.011</b> (0.010-0.011)	<b>0.011</b> (0.010-0.012)	<b>0.012</b> (0.011-0.013)

<sup>1</sup> Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS). Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.





[Back to Top](#)

**PF graphical**



PDS-based intensity-duration-frequency (IDF) curves

Latitude: 41.1331°, Longitude: -111.9381°

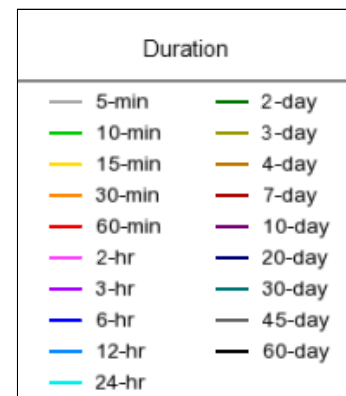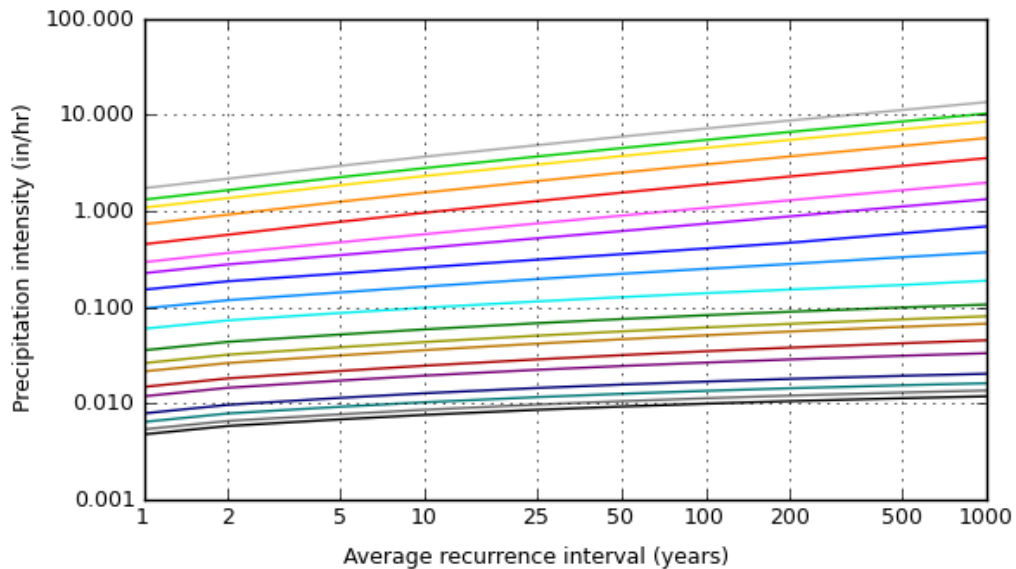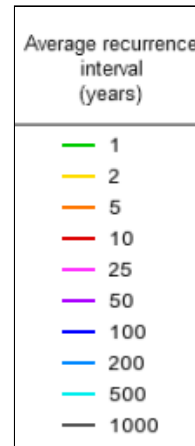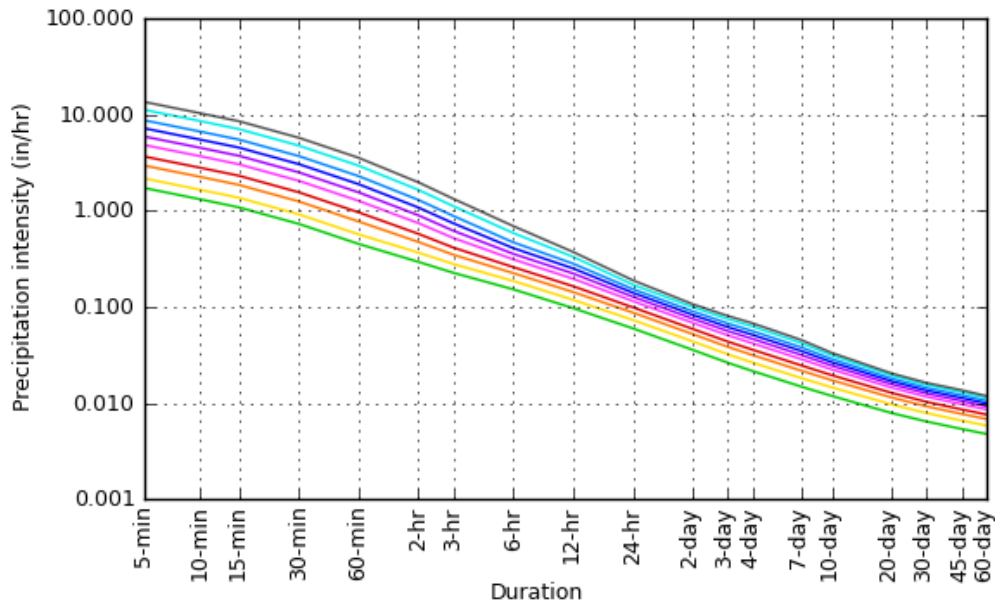

[Back to Top](#)

**Maps & arials**

**Small scale terrain**

## **EXHIBIT 2 – NOAA POINT PRECIPITATION FREQUENCY ESTIMATES - DEPTH**



**NOAA Atlas 14, Volume 1, Version 5**  
**Location name: Ogden, Utah, USA\***  
**Latitude: 41.1331°, Longitude: -111.9381°**  
**Elevation: 4511.67 ft\*\***



\* source: ESRI Maps  
 \*\* source: USGS

**POINT PRECIPITATION FREQUENCY ESTIMATES**

Sanja Perica, Sarah Dietz, Sarah Heim, Lillian Hiner, Kazungu Maitaria, Deborah Martin, Sandra Pavlovic, Ishani Roy, Carl Tryppaluk, Dale Unruh, Fenglin Yan, Michael Yekta, Tan Zhao, Geoffrey Bonnin, Daniel Brewer, Li-Chuan Chen, Tye Parzybok, John Yarchoan

NOAA, National Weather Service, Silver Spring, Maryland

[PF\\_tabular](#) | [PF\\_graphical](#) | [Maps\\_&\\_aerials](#)

**PF tabular**

<b>PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches)<sup>1</sup></b>										
<b>Duration</b>	<b>Average recurrence interval (years)</b>									
	<b>1</b>	<b>2</b>	<b>5</b>	<b>10</b>	<b>25</b>	<b>50</b>	<b>100</b>	<b>200</b>	<b>500</b>	<b>1000</b>
<b>5-min</b>	<b>0.144</b> (0.125-0.168)	<b>0.181</b> (0.158-0.212)	<b>0.246</b> (0.213-0.288)	<b>0.306</b> (0.263-0.359)	<b>0.403</b> (0.338-0.476)	<b>0.494</b> (0.402-0.590)	<b>0.601</b> (0.473-0.725)	<b>0.728</b> (0.552-0.897)	<b>0.935</b> (0.670-1.19)	<b>1.13</b> (0.770-1.47)
<b>10-min</b>	<b>0.219</b> (0.189-0.256)	<b>0.275</b> (0.241-0.323)	<b>0.375</b> (0.324-0.439)	<b>0.466</b> (0.400-0.546)	<b>0.614</b> (0.514-0.725)	<b>0.751</b> (0.611-0.897)	<b>0.914</b> (0.719-1.10)	<b>1.11</b> (0.840-1.37)	<b>1.42</b> (1.02-1.81)	<b>1.72</b> (1.17-2.24)
<b>15-min</b>	<b>0.271</b> (0.234-0.317)	<b>0.341</b> (0.298-0.401)	<b>0.464</b> (0.402-0.544)	<b>0.578</b> (0.496-0.677)	<b>0.760</b> (0.638-0.899)	<b>0.931</b> (0.758-1.11)	<b>1.13</b> (0.891-1.37)	<b>1.37</b> (1.04-1.69)	<b>1.77</b> (1.26-2.24)	<b>2.13</b> (1.45-2.77)
<b>30-min</b>	<b>0.365</b> (0.316-0.427)	<b>0.459</b> (0.401-0.540)	<b>0.625</b> (0.542-0.732)	<b>0.778</b> (0.667-0.912)	<b>1.02</b> (0.859-1.21)	<b>1.25</b> (1.02-1.50)	<b>1.53</b> (1.20-1.84)	<b>1.85</b> (1.40-2.28)	<b>2.38</b> (1.70-3.02)	<b>2.87</b> (1.96-3.73)
<b>60-min</b>	<b>0.452</b> (0.391-0.529)	<b>0.568</b> (0.496-0.668)	<b>0.773</b> (0.670-0.906)	<b>0.962</b> (0.826-1.13)	<b>1.27</b> (1.06-1.50)	<b>1.55</b> (1.26-1.85)	<b>1.89</b> (1.49-2.28)	<b>2.29</b> (1.74-2.82)	<b>2.94</b> (2.11-3.73)	<b>3.55</b> (2.42-4.62)
<b>2-hr</b>	<b>0.588</b> (0.518-0.675)	<b>0.734</b> (0.649-0.845)	<b>0.947</b> (0.832-1.09)	<b>1.15</b> (0.998-1.33)	<b>1.49</b> (1.26-1.73)	<b>1.79</b> (1.48-2.10)	<b>2.16</b> (1.73-2.57)	<b>2.59</b> (2.00-3.15)	<b>3.29</b> (2.40-4.12)	<b>3.94</b> (2.74-5.06)
<b>3-hr</b>	<b>0.679</b> (0.609-0.768)	<b>0.838</b> (0.751-0.951)	<b>1.05</b> (0.930-1.19)	<b>1.24</b> (1.10-1.41)	<b>1.56</b> (1.35-1.79)	<b>1.86</b> (1.57-2.15)	<b>2.22</b> (1.83-2.61)	<b>2.65</b> (2.12-3.17)	<b>3.35</b> (2.55-4.16)	<b>3.99</b> (2.92-5.11)
<b>6-hr</b>	<b>0.912</b> (0.835-1.00)	<b>1.12</b> (1.02-1.23)	<b>1.34</b> (1.22-1.49)	<b>1.55</b> (1.40-1.72)	<b>1.87</b> (1.66-2.09)	<b>2.13</b> (1.87-2.40)	<b>2.45</b> (2.11-2.79)	<b>2.81</b> (2.36-3.25)	<b>3.51</b> (2.86-4.20)	<b>4.14</b> (3.28-5.16)
<b>12-hr</b>	<b>1.17</b> (1.07-1.29)	<b>1.43</b> (1.31-1.57)	<b>1.72</b> (1.56-1.90)	<b>1.98</b> (1.79-2.18)	<b>2.36</b> (2.11-2.63)	<b>2.68</b> (2.37-3.01)	<b>3.03</b> (2.62-3.44)	<b>3.40</b> (2.88-3.91)	<b>4.00</b> (3.29-4.71)	<b>4.49</b> (3.60-5.40)
<b>24-hr</b>	<b>1.43</b> (1.33-1.54)	<b>1.75</b> (1.63-1.90)	<b>2.09</b> (1.95-2.26)	<b>2.37</b> (2.21-2.56)	<b>2.76</b> (2.55-2.97)	<b>3.06</b> (2.82-3.29)	<b>3.36</b> (3.09-3.62)	<b>3.67</b> (3.36-3.96)	<b>4.09</b> (3.71-4.76)	<b>4.54</b> (3.97-5.46)
<b>2-day</b>	<b>1.72</b> (1.60-1.85)	<b>2.10</b> (1.95-2.27)	<b>2.50</b> (2.33-2.70)	<b>2.83</b> (2.63-3.05)	<b>3.28</b> (3.04-3.53)	<b>3.62</b> (3.34-3.91)	<b>3.97</b> (3.64-4.29)	<b>4.32</b> (3.94-4.67)	<b>4.78</b> (4.32-5.19)	<b>5.12</b> (4.61-5.59)
<b>3-day</b>	<b>1.89</b> (1.76-2.04)	<b>2.32</b> (2.16-2.50)	<b>2.77</b> (2.58-2.98)	<b>3.14</b> (2.92-3.38)	<b>3.65</b> (3.38-3.92)	<b>4.04</b> (3.73-4.35)	<b>4.44</b> (4.08-4.79)	<b>4.85</b> (4.43-5.24)	<b>5.39</b> (4.88-5.85)	<b>5.80</b> (5.22-6.32)
<b>4-day</b>	<b>2.07</b> (1.92-2.22)	<b>2.53</b> (2.36-2.72)	<b>3.03</b> (2.83-3.25)	<b>3.44</b> (3.21-3.70)	<b>4.02</b> (3.73-4.31)	<b>4.46</b> (4.13-4.79)	<b>4.92</b> (4.52-5.29)	<b>5.38</b> (4.92-5.81)	<b>6.01</b> (5.45-6.51)	<b>6.49</b> (5.83-7.06)
<b>7-day</b>	<b>2.50</b> (2.33-2.68)	<b>3.06</b> (2.86-3.29)	<b>3.66</b> (3.41-3.92)	<b>4.15</b> (3.87-4.45)	<b>4.82</b> (4.48-5.17)	<b>5.34</b> (4.94-5.73)	<b>5.87</b> (5.40-6.30)	<b>6.39</b> (5.86-6.90)	<b>7.10</b> (6.45-7.71)	<b>7.64</b> (6.89-8.34)
<b>10-day</b>	<b>2.85</b> (2.66-3.05)	<b>3.50</b> (3.26-3.75)	<b>4.15</b> (3.88-4.44)	<b>4.68</b> (4.37-5.00)	<b>5.37</b> (5.00-5.74)	<b>5.88</b> (5.46-6.29)	<b>6.39</b> (5.91-6.85)	<b>6.89</b> (6.35-7.40)	<b>7.52</b> (6.89-8.12)	<b>7.99</b> (7.28-8.66)
<b>20-day</b>	<b>3.79</b> (3.53-4.05)	<b>4.65</b> (4.34-4.99)	<b>5.49</b> (5.13-5.88)	<b>6.13</b> (5.73-6.57)	<b>6.95</b> (6.49-7.43)	<b>7.54</b> (7.03-8.06)	<b>8.11</b> (7.54-8.68)	<b>8.65</b> (8.02-9.27)	<b>9.31</b> (8.60-10.0)	<b>9.78</b> (9.00-10.5)
<b>30-day</b>	<b>4.63</b> (4.33-4.95)	<b>5.68</b> (5.31-6.07)	<b>6.66</b> (6.23-7.12)	<b>7.42</b> (6.93-7.92)	<b>8.39</b> (7.82-8.96)	<b>9.08</b> (8.45-9.70)	<b>9.75</b> (9.04-10.4)	<b>10.4</b> (9.60-11.1)	<b>11.1</b> (10.3-12.0)	<b>11.7</b> (10.7-12.6)
<b>45-day</b>	<b>5.82</b> (5.43-6.24)	<b>7.11</b> (6.63-7.64)	<b>8.33</b> (7.78-8.94)	<b>9.29</b> (8.66-9.95)	<b>10.5</b> (9.79-11.2)	<b>11.4</b> (10.6-12.2)	<b>12.2</b> (11.4-13.1)	<b>13.0</b> (12.1-14.0)	<b>14.0</b> (12.9-15.1)	<b>14.7</b> (13.5-15.9)
<b>60-day</b>	<b>6.88</b> (6.42-7.35)	<b>8.41</b> (7.85-9.02)	<b>9.85</b> (9.21-10.5)	<b>11.0</b> (10.2-11.7)	<b>12.4</b> (11.5-13.2)	<b>13.4</b> (12.5-14.3)	<b>14.3</b> (13.3-15.4)	<b>15.2</b> (14.1-16.3)	<b>16.3</b> (15.1-17.6)	<b>17.1</b> (15.7-18.4)





<sup>1</sup> Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS). Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)

**PF graphical**

PDS-based depth-duration-frequency (DDF) curves

Latitude: 41.1331°, Longitude: -111.9381°

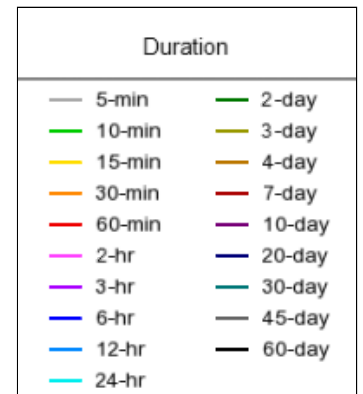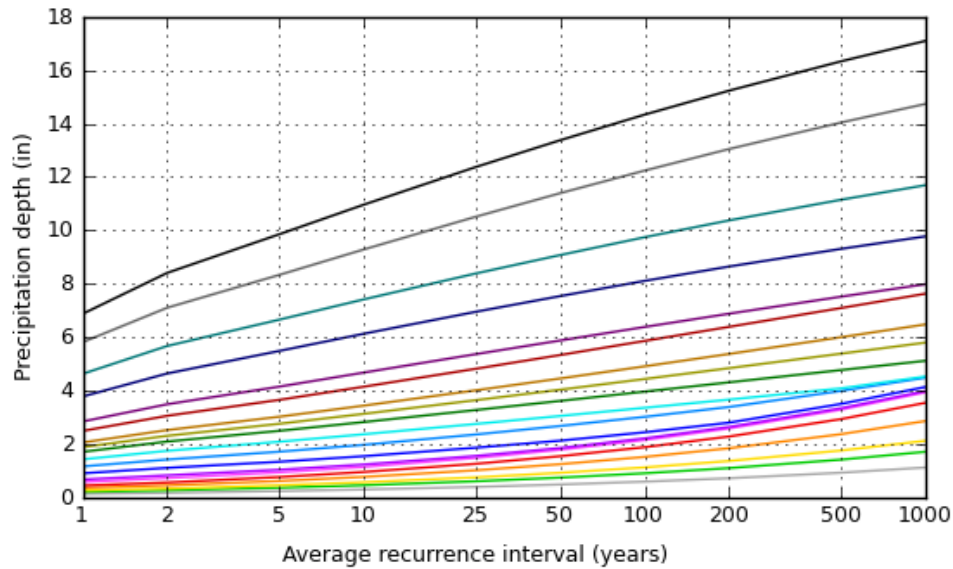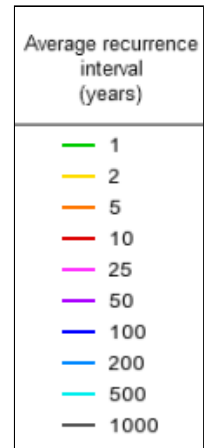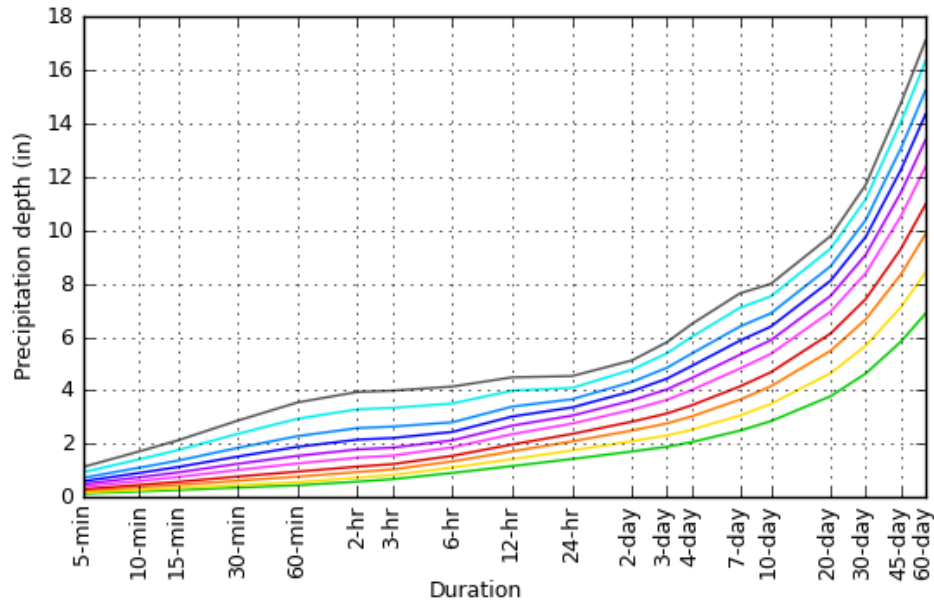

[Back to Top](#)

**Maps & aerials**

**Small scale terrain**

**APPENDIX B – MODIFICATIONS AND ADDITIONS TO MANUAL OF STANDARD SPECIFICATIONS**

Modifications and Additions to the  
2017 Manual of Standard Specifications

as published by:  
Utah LTAP Center  
Utah State University  
Logan Utah  
2017

## TABLE OF CONTENTS

<u>Section</u>	<u>Page No.</u>
<b>DIVISION 03            CONCRETE</b>	
03 20 00 M    CONCRETE REINFORCING (Modified) .....	1
03 30 04 M    CONCRETE (Modified).....	2
03 30 10 M    CONCRETE PLACEMENT (Modified).....	3
<b>DIVISION 31            EARTHWORK</b>	
31 23 16 M    EXCAVATION (Modified) .....	4
31 23 20        FILL .....	5
31 41 00 M    SHORING (Modified).....	8
<b>DIVISION 32            EXTERIOR IMPROVEMENTS</b>	
32 01 06        STREET NAME SIGNS.....	10
32 01 13.64 M    CHIP SEAL (Modified).....	11
32 01 05 M    BITUMINOUS CONCRETE .....	14
32 16 13 M    DRIVEWAY, SIDEWALK, CURB, GUTTER (Modified).....	15
32 31 13 M    CHAIN LINK FENCES AND GATES (Modified) .....	16
32 31 16 M    WELDED WIRE FENCES AND GATES (Modified).....	17
32 31 23        POLY(VINYL CHLORIDE)(PVC) FENCES AND GATES .....	18
32 92 00 M    TURF AND GRASS (Modified) .....	23
<b>DIVISION 33            UTILITIES</b>	
33 05 25 M    PAVEMENT RESTORATION (Modified).....	24
33 08 00 M    COMMISSIONING OF WATER UTILITIES (Modified) .....	25
33 11 00 M    WATER DISTRIBUTION AND TRANSMISSION (Modified).....	27
33 12 16 M    WATER VALVES (Modified) .....	31
33 12 19 M    HYDRANTS (Modified) .....	33
33 12 33 M    WATER METER (Modified).....	34
33 13 00 M    DISINFECTION (Modified) .....	36

**SECTION 03 20 00 M  
CONCRETE REINFORCING (MODIFIED)**

---

**PART 3 EXECUTION**

---

**3.1 PLACING**

*Add paragraphs F and G as follows:*

- F. No steel shall extend from or be visible on any finished surface
- G. All steel shall have a minimum of 1.5-inches of concrete cover.



**SECTION 03 30 04 M  
CONCRETE (Modified)**

---

**PART 2            PRODUCTS**

---

2.4    Add paragraph F as follows:

- F.    Fiber Reinforcement: A minimum of 1.0 pounds per cubic yard of polyolefin fiber reinforcement shall be evenly distributed into the mix. Mixing shall be as recommended by the manufacturer/supplier such that the fibers do not ball up. Polyolefin fibers shall meet the requirements of ASTM C1116 and ASTM D7508.

2.5    **MIX DESIGN**

*Replace Paragraph A with the following:*

- A.    **Class:** When not specified in the plans or project specifications, use the following table to select the class of concrete required for the application:

Class	Application
5,000	Reinforced Structural Concrete
4,000	Sidewalks, curb, gutter, cross gutters, waterways, pavements, and unreinforced footings and foundations
3,000	Thrust blocks
2,000	Anchors, mass concrete

**SECTION 03 30 10 M  
CONCRETE PLACEMENT (Modified)**

---

**PART 3      EXECUTION**

---

**3.2      PREPARATION**

*Add paragraph F as follows:*

- F. No concrete shall be placed until the surfaces have been inspected and approved by the City Engineer or City Inspector.

**SECTION 31 23 16 M  
EXCAVATION (Modified)**

---

**PART 3            EXECUTION**

---

**3.3      GENERAL EXCAVATION REQUIREMENT**

*Add paragraph I as follows:*

- I.    Excavation for pipelines under existing curb and gutter, concrete slabs, or sidewalks shall be open cut. Neither tunneling nor water jetting is allowed. At the option of the City Engineer, jacking or boring under permanent facilities may be allowed based on his/her direction.

Add Section 31 23 20 Fill

**SECTION 31 23 20  
FILL**

---

**PART 1          GENERAL**

---

**1.1      SECTION INCLUDES**

- A. Non-structural fill materials.
- B. Non-structural placement and compaction.

**1.2      REFERENCES**

**A.    ASTM Standards**

- D 698      Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft-lbf/ft<sup>3</sup> (600 kN-m/m<sup>3</sup>)).
- D 1557     Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort (56,000 ft-lbf/ft<sup>3</sup> (2,700 kN-m/m<sup>3</sup>)).
- D 2922     Density of Soil and Soil-Aggregate in Place by Nuclear Methods (Shallow Depth).

**1.3      SUBMITTALS**

- A. When requested by ENGINEER, submit laboratory dry density and optimum laboratory moisture content for each type of fill to be used.

**1.4      QUALITY ASSURANCE**

- A. Do not change material sources without ENGINEER's knowledge.
- B. Reject material that does not comply with the requirements specified in this Section.

**1.5      STORAGE**

- A. Safely stockpile materials.
- B. Separate differing fill materials, prevent mixing, and maintain optimum moisture content of materials.

**1.6      SITE CONDITIONS**

- A. Do not place, spread, or roll any fill material over material that is damaged by water. Remove and replace damaged material at no additional cost to OWNER.
- B. Control erosion. Keep area free of trash and debris. Repair settled, eroded, and rutted areas.
- C. Reshape and compact damaged structural section to required density.

**1.7      ACCEPTANCE**

- A. General: Native material may be wasted if there is no additional cost to substitute material acceptable to ENGINEER.
- B. Lift thickness: One test per Lot.

- C. Compaction: One test per Lot. Verify density using nuclear tests, ASTM D 2922.  
Compaction and Lot sizes as follows:
  - 1. Compact to 92% Standard Proctor
  - 2. One Lot = 1500 square feet per lift

### 1.8 **WARRANTY**

- A. Repair settlement damage at no additional cost to OWNER.

---

## **PART 2 PRODUCTS**

---

### 2.1 **FILL MATERIALS**

- A. Material shall be free from sod, grass, trash, rocks larger than four (4) inches in diameter, and all other material unsuitable for construction of compacted fills.

### 2.2 **WATER**

- A. Make arrangements for sources of water during construction and make arrangements for delivery of water to site.
- B. Comply with local Laws and Regulations at no additional cost to OWNER when securing water from water utility company.

---

## **PART 3 EXECUTION**

---

### 3.1 **PREPARATION**

- A. Implement the traffic control plan requirements, Section 01 55 26.
- B. Verify material meets maximum size requirements.
- C. If ground water is in the intended fill zone, dewater.

### 3.2 **PROTECTION**

- A. Protect existing trees, shrubs, lawns, structures, fences, roads, sidewalks, paving, curb and gutter and other features.
- B. Protect above or below grade utilities. Contact utility companies to repair utility damage. Pay all cost of repairs.
- C. Avoid displacement of and damage to existing installations while compacting or operating equipment.
- D. Do not use compaction equipment adjacent to walls or retaining walls that may cause wall to become over-stressed or moved from alignment.
- E. Restore any damaged structure to its original strength and condition.

### 3.3 **LAYOUT**

- A. Identify required line, levels, contours, and datum.
- B. Stake and flag locations of underground utilities.

- C. Upon discovery of unknown utility or concealed conditions, notify ENGINEER.
- D. Maintain all benchmarks, control monuments and stakes, whether newly established by surveyor or previously existing. Protect from damage and dislocation.
- E. If discrepancy is found between Contract Documents and site, ENGINEER shall make such minor adjustments in the Work as necessary to accomplish the intent of Contract Documents without increasing the Cost of the Work to CONTRACTOR or OWNER.

#### 3.4 **SUBGRADE**

- A. Protect Subgrade from desiccation, flooding, and freezing.
- B. Before placing fill over Subgrade, get ENGINEER's inspection of subgrade surface preparations.
- C. If Subgrade is not readily compactable get ENGINEER's permission to stabilize the subgrade.

#### 3.5 **TOLERANCES**

- A. Compaction: Ninety-two (92) percent minimum relative to a standard proctor density, Section 31 23 26.
- B. Lift Thickness (before compaction):
  - 1. Eight (8) inches when using riding compaction equipment.
  - 2. Six (6) inches when using hand held compaction equipment.

#### 3.6 **CLEANING**

- A. Remove stockpiles from site. Grade site surface to prevent free standing surface water.
- B. Leave borrow areas clean and neat.

END OF SECTION

**SECTION 31 41 00 M  
SHORING (Modified)**

---

**PART 1            GENERAL**

---

**1.2     PRICE – MEASUREMENT AND PAYMENT**

A. In Trenching, Shoring:

*Revise subparagraph 1 to read as follows:*

1. A two (2) part Protective System is required if each Side of the Trench is to be shored. The use of a Trench Box shall be classified as one Protective System.

**1.4     DESIGN OF PROTECTIVE SYSTEMS**

*Add paragraphs C and D as follows:*

- C. Trenches five (5) feet deep or greater require a protective system unless the excavation is made entirely in stable rock. If less than five (5) feet deep, a competent person may determine that a protective system is not required.
- D. Trenches 20 feet deep or greater require that the protective system be designed by a registered professional engineer or be based on tabulated data prepared and/or approved by a registered professional engineer in accordance with 1926.652(b) and (c).

**1.5     SUBMITTALS**

*Revise paragraph A to read as follows:*

- A. Submit a Protective System plan:
  1. When excavation is over twenty (20) feet deep, or
  2. When requested by ENGINEER.

*Add Article 1.6 as follows:*

**1.6     REFERENCES**

- A. 29 CFR Part 1910 – Occupational Safety and Health Standards
- B. 29 CFR Part 1926 Subpart P – Excavations

---

**PART 3            EXECUTION**

---

**3.4     INSPECTIONS**

*Add paragraph C as follows:*

- C. OWNER and/or ENGINEER may order an immediate work stoppage if working conditions are thought to be unsafe. Work may resume only after proper safety precautions are implemented.

**SECTION 32 01 06 M  
STREET NAME SIGNS (Modified)**

---

**PART 1      GENERAL**

---

**1.2      REFERENCES**

*Add paragraph C as follows:*

- C.    South Weber City Public Works Standard Drawings**



**SECTION 32 01 13.64 M  
CHIP SEAL (Modified)**

---

**PART 1            GENERAL**

---

**1.2    REFERENCES****A.   ASTM Standards:**

*Add the following to paragraph A:*

- C 29            Standard Test Method for Bulk Density (“Unit Weight”) and Voids in Aggregate
- C 330           Standard Specification for Lightweight Aggregates for Structural Concrete

*Rename Article 1.5 as follows:*

**1.5    WEATHER AND CONDITIONS****D.   Temperature**

*Add subparagraph 4 as follows:*

- 4.   Do not place if forecasted temperature is expected to drop below 40 deg F within 72 hours of placement.

**B.   Moisture and Wind:**

*Add subparagraph 1 as follows:*

- 1.   Do not place chip seal coat if surface moisture is present.

---

**PART 2            PRODUCTS**

---

**2.1    ASPHALT BINDER**

*Revise paragraph B as follows:*

- A.   Emulsified Asphalt: CRS-2P or LMCRS, Section 32 12 03. Use any of the following additives to match aggregate particle charge, weather conditions, and mix design:  
(Subparagraphs 1-5 remain unchanged.)

**2.2    COVER AGGREGATE****A.   Material:**

*Revise subparagraph 2 to read as follows:*

- 2.   100% Crusher processed rotary kiln lightweight expanded shale chips (Utelite or approved equal).

Replace Table 1 with the following:

Property	ASTM	Min.	Max.
Clay Lumps and Friable Particles, percent	C142	-	2
Bulk Density Dry Loose Condition, lb/ft <sup>3</sup>	C29	-	55

B. Gradation: Analyzed on a dry weight and percent passing basis.

Replace Table 2 with the following:

Sieve	ASTM	C330 Requirement
1/2"	C136	100
3/8"		80-100
No. 4		5-40
No. 8		0-20
No 16		0-10
No. 200		0-10

Replace Article 2.3 with the following:

### 2.3 FOG SEAL/FLUSH COAT

A. Material: Use cationic emulsified asphalt grade CSS-1h, Section 32 12 03.

Add Article 2.4 as follows:

### 2.4 MIX DESIGN

A. Select Type and grade of emulsified asphalt, ASTM D 3628.

B. Use the following application rates, or submit mix design for approval by Engineer.

1. Emulsion: Use Table 3.

Emulsion	Application Rate (gal/sy)
CRS-2P	0.32 – 0.35
LMCRS-2	0.32 – 0.35

2. Cover Material: Use Table 4.

Emulsion	Application Rate (lbs/sy)
CRS-2P	10.0 – 12.0
LMCRS-2	10.0 – 12.0

3. Fog Seal/Flush Coat: Use 0.10 – 0.12 gal/sy at a 2:1 dilution rate.

---

## **PART 3 EXECUTION**

---

### **3.2 PREPARATION**

*Add paragraph F as follows:*

- F. Cover manholes, valves boxes, storm drain inlets, and other service utility features before placing any chip seal coat.

### **3.4 APPLICATION**

*Revise paragraph A to read as follows:*

- A. Asphalt Emulsion: Keep viscosity between 50 and 100 centistokes during application, ASTM D 2170. Keep temperature to a minimum of 145 deg F.

*Revise Article 3.6 to read as follows:*

### **3.6 FOG SEAL/FLUSH COAT**

- A. Apply asphalt seal over the chips within 24 hours of placing chips.  
 B. Keep viscosity between 50 and 100 centistokes, during application, ASTM D 2170.

**SECTION 32 12 05 M  
BITUMINOUS CONCRETE (MODIFIED)**

**1.2 REFERENCES**

*Add the following paragraph to Section 1.2:*

- A. **Utah Department of Transportation (UDOT)**  
Quality Management Plan 514 Hot-Mix Asphalt

**1.3 DEFINITIONS**

*Add the following paragraph to Section 1.3:*

H. **Road Class**

- Class I: Includes maintenance mixes, bike paths, and residential driveways. (ESAL < 10<sup>4</sup> per year)
- Class II: Includes non-industrial parking lots, local and residential streets, and low volume (minor) collectors. (ESAL between 10<sup>4</sup> and 10<sup>6</sup> per year)
- Class III: Includes high volume (major) collectors, arterials, and industrial parking lots (primary load from 3-axle or greater vehicles). (ESAL > 10<sup>6</sup> per year)

**1.4 SUBMITTALS**

A. **General:**

*Add the following paragraph:*

4. Submit plant certification documentation (see 3.1.A)

B. **Quality Assurance:**

*Revise paragraph 3 to read as follows:*

1. Testing Report: Submit Quality Control data to the Engineer within one (1) working day after completion of each day of paving and prior to the start of the next paving day.

*Add the following paragraph:*

2. Plant Production Report: Submit daily plant productions records to the Engineer within one (1) working day after completion of each day of paving and prior to the start of the next paving day. Report shall include the following information:
- 2.1 Plant Location
  - 2.2 Production Date and Times
  - 2.3 Mix Designation
  - 2.4 Total Mix Tonnage
  - 2.5 Virgin Aggregate Tonnage

- 2.6 Virgin Asphalt Tonnage
- 2.7 RAP Aggregate Tonnage
- 2.8 Lime Tonnage
- 2.9 Water Tonnage

*Revise Section 2.3 to read as follows:*

### 2.3 **ADDITIVES**

- A. Mineral Filler: None
- B. Recycle Agent: None
- C. Anti-strip Agent: 1% Lime Slurry, minimum, meeting the HWT requirements for Superpave mixes
- D. RAP or ROSP (By weight or binder, whichever is lesser): Allowed up to 15%
  - 1. Free of detrimental quantities of deleterious materials
  - 2. No change in specified binder grade
  - 3. Determine RAP binder content by chemical extraction

### 2.4 **MIX DESIGN**

*Replace paragraph A with the following:*

- A. Project Specific Requirements:
  - 1. Less than 3-inch depth (including overlays)**
    - a. Option 1 – Superpave
      - i. Mix Designator (Compaction Effort): 75 gyrations (75 N<sub>d</sub>)
      - ii. Binder Grade: PG 58-28
      - iii. Master Grading Band: SP ½
    - b. Option 2 – Marshall
      - i. Mix Designator (Compaction Effort): 50 blow
      - ii. Binder Grade: PG 58-28
      - iii. Master Grading Band: DM ½
  - 2. 3-inch and greater depth**
    - a. Superpave
      - i. Mix Designator (Compaction Effort): 75 gyrations (75 N<sub>d</sub>)
      - ii. Binder Grade: PG 58-28
      - iii. Master Grading Band: SP ½

### 3.1 CONSTRUCTION EQUIPMENT

*Revise paragraph A to read as follows:*

- A. Mixing Plant: ASTM D995. Use a UDOT Quality Management Plan 514 certified asphalt mixing plant. Provide:
  - 1. Positive means to determine the moisture content of aggregate.
  - 2. Positive means to sample all material components.
  - 3. Sensors to measure the temperature of the mix at discharge.
  - 4. Ability to maintain discharge temperature of mix.
  - 5. Capability of maintaining plus or minus five (5) percent tolerance on component percentages in final mix.
  - 6. Oil Sand Introduction System: Do not burn off the light oils in Bitumen Binder (oil sand).

**SECTION 32 16 13 M**  
**DRIVEWAY, SIDEWALK, CURB, GUTTER (Modified)**

---

**PART 3            EXECUTION**

---

**3.4        CONTRACTION JOINTS**

D. Curb, Gutter, Waterway:

*Revise subparagraph 1 to read as follows:*

1. Place joints at intervals not exceeding 10 feet.

**3.5        EXPANSION JOINTS**

B. Sidewalks:

*Add subparagraph 5 as follows:*

5. Expansion joints are to be placed at 48-foot intervals (minimum) or wherever new sidewalk adjoins existing sidewalks, driveways, or aprons.

**SECTION 32 31 13 M**  
**CHAIN LINK FENCES AND GATES (Modified)**

---

**PART 2            PRODUCTS**

---

**2.6        POSTS, CAPS, RAILS, COUPLINGS**

- A. Posts, Frames, Stiffeners, Rails: ASTM F 1043:

*Revise applicable rows of Table 1 to read as follows:*

Top Rail	1-5/8" pipe
----------	-------------

---

**PART 3            EXECUTION**

---

**3.6        INSTALLATION OF FENCE FABRIC**

*Revise paragraph A to read as follows:*

- A. Place fence fabric on roadway side of posts unless otherwise specified. Place fabric approximately 1 inch above the grounds. Maintain a straight grade between posts by excavating ground high points and filling depressions with soil.



**SECTION 32 31 16 M**  
**WELDED WIRE FENCES AND GATES (Modified)**

---

**PART 1            GENERAL**

---

**1.2        REFERENCES**

*Add paragraph D as follows:*

D. UDOT Standard Drawing

FG 2A        Right of Way Fence and Gates (Metal Post)

FG 2B        Right of Way Fence and Gates (Metal Post)

---

**PART 3            EXECUTION**

---

**3.2        INSTALLATION**

*Add paragraph N as follows:*

N. Install per UDOT Standard Drawings FG 2A and FG 2B.

Add Section 32 31 23 Poly(Vinyl Chloride)(PVC) Fences and Gates

**SECTION 32 31 23  
POLY(VINYL CHLORIDE)(PVC) FENCES AND GATES**

---

**PART 1            GENERAL**

---

**1.1      SECTION INCLUDES**

- A. PVC fencing, posts, gates, and appurtenances.

**1.2      REFERENCES**

A. **ASTM Standards:**

- |        |  |
|--------|--|
| D 1784 | Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds |
| F 626  | Fence Fittings   |
| F 964  | Rigid Poly(Vinyl Chloride)(PVC) Exterior Profiles Used for Fencing and Railing                   |
| F 1999 | Installation of Rigid Poly(Vinyl Chloride)(PVC) Fence Systems                                    |

**1.3      SUBMITTALS**

- A. Drawings: Indicate plan layout, grid, size and spacing of components, accessories, fittings, anchorage, and post section.
- B. Data: Submit manufacturer's installation instructions and procedures, including details of fence and gate installation.
- C. Submit sample of fence fabric and typical accessories.

---

**PART 2            PRODUCTS**

---

**2.1      GENERAL**

- A. Products from other qualified manufacturers having a minimum of 5 years' experience manufacturing PVC fencing will be acceptable by the architect as equal, if approved in writing, ten days prior to bidding, and if they meet the following specifications for design, size, and fabrication. PVC Profiles, lineals, and extrusions used as components must "meet or exceed" the minimum performance guidelines laid out in ASTM 964.

**2.2      PVC FENCE**

- A. Pickets, rails, and posts fabricated from PVC extrusion. The PVC extrusions shall comply with ASTM D 1784, Class 14344B and have the following characteristics:

Specific Gravity (+/- 0.02)	1.4
Using 0.125 specimen Izod impact ft. lbs./in. notch	23.0
Tensile strength, PSI	6,910
Tensile modulus, PSI	336,000
Flexural yield strength, PSI	10,104
Flexural modulus, PSI	385,000
DTUL at 264 PSI	67°C

- B. All fence parts made from PVC shall have a minimum thickness of 0.17 in except where specified otherwise.

### 2.3 POST CAPS

- A. Molded, one piece.
- B. Cross Section: Match post or gate upright cross section.
- C. Thickness: 0.095" minimum.
- D. Configuration: Flat or four-sided as required for installation to top of posts and gate.

### 2.4 ACCESSORIES

- A. Standard gate brace, screw caps, rail end reinforcers, and other accessories as required.

### 2.5 MISCELLANEOUS MATERIALS

- A. Stiffener Chemicals: Galvanized steel structural channel. Configure channels for concealed installation within PVC rails with pre-drilled holes for drainage. Aluminum extruded channel available upon request.
1. Cross Section: 3.00" x 3.00" x 1.500" hourglass shape to grip picket.
  2. Thickness: 0.040 Gauge (minimum)
- B. Fasteners and Anchorage: Stainless Steel. All fasteners to be concealed or colored heads to match. Provide sizes as recommended by fence manufacturer.
- C. PVC Cement: As recommended by fence manufacturer.

### 2.6 GATE HARDWARE AND ACCESSORIES

- A. General: Provide hardware and accessories for each gate according to the following requirements.
- B. Hinges: Size and material to suit gate size, non-lift-off type, self-closing, glass filled nylon with stainless steel adjuster plate, offset to permit 120 degree gate opening. Provide one pair of hinges for each gate.
1. Stainless Steel, painted with carbo zinc base.
  2. Finish: Pre-painted, 2 coats "Polane."
  3. Color: Black Gravity Latch or dual access gravity latch.
- C. Latch: Manufacturers' standard self-latching, thumb latch, pre-finished steel, or stainless steel gravity latch. Provide one latch per gate.

1. Finish: Match gate hinge finish.
  - D. Hardware: Stainless Steel. Provide sizes as recommended by fence manufacturer.
    1. Finish: Match gate hinge finish.
- 2.7 **CONCRETE**
- A. Use Class 3000 concrete. Section 03 30 04.
- 2.8 **REINFORCING FOR FILLED POSTS**
- A. Steel Reinforcing:
    1. Steel Reinforcing Bars: ASTM A 615. Grade 60. Deformed (#4 or ½").
    2. Install 2 bars for each corner or gate post as specified in the drawings.

---

**PART 3 EXECUTION**

---

**3.1 PREPARATION**

- A. Locate and preserve utilities, Section 31 23 16.
- B. Excavation, Section 31 23 16.
- C. Review to ASTM F 567 and CLFMI products manual for chain link fence installation.
- D. Protect roots and branches of trees and plants to remain.
- E. Limit amount of clearing and grading along fence line to permit proper installation.

**3.2 LAYOUT OF WORK**

- A. Accurately locate and stake locations and points necessary for installation of fence and gates.
- B. General arrangements and location of fence and gates are indicated. Install except for minor changes required by unforeseen conflicts with work of other trades.

**3.3 INSTALLATION – GENERAL**

- A. Install fence in compliance with manufacturer’s written instructions.
- B. PVC components shall be carefully handled and stored to avoid contact with abrasive surfaces.
- C. Install components in sequence as recommended by fence manufacturer.
- D. Install fencing as indicated on the drawings provided.
- E. Variations from the installation indicated must be approved.
- F. Variations from the fence and gate installation indicated and all costs for removal and replacement will be the responsibility of the CONTRACTOR.

**3.4 INSTALLATION OF POSTS**

- A. Excavation
  1. Drill or hand-excavate (using post hole digger) holes for posts to diameters and spacings indicated, in firm, undisturbed or compacted soil.

2. If not indicated on drawings, excavate holes for each post to a minimum diameter of 12 inches.
3. Unless otherwise indicated, excavate hole depths not less than 30 inches or to frost line.

**B. Posts**

1. Install posts in one piece, plumb and in line. Space as noted in the drawings. Enlarge excavation as required to provide clearance indicated between post and side of excavation.
2. Protect portion of posts above ground from concrete splatter. Place concrete around posts and vibrate or tamp for consolidation. Check each post for vertical and top alignment and hold in position during placement and finishing operations.
  - a. Unless otherwise indicated, terminate top of concrete footings 3 inches below adjacent grade and trowel to a crown to shed water.
  - b. Secure posts in position for manufacturer's recommendations until concrete sets.
  - c. After installation of rails and unless otherwise indicated, install reinforcing in posts in opposing corners of post as shown and fill end and gate posts with concrete to level as indicated. Concrete fill shall completely cover the reinforcing steel and gate hardware fasteners. Consolidate the concrete by striking the post face with a rubber mallet, carefully tamping around the exposed post bottom.
  - d. Install post caps. Use #8 screws, nylon washers and snap caps.
  - e. Remove concrete splatters from PVC fence materials with care to avoid scratching.

**3.5 INSTALLATION OF RAILS**

**A. Top and Bottom Rails**

1. Install rails in one piece into routed hole fabricated into posts to receive top and bottom rails, and middle where necessary. Except at sloping terrain, install rails level.
  - a. Prior to installation of rails into posts, insert concealed steel channel stiffeners in top rail, where necessary. Bottom rails shall include minimum 2- $\frac{1}{4}$ " drainage holes.
  - b. At posts to receive concrete fill, tape rail ends to prevent seepage when filling post with concrete.

**B. Middle Rails:**

1. Where necessary, install middle rails in one piece into routed hole in posts with larger holes facing down. Except at sloping terrain, install middle rails level. Secure mid rail to pickets with 2-#8 x 1- $\frac{1}{2}$ " screws evenly spaced.
  - a. At posts to receive concrete fill, tape rail ends to prevent seepage when filling post with concrete.

**3.6 INSTALLATION OF FENCE FABRIC/PICKETS**

- A. Pickets:** Install pickets in one piece as per manufacturer recommendations. Install pickets plumb.

**3.7 INSTALLATION ON SLOPING TERRAIN**

- A. At sloping terrain rails may be racked (sloped) or stepped to comply with manufacturer's recommendations.

**3.8 INSTALLATION OF GATES**

- A. Prior to installation of rails into posts, apply PVC cement into sockets per manufacturer's recommendations. Bottom rail shall include minimum 2-¼" drainage holes.
- B. Assemble gate prior to fence installation to accurately locate hinge and latch post. Align gate horizontal rails with fence horizontal rails.
- C. Install gates plumb, level, and secure for full opening without interference according to manufacturer's instructions.
- D. Gate Latch Installation. Install gate latch according to manufacturer's instructions.
- E. Allow minimum 72 hours to let concrete set-up before opening gates.

END OF SECTION

**SECTION 32 92 00 M  
TURF AND GRASS (Modified)**

---

**PART 1            GENERAL**

---

**1.3      SUBMITTALS**

*Add paragraph C as follows:*

- C. Submit seed mix.

---

**PART 2            PRODUCTS**

---

**2.1      SEED**

*Add paragraph D as follows:*

- D. Seed Mix:

<u>SEED #</u>	<u>BOTANICAL NAME</u>	<u>COMMON NAME</u>	<u>% by Weight</u>
1	Agropyron cristatum 'Fairway'	Fairway Crested Wheatgrass	15%
2	Agropyron riparium 'Sodar'	Streambank Wheatgrass	20%
3	Bromus inermis 'Manchar'	Smooth Brome	32%
4	Fescue rubra 'Fortress'	Red Fescue	25%
5	Poa compressa 'Reuben's'	Reuben's Canadian Bluegrass	6%
6	Trifolium repens	White Dutch Cover	2%

---

**PART 3            EXECUTION**

---

**3.4      SEEDING**

*Revise paragraph A to read as follows:*

- A. Apply seed at a rate of eight (8) pounds per 1,000 square feet evenly in two (2) intersecting directions. Rake in lightly.

**SECTION 33 05 25 M  
PAVEMENT RESTORATION (Modified)**

---

**PART 1            GENERAL**

---

**1.2        REFERENCES**

*Replace paragraph A to read as follows:*

- A.    South Weber City Public Works Standard Drawings**

---

**PART 2            PRODUCTS**

---

**2.2        ASPHALT PAVEMENT**

*Revise paragraph A to read as follows:*

- A.    Permanent Warm Weather Asphalt Concrete: Section 32 12 05 M unless indicated otherwise.**

*Revise paragraph C to read as follows:*

- C.    Pavement Sealing:**
- 1.    Crack Seal: Section 32 01 17**
  - 2.    Chip Seal: Section 32 01 13.64 and 32 01 13.64 M.**
  - 3.    Fog Seal: Section 32 01 13.50.**

---

**PART 3            EXECUTION**

---

**3.5        ASPHALT PAVEMENT RESTORATION**

*Revise paragraphs A and B to read as follows:*

- A.    Follow South Weber City Public Works Standard Drawings.**
- B.    Match existing pavement thickness or 4-inches minimum, whichever is greater.**



**SECTION 33 08 00 M**  
**COMMISSIONING OF WATER UTILITIES (Modified)**

---

**PART 3            EXECUTION**

---

**3.5        INFILTRATION TEST**

*Revise paragraph A to read as follows:*

- A. General: 150 gallons per inch diameter per mile per day. If the ground water table is less than two (2) feet above the crown of the pipe, the infiltration test is not required.

*Revise Article 3.6 in its entirety to read as follows:*

**3.6        EXFILTRATION TEST**

A. Non-Pressurized System:

- 1. General: Air test or hydrostatic test is CONTRACTOR's choice.
- 2. Air Test:
  - a. Plastic Pipe: ASTM F 1417.
    - (i) For pipe up to 30 inches diameter, pressure drop is 0.5 psi.
    - (ii) For pipe larger than 30 inches diameter, isolated joint test is 3.5 psi maximum pressure drop is 1.0 psi in 5 seconds.
  - b. Concrete Pipe:
    - (i) ASTM C 1214 for concrete pipe 4" to 24" diameter.
    - (ii) ASTM C 1103 for concrete pipe 27" and larger.
- 3. Hydrostatic Test: Provide air release taps at pipeline's highest elevations and expel all air before the test. Insert permanent plugs after test has been completed.
  - a. Plastic Pipe: ASTM F 2497.
  - b. Concrete Pipe: ASTM C 497. Abide by Section 3 and Section 16 in the ASTM standard and applicable recommendations of manufacturer.

B. Pressurized System:

- 1. Pressure Test: All newly laid pipe segments and their valves, unless otherwise specified, shall be subjected to a hydrostatic pressure test of 225 psi or 50 psi above working pressure, whichever is higher. The hydrostatic pressure test shall be conducted after the pipe segments have been partially backfilled.
- 2. Duration of Pressure Test: The duration of each hydrostatic pressure test shall be at least two (2) hours.
- 3. Test Procedure: Each pipe segment shall be slowly filled with water and the specified test pressure, measured at the point of lowest elevation, shall be applied by means of a pump connected to the pipe in a satisfactory manner. Testing against closed valves will be allowed. The pump, pipe connection, and all necessary apparatus including gauges

and meters shall be furnished by the CONTRACTOR. CONTRACTOR shall provide all labor and equipment necessary to perform the test.

4. Expelling Air Before Test: Before applying the specified test pressure, all air shall be expelled from the pipe. To accomplish this, air release mechanisms shall be installed, if necessary, at points of highest elevation, and afterwards tightly capped.
5. Examination Under Pressure: All pipes, fittings, valves, hydrants, joints, and other hardware will be subject to examination under pressure during the hydrostatic test. Any defective pipes, fittings, hydrants, valves, or other hardware discovered in consequence of this pressure test shall be removed and replaced by the CONTRACTOR with sound material, at no expense to the OWNER, and the test shall be repeated until the ENGINEER is satisfied.
6. No piping installation will be acceptable until the leakage is less than the amount allowed by industry standards for the type of pipe material being tested. Or, if no standard prevails, than the number of gallons per hour is determined by the formula:

$$Q = \frac{LD\sqrt{P}}{148,000}$$

Where: Q = allowable leakage, gallons per hour  
L = length of pipe under test, feet  
D = diameter of pipe, inches  
P = average test pressure, psig

**SECTION 33 11 00 M**  
**WATER DISTRIBUTION AND TRANSMISSION (Modified)**

---

**PART 1            GENERAL**

---

**1.2        REFERENCES**

*Revise paragraph B to read as follows:*

**B.    South Weber City Public Works Standard Drawings**

*Add to paragraph C. AWWA Standards:*

C105	Polyethylene Encasement for Ductile Iron Pipe Systems
C110	Ductile-Iron and Gray-Iron Fittings
C111	Rubber-Gasket Joints for Ductile-Iron Pressure Pipe and Fittings
C223	Fabricated Steel and Stainless Steel Tapping Sleeves
M14	AWWA Recommended Practice for Backflow Prevention and Cross-Connection Control

*Add paragraph F as follows:*

**F.    ANSI/NSF Standards:**

61	Drinking Water System Components
----	----------------------------------

**1.3        PERFORMANCE REQUIREMENTS**

*Replace paragraph A with the following:*

**A.    Depth of Cover:**

1. Minimum as indicated on the drawings. If minimum cannot be achieved, contact ENGINEER.
2. Maximum of 72 inches unless indicated on the plans or approved by ENGINEER.

**1.5        SITE CONDITIONS**

*Revise paragraph D to read as follows:*

- D.    Do not operate any water valve until its owner and water company's permission is secured.**

---

**PART 2        PRODUCTS**

---

**2.1        PIPES AND FITTINGS**

*Revise paragraph A to read as follows:*

- A. Provide piping materials and factory fabricated piping products of sizes, types, pressure ratings, and capacities indicated. Use only NSF 61 approved products in drinking water systems. All such products shall be appropriately stamped with the NSF logo.

*Add paragraphs E and F as follows:*

- E. Mechanical Joint Fittings: Ductile iron, Class 250
- F. Flanged Fittings: Ductile iron, Class 250

**2.3        VALVE BOX**

*Revise paragraph A to read as follows:*

- A. Buried Valves in Traffic Areas: Cast iron two (2) piece slip sleeve type, 5-1/4 inch shaft, with a drop lid, rated for HL-93 loading.

*Revise paragraph C to read as follows:*

- C. Markings: Potable water main line valves box covers shall contain the wording "SOUTH WEBER WATER."

*Add Articles 2.9 and 2.10 as follows:*

**2.9        TAPPING SLEEVE AND VALVE**

- A. AWWA C223.
- B. Sleeve shall be full circumferential seat with all stainless steel tapping sleeve.
- C. Flanged outlet with flanged by MJ valve.

**2.10       FIRE SPRINKLER/SUPPRESSION LINES**

- A. Lines:
  - 1. Ductile iron, Class 51, or as approved in writing by OWNER or ENGINEER.
  - 2. Meet all specifications for main lines.
- B. Valve:
  - 1. All fire lines shall be equipped with an isolation gate valve located at the main line.

---

**PART 3 EXECUTION**

---

**3.3 LAYOUT**

*Replace paragraph B with the following:*

- B. The Utah Division of Drinking Water must grant an exception where a potable water line crosses under a sanitary sewer line.

**3.4 INSTALLATION – PIPE AND FITTING**

- A. General:

*Add subparagraphs 3 through 7 as follows:*

- 3. Encase all buried ductile iron valves, fitting, connections, and specialties in minimum 8 mil. polyethylene sheets in accordance with AWWA C105.
- 4. Waterline shall be laid and maintained to lines and grades established by the drawings, with fittings and valves at the required locations. Deviations as approved in writing by OWNER or ENGINEER.
- 5. Lay water lines on a continuous grade to avoid high points except as shown on the plans.
- 6. Cut edges and rough ends shall be ground smooth. Bevel end for push-on connections.
- 7. Do not drop pipe or fittings into trench.

*Add paragraph I as follows:*

- I. Tie-Ins:
  - 1. All tie-ins shall be made dry and not on a day proceeding a weekend or holiday.
  - 2. OWNER requires 48-hours' notice for water turn-off.
  - 3. At least 24-hours prior to a service disruption, CONTRACTOR shall notify all affected water users.
  - 4. Where shutting down a line is not feasible as determine by OWNER or ENGINEER, CONTRACTOR shall make a wet tap using a tapping sleeve and valve.

**3.5 INSTALLATION – CONCRETE THRUST BLOCK**

*Revise paragraph A to read as follows:*

- A. South Weber City Public Works Standard Drawings.

**3.8 INSTALLATION – TAPS**

*Revise paragraph A to read as follows:*

- A. South Weber City Public Works Standard Drawings.

**3.9 INSTALLATION – SERVICE LINE**

*Revise paragraph C to read as follows:*

- C. Meter Box: South Weber City Public Works Standard Drawings.

*Add paragraph D as follows:*

- D. New Water Service Line
  - 1. 1" Service
    - a. All laterals must be of one continuous copper tube between the corp stop and the meter box. No joints or copper to copper connectors are allowed.
  - 2. 1.5" and 2" Services
    - a. All solder joints shall be 95-5 solder or better, or Mueller compression fittings.

**3.10 INSTALLATION – WATERMAIN LOOP (SYPHON)**

*Revise paragraph A to read as follows:*

- A. South Weber City Public Works Standard Drawings.

**3.12 BACKFILLING**

- B. Trenches: Section 33 05 20:

*Revise subparagraphs 1 and 2 to read as follows:*

- 1. Pipe zone backfill, South Weber City Public Works Standard Drawings.
- 2. Trench backfill, South Weber City Public Works Standard Drawings.

**3.13 SURFACING RESTORATION**

- A. Roadway Trenches and Patches: Section 33 05 25:

*Revise subparagraphs 1 and 2 to read as follows:*

- 1. Asphalt concrete patch, South Weber City Public Works Standard Drawings.
- 2. Concrete pavement patch, contact OWNER for instructions.

*Add new Article 3.14 as follows:*

**3.14 FIRE SPRINKLER/SUPPRESSION LINES**

- A. Notify OWNER 48 hours prior to installation.
- B. Unless written authorization is given by OWNER, no services shall be connected to the fire sprinkler/suppression lines.
- C. Location: As approved by OWNER.

---

**SECTION 33 12 16 M  
WATER VALVES (Modified)**

---

**PART 1            GENERAL**

---

**1.2    REFERENCES**

*Modify the fourth (4<sup>th</sup>) item in paragraph A to read as follows:*

C509            Resilient-Seated Gate Valves for Water Supply Service

*Add paragraph B as follows:*

**B.   South Weber City Public Works Standard Drawings**

---

**PART 2            PRODUCTS**

---

**2.1    VALVES – GENERAL**

A.   Underground:

*Add subparagraph 3 as follows:*

3.   Valves over five (5) feet in depth shall have a valve nut extension stem.

**2.2    GATE VALVES**

*Add paragraph D as follows:*

D.   Model: Mueller A-2361

*Add Article 2.10 as follows:*

**2.10   AIR/VACUUM RELIEF VALVES**

- A.   Operation: Relieve air build-up and/or allow intrusion of air to prevent vacuum conditions within pipe.
- B.   Location: Valve and vent placement location as approved by OWNER or ENGINEER.
- C.   Connection: Service saddle.

---

**PART 3            EXECUTION**

---

**3.1    INSTALLATION**

*Add paragraphs D, E, and F as follows:*

- D.   Prior to installation, inspect valves for direction of opening, freedom of operation, tightness of pressure-containing bolting, and cleanliness of valve ports and seating surfaces.
- E.   Examine all valves for damage or defects immediately prior to installation.
- F.   Mark and hold defective materials for inspection by OWNER or ENGINEER. Replace rejected materials.

---

**SECTION 33 12 19 M  
HYDRANTS (Modified)**

---

**PART 1            GENERAL**

---

**1.2        REFERENCES**

*Revise paragraph A to read as follows:*

- A. **South Weber City Public Works Standard Drawings**

---

**PART 2            PRODUCTS**

---

**2.1        DRY-BARREL FIRE HYDRANT**

*Add paragraph C as follows:*

- C. Model: Mueller Super Centurion.

**2.2        VALVES**

*Revise paragraph A to read as follows:*

- C. Gate Valve: Section 33 12 16.

**2.3        ACCESSORIES**

*Revise paragraph D to read as follows:*

- D. Valve Box, Valve Chamber: Section 33 11 00.

---

**PART 3            EXECUTION**

---

**3.2        INSTALLATION**

*Revise paragraph A to read as follows:*

- C. Install hydrant according to South Weber City Public Works Standard Drawings and AWWA M17.

*Revise paragraph H to read as follows:*

- H. Install thrust block according to South Weber City Public Works Standard Drawings.



---

**SECTION 33 12 33 M  
WATER METER (Modified)**

---

**PART 1            GENERAL**

---

**1.2        REFERENCES**

*Add paragraph B as follows:*

- E.    South Weber City Public Works Standard Drawings.**

---

**PART 2            PRODUCTS**

---

**2.2        METERS FOR SERVICE PIPING**

*Revise paragraph A to read as follows:*

- F.    OWNER shall supply and set all 1” meters. All other meters supplied and set by CONTRACTOR.**

**2.3        SERVICE LINE, VALVES, AND FITTINGS**

*Revise paragraph A to read as follows:*

- A.    Service Pipe: Type K Copper, Section 33 05 03, with compression copper fittings made of brass.**

*Revise paragraph B to read as follows:*

- B.    Service Valves and Fittings:**
- 1.    AWWA C800.**
  - 2.    1-Inch Service Laterals – Brass corporation stops with CC thread.**
  - 3.    1.5-Inch and 2-Inch Service Laterals – Copper or brass screw-type fittings (ball valves, strainers, nipples, tees, bends, etc.).**
  - 4.    Greater than 2-Inch – Coordinate with and obtain approval from OWNER and ENGINEER.**

*Replace Article 2.4 with the following:*

**2.4        METER BOXES**

- A.    See South Weber City Public Works Standard Drawings.**

---

**PART 3            EXECUTION**

---

**3.1        INSTALLATION**

*Revise paragraph D to read as follows:*

D. OWNER Supplied Meters: Installed by OWNER unless indicated otherwise.

*Add paragraphs E and F as follows:*

- E. Install one solid piece of copper pipe from main to meter.
- F. Install service laterals with 60-inches of cover, minimum.

---

**SECTION 33 13 00 M**  
**DISINFECTION (Modified)**

---

**PART 1 GENERAL**

---

**1.2 REFERENCES**

*Modify paragraph B to read as follows:*

- B. Utah Administrative Code  
R309 Drinking Water

*Add paragraph C as follows:*

- C. NSF/ANSI Standards:  
60 Drinking Water Treatment Chemicals – Health Effects

**1.4 SUBMITTALS**

*Delete paragraphs B, C, and D in their entirety.*

*Add Article 1.8 as follows:*

**1.8 WORK PERFORMED BY OWNER**

- A. OWNER will perform bacteriological and high chlorine sampling and testing. CONTRACTOR shall provide all other work associated with this Section.

---

**PART 2 PRODUCTS**

---

**2.10 DISINFECTANT**

*Add paragraph E as follows:*

- E. All products shall comply with NSF/ANSI 60.

---

**PART 3 EXECUTION**

---

**3.1 PREPARATION**

*Add paragraphs C and D as follows:*

- C. Notify OWNER at least 72 hours prior to any flushing or disinfecting.
- D. Install temporary connections for flushing water lines after disinfection. After the satisfactory completion of the flushing work, remove and plug the temporary connection.

**3.2 DISINFECTION OF WATER LINES**

*Revise paragraph D to read as follows:*

- D. Coordinate with OWNER to collect a bacteriological water sample at end of line to be tested. If sample fails bacteriological test, flush system and retest. Continue flushing and retesting until sample passes test.

*Revise paragraph G to read as follows:*

- G. After a passing bacteriological test sample is obtained, let the system relax for 24 hours. Flush and coordinate with OWNER to collect a subsequent bacteriological sample for testing. If the subsequent test passes, then water line is acceptable.

**3.5 FIELD QUALITY CONTROL**

- A. Bacteriological Test:

*Revise subparagraphs 1 and 2 to read as follows:*

1. Coordinate with OWNER to collect samples for testing no sooner than 16 hours after system flushing.
2. OWNER will have water samples analyzed per State of Utah requirements.

*Add Article 3.6 as follows:*

**3.6 SPECIAL PROCEDURE FOR TAPPING SLEEVES**

- A. Before a tapping sleeve is installed, the exterior of the main to be tapped shall be thoroughly cleaned, and the interior surface of the sleeve shall be lightly dusted with calcium hypochlorite powder.


## **APPENDIX C - SOUTH WEBER CITY PUBLIC WORKS STANDARD DRAWINGS**


# SOUTH WEBER CITY CORPORATION

## PUBLIC WORKS STANDARD DRAWINGS


### Index of Drawings

#### SUBMITTED & RECOMMENDED

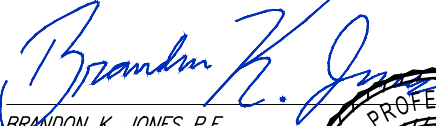
  
 BRANDON K. JONES P.E.  
 SOUTH WEBER CITY ENGINEER




3/5/19  
DATE

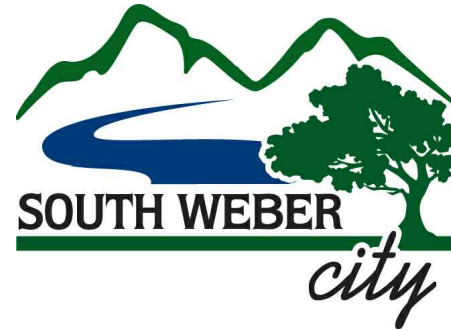


#### APPROVAL

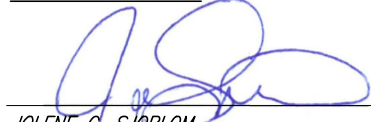  
 JOLENE C. SJÖBLOM  
 SOUTH WEBER CITY MAYOR


3/5/19  
DATE

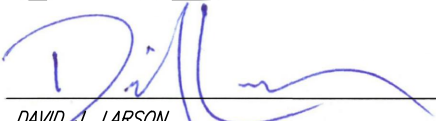  
 DAVID J. LARSON  
 SOUTH WEBER CITY MANAGER


3/6/19  
DATE

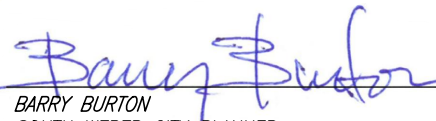  
 BARRY BURTON  
 SOUTH WEBER CITY PLANNER


3-6-19  
DATE

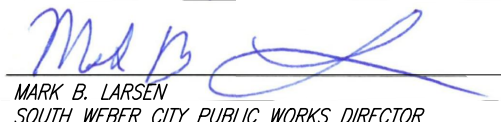  
 MARK B. LARSEN  
 SOUTH WEBER CITY PUBLIC WORKS DIRECTOR

3/5/19  
DATE

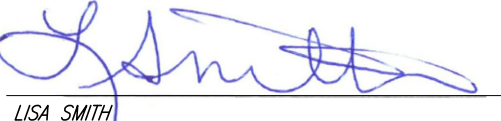  
 LISA SMITH  
 ATTEST, SOUTH WEBER CITY RECORDER


3/6/19  
DATE

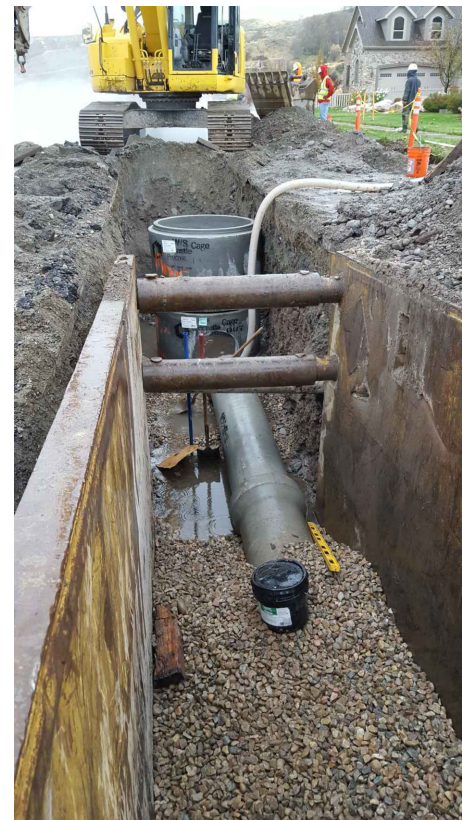

- CS-01.....TITLE PAGE & INDEX OF DRAWINGS
- CS-02.....PUBLIC ROADS - TYPICAL LOCAL STREET SECTION & UTILITY LATERAL CONFIGURATION DETAILS
- CS-03.....PUBLIC ROADS - SOUTH WEBER DRIVE & SOUTH BENCH DRIVE TYPICAL CROSS SECTION DETAILS
- CS-04.....PUBLIC ROADS - TYPICAL INTERSECTION & STREET DETAILS
- CS-05.....PUBLIC ROADS - TYPICAL DRIVE APPROACH, ASPHALT PATCH & DEFECTIVE CONCRETE REPLACEMENT DETAILS
- CS-05A...PUBLIC ROADS - APWA PLAN 255 BITUMINOUS PAVEMENT T-PATCH
- CS-06.....PUBLIC ROADS - TYPICAL ADA RAMP, SIDEWALK, CURB & GUTTER, AND CONCRETE JOINT DETAILS
- CS-07.....PUBLIC ROADS - CUL-DE-SAC & TEMP. TURNAROUND DETAILS
- CS-08.....CULINARY WATER - RESIDENTIAL WATER SERVICE DETAILS
- CS-09.....CULINARY WATER - AIR/VACUUM RELIEF STATION & FIRE HYDRANT DETAILS
- CS-10.....CULINARY WATER - TRACER WIRE INSTALLATION DETAILS
- CS-11.....CULINARY WATER - STANDARD WATER METER STATIONS
- CS-12.....CULINARY WATER - PRESSURE REDUCTION STATION
- CS-13.....CULINARY WATER - THRUST BLOCK, WATERLINE LOOP, PIPE TRENCH & MISC. VAULT DETAILS
- CS-14.....SANITARY SEWER - LATERAL & CONNECTION DETAILS
- CS-15.....SANITARY SEWER - TYPICAL MANHOLES & DETAILS
- CS-16.....STORM DRAIN - SINGLE AND DOUBLE CATCH BASIN DETAILS
- CS-17.....STORM DRAIN - DRAINAGE INLET BOX & GENERAL GRATE AND FRAME DETAILS
- CS-18.....STORM DRAIN - MANHOLE DETAILS
- CS-19.....STORM DRAIN - LARGE DETENTION BASIN DETAILS
- CS-20.....STORM DRAIN - SMALL DETENTION BASIN DETAILS
- CS-21.....GENERAL - CHAIN LINK FENCE DETAILS
- CS-22.....GENERAL - STREET LIGHTING STANDARDS
- CS-23.....GENERAL - LID (LOW IMPACT DEVELOPMENT) EXAMPLES


**GENERAL NOTES:**

1. PROVIDE 4" THICKNESS OF 3/4" OR 1" UNTREATED BASE COURSE UNDER SIDEWALK, DRIVEWAY APPROACHES AND CURB & GUTTER, COMPACTED TO 95%, PER ASTM D-1557.
2. THESE PAVEMENT THICKNESS SHALL BE CONSIDERED AS CITY MINIMUMS AND MAY BE INCREASED BY THE CITY ENGINEER WHEN A GREATER DEPTH IS NECESSARY TO PROVIDE SUFFICIENT STABILITY. DESIGNER AND/OR DEVELOPER MAY SUBMIT AN ALTERNATIVE PAVEMENT DESIGN BASED ON A DETAILED SOILS ANALYSIS FOR APPROVAL BY THE CITY ENGINEER WHICH MAY MODIFY PAVEMENT THICKNESS, BUT IN NO CASE SHALL THE BITUMINOUS SURFACE COURSE BE LESS THAN 4" AND UNTREATED BASE COURSE LESS THAN 12" THICK.
3. ALL ROAD CUTS SHALL BE PATCHED PER CS-05 AND CS-13
4. CURB & GUTTER AND SIDEWALKS SHALL BE CONSTRUCTED USING FIBER REINFORCED CONCRETE AND IN COMPLIANCE WITH SOUTH WEBER CITY TECHNICAL SPECIFICATIONS AND THESE DRAWINGS.
5. ALL CULINARY WATER MAINS AND SERVICES MUST MAINTAIN A MINIMUM SEPARATION FROM ALL SEWER MAINS AND LATERALS OF 10'-0" HORIZONTAL AND 18" VERTICAL IN ACCORDANCE WITH THE STATE OF UTAH DIVISION OF DRINKING WATER RULES SECTION R309-550-7
6. THE 6'-0" SIDEWALK SHOWN ABOVE IS TO BE CONSIDERED THE "CITY STANDARD." OTHER LOCATIONS AND TYPES OF SIDEWALK AS REQUESTED BY THE DEVELOPER MUST BE APPROVED BY THE CITY. IF SIDEWALK IS LOCATED AGAINST THE TBC, IT MUST BE A MINIMUM OF 6 FEET IN WIDTH.
7. NATURAL GAS TYPICALLY LOCATED IN THE PARKSTRIP, POWER AND COMMUNICATION LINES TYPICALLY LOCATED BEHIND PROPERTY LINES OR IN LOT EASEMENTS.
8. "SEAL COAT" CONSISTS OF THE FOLLOWING:
  - a. CHIP SEAL PER APWA 32 01 13.64 AND CITY MODIFICATIONS, AND
  - b. FOG SEAL PER APWA 32 01 13.50 AND CITY MODIFICATIONS.
9. IMPORTED FILL UNDER ROADWAY SHALL BE GRANULAR BORROW 2" MAX.
10. PRIOR TO THE INSTALLATION OF PAVEMENT, THE CITY INSPECTOR MUST GIVE WRITTEN PERMISSION TO PROCEED.

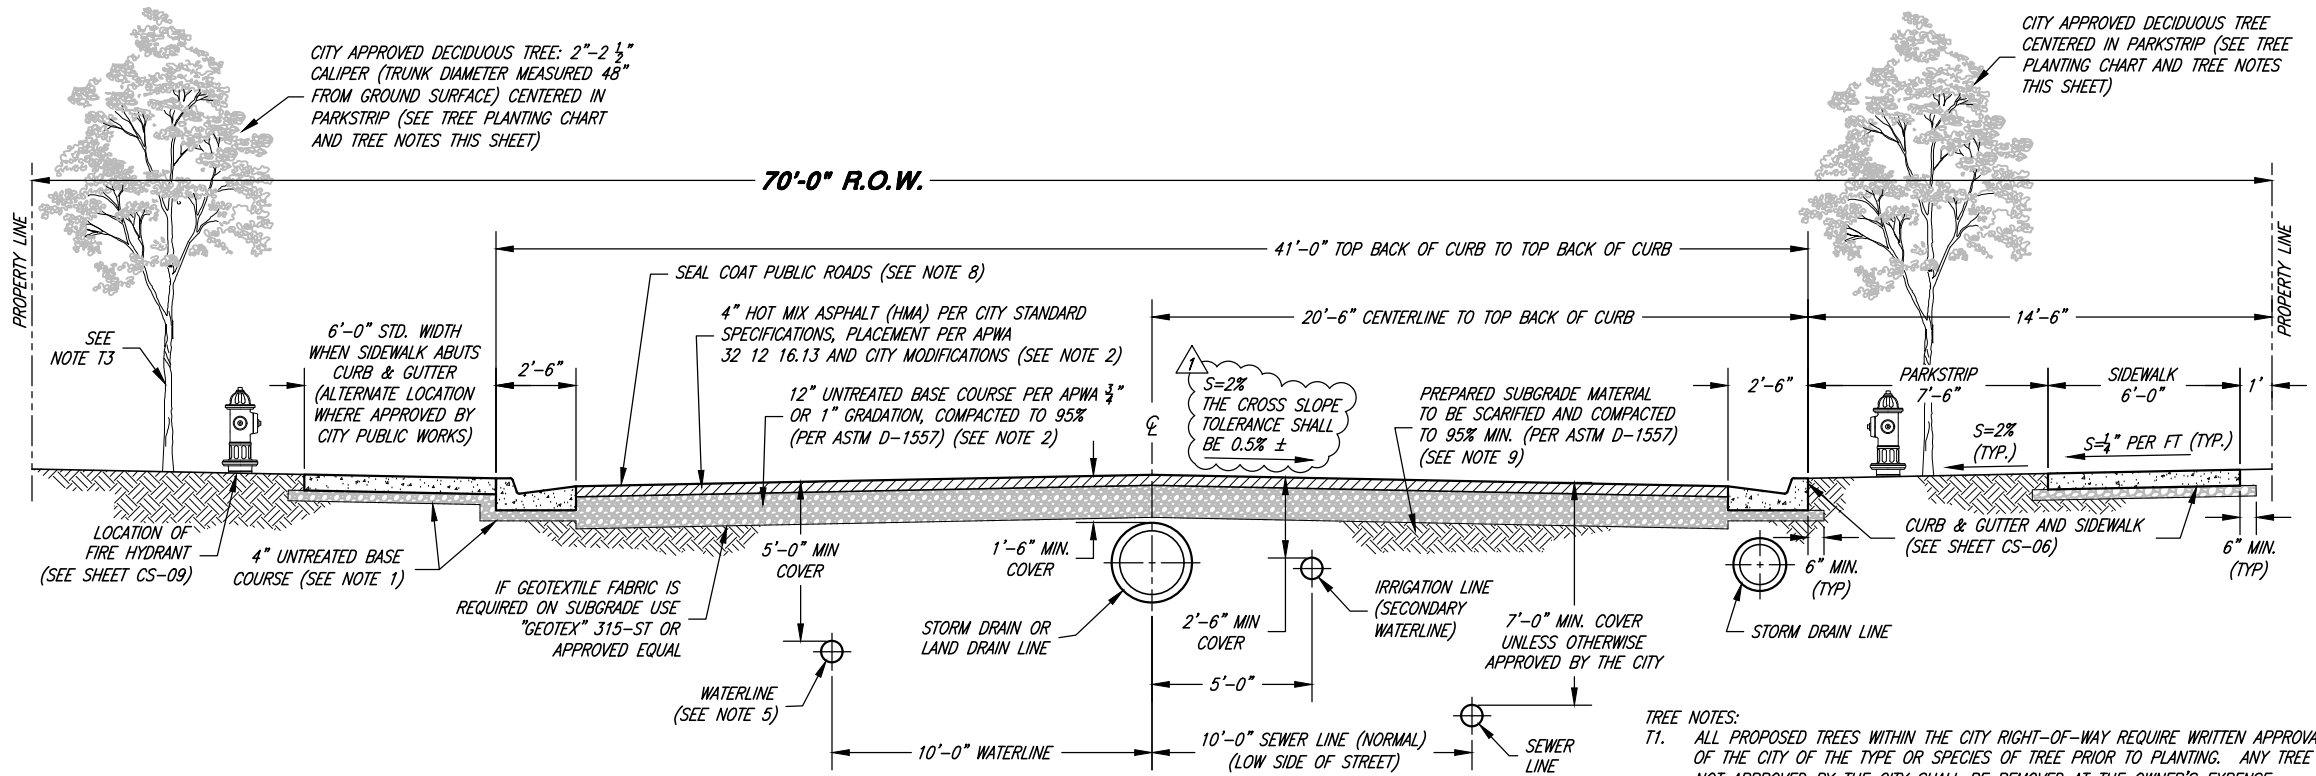


- TREE NOTES:**
- T1. ALL PROPOSED TREES WITHIN THE CITY RIGHT-OF-WAY REQUIRE WRITTEN APPROVAL OF THE CITY OF THE TYPE OR SPECIES OF TREE PRIOR TO PLANTING. ANY TREE NOT APPROVED BY THE CITY SHALL BE REMOVED AT THE OWNER'S EXPENSE.
  - T2. ALL PLANTED TREES TO BE SPACED IN ACCORDANCE WITH THE SPECIES CHARACTERISTICS SUCH THAT THE TREES' CROWNS AT MATURITY WILL NOT OVERLAP WITH ANOTHER TREE NOR TOUCH OR OVERHANG A BUILDING.
  - T3. FOR ADDITIONAL HELP WITH TREE SELECTION VISIT [WWW.TREEBROWSER.ORG](http://WWW.TREEBROWSER.ORG) FOR FURTHER INFORMATION ON NATIVE AND INTRODUCED TREES GROWING IN UTAH AND THE INTERMOUNTAIN WEST.
  - T4. THE PLANTING OF TREES IN THE PARKSTRIP MAY BE A REQUIREMENT OF THE DEVELOPMENT IF DEEMED NECESSARY BY THE CITY.

TREE PLANTING CHART				
SIZE	MATURE HEIGHT	CONCRETE OFFSET	STREET CORNER/FH	POWER/UTILITY DISTANCE
LARGE	OVER 40 FEET	8 FEET MIN. DISTANCE	30 FEET FROM STREET CORNER & 10 FEET FROM ANY FIRE HYDRANT	10 LATERAL FEET OF ANY OVERHEAD UTILITY WIRE & 5 LATERAL FEET OF ANY UNDERGROUND UTILITY LINE
MEDIUM	25 FEET TO 40 FEET	6 FEET MIN. DISTANCE		
SMALL	LESS THAN 25 FEET	3 FEET MIN. DISTANCE		

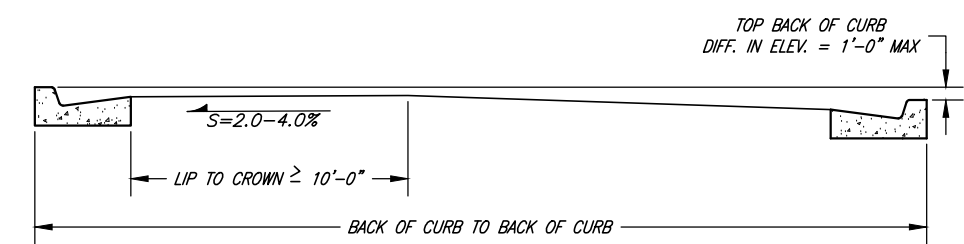

- CROWN NOTES:**
- A. MAXIMUM DIFFERENCE IN ELEVATION BETWEEN CURBS ON OPPOSITE SIDES OF THE STREET SHALL NOT EXCEED 1'-0" AS SHOWN IN DETAIL.
  - B. ON CERTAIN STREETS APPROVED BY THE CITY COUNCIL, THE CITY ENGINEER WILL PROVIDE A PAVEMENT DESIGN. LOCATION OF SIDEWALK AND CURB & GUTTER MAY VARY PER DIRECTION OF THE CITY ENGINEER.
  - B. ALL STREET CROSS SECTIONS SHALL BE AS APPROVED BY THE CITY ENGINEER.

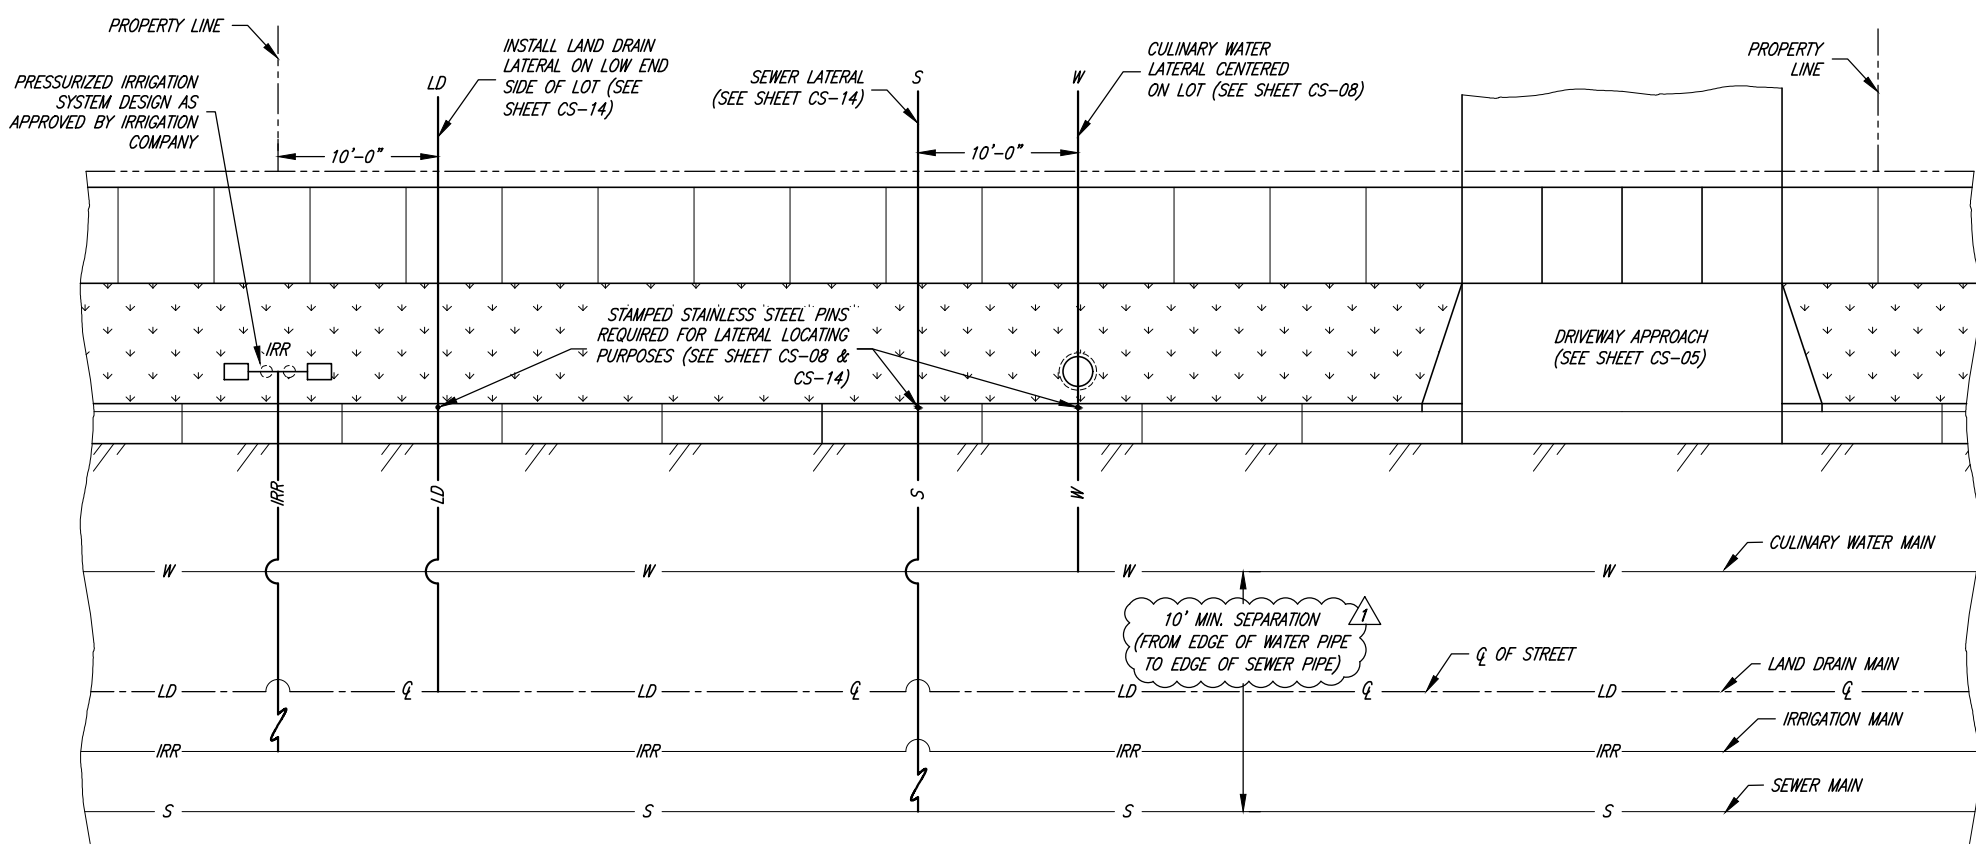

BRANDON KENT JONES  
No. 5148758  
REGISTERED PROFESSIONAL ENGINEER  
State of Utah  
PROJECT ENGINEER  
DATE 2-12-2019

REV.	DATE	APPR.	ADDED AND/OR MODIFIED NOTES
1	JAN '19	BKJ	ADDED AND/OR MODIFIED NOTES

SCALE: N.T.S.  
DESIGNED: BKJ  
DRAWN: BEB  
CHECKED: BKJ

**JA JONES & ASSOCIATES**  
CONSULTING ENGINEERS  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
[www.jonescivil.com](http://www.jonescivil.com)

**SOUTH WEBER CITY CORPORATION**  
PUBLIC WORKS STANDARDS  
PUBLIC ROADS - TYPICAL LOCAL STREET CROSS SECTION & UTILITY LATERAL CONFIGURATION DETAILS

SHEET: **CS-02**  
OF 24 SHEETS  
0






**STREET NOTES:**

1. PRESSURIZED IRRIGATION SYSTEM LAYOUT AS APPROVED BY EITHER THE WEBER BASIN WATER CONSERVANCY DISTRICT, SOUTH WEBER WATER IMPROVEMENT DISTRICT, DAVIS AND WEBER COUNTIES CANAL COMPANY, OR THE SOUTH WEBER IRRIGATION COMPANY.
2. EXACT LOCATION OF STREET AND REGULATORY SIGNS SHALL BE SPECIFIED BY THE PUBLIC WORKS DIRECTOR FOR SPECIFIC INTERSECTIONS.
3. THE NUMBER OF VALVES REQUIRED AT EACH INTERSECTION SHALL BE DETERMINED BY THE CITY ENGINEER.


(NOTES CONTINUED BELOW)



20' RADIUS FOR RESIDENTIAL;  
40' RADIUS FOR STATE ROADS  
OR AS APPROVED BY UDOT

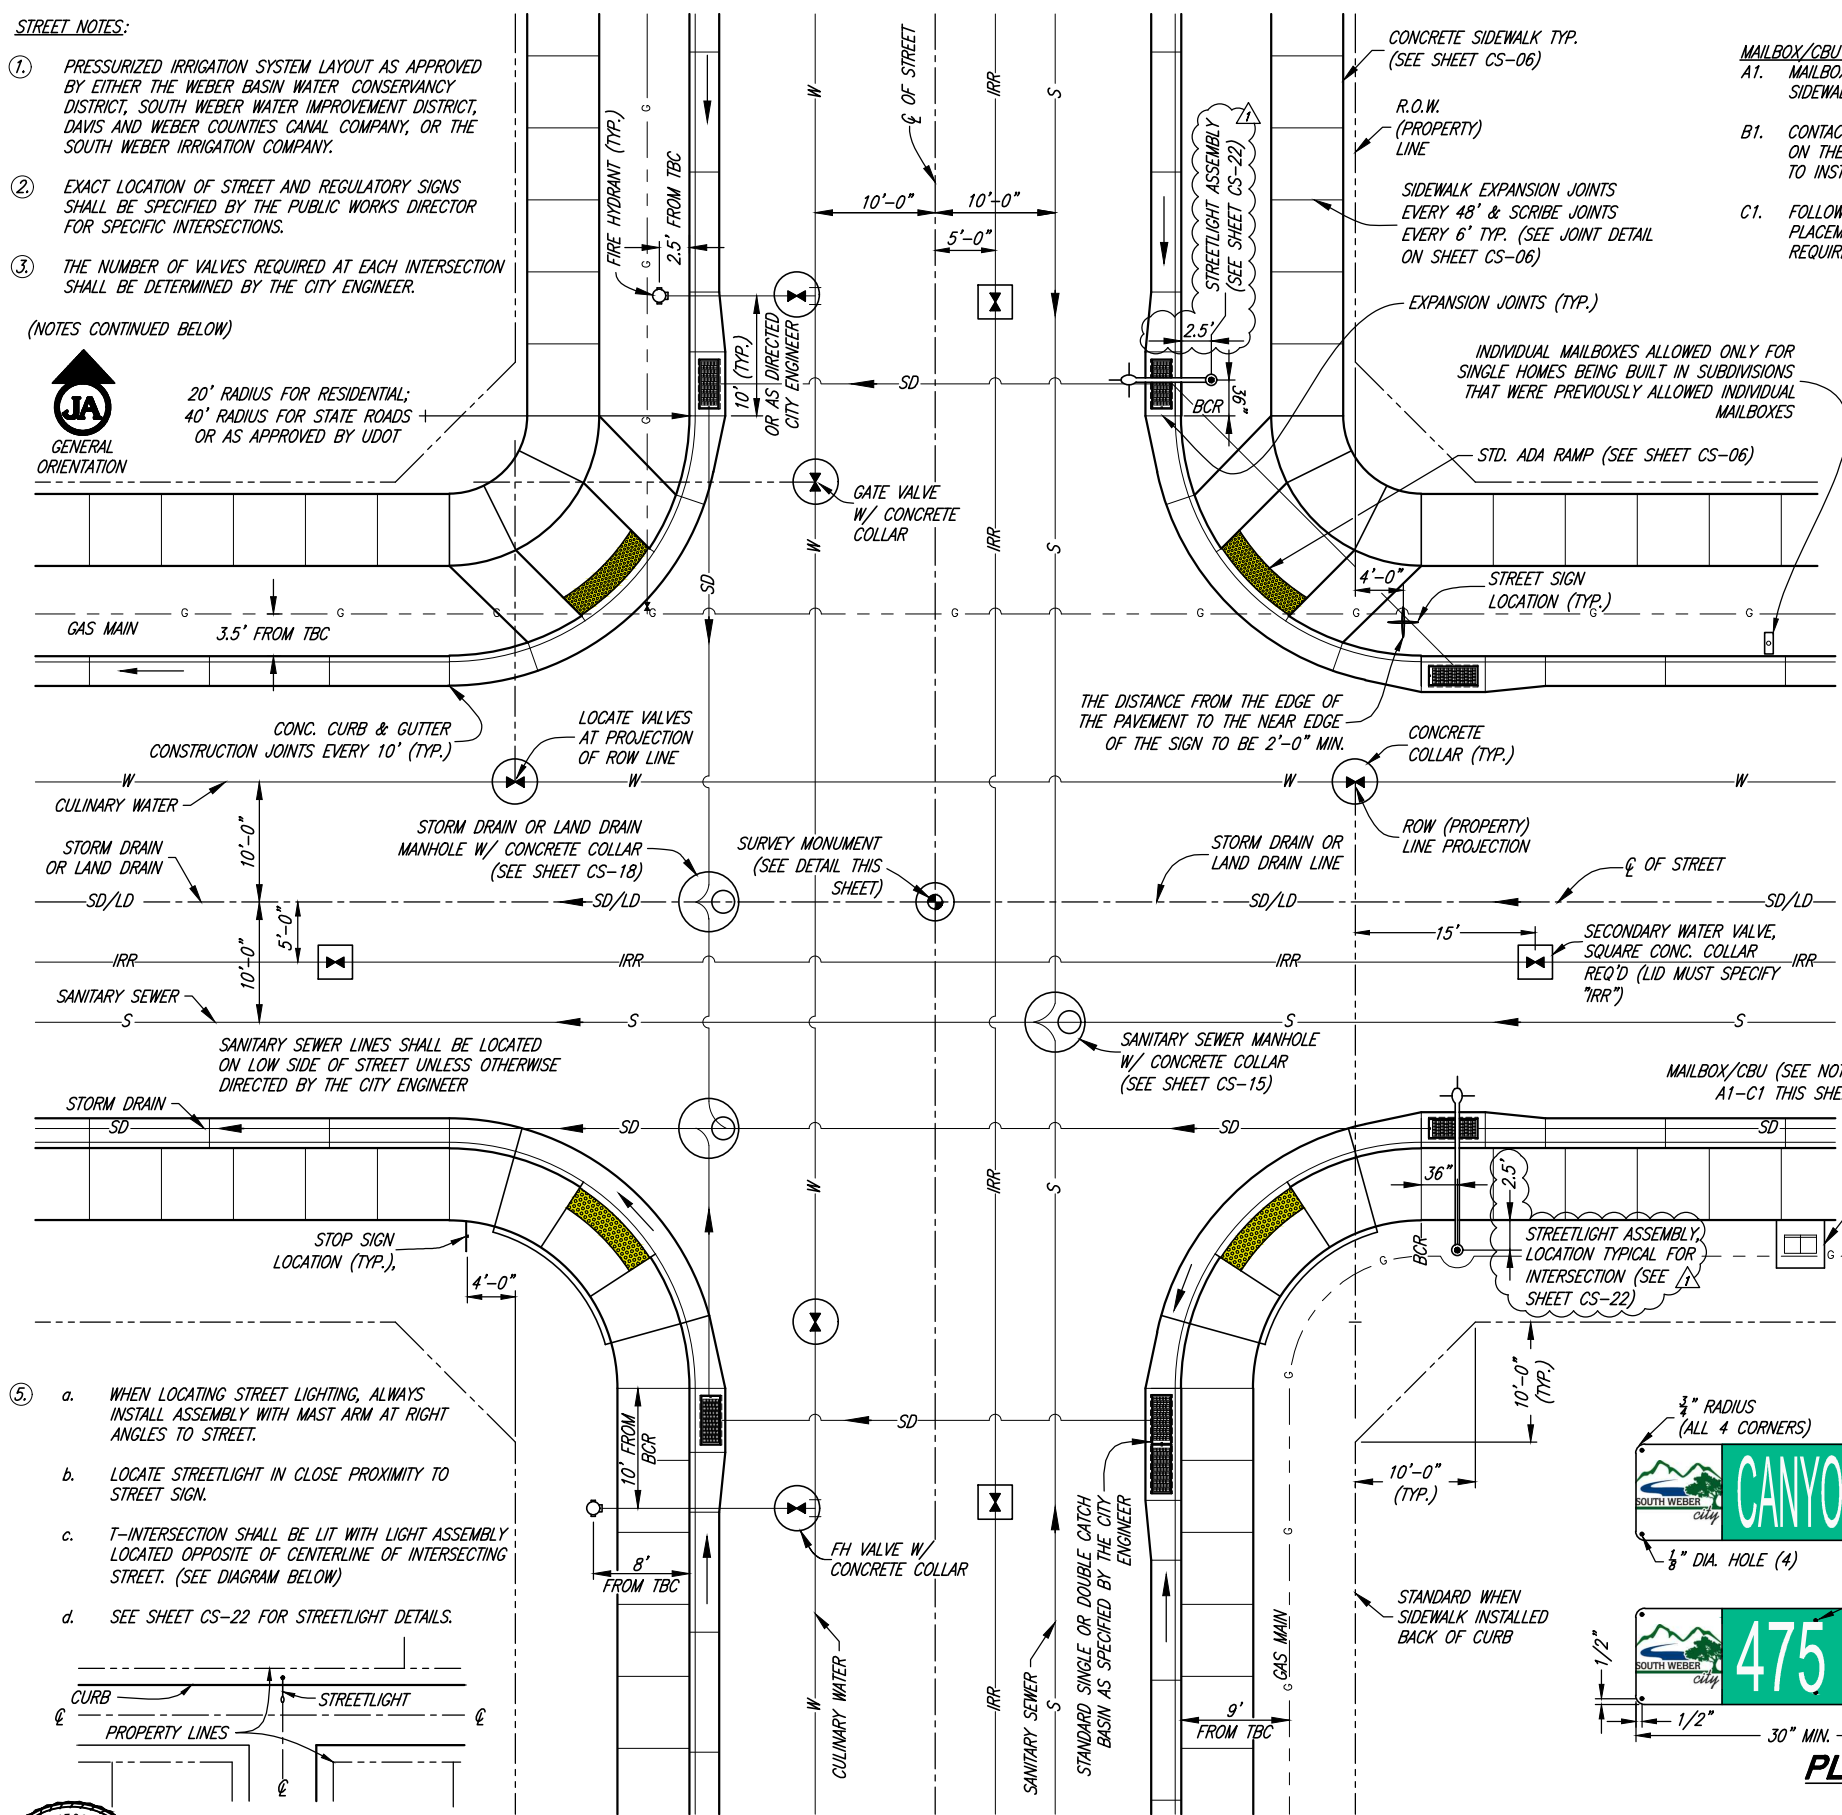

- a. WHEN LOCATING STREET LIGHTING, ALWAYS INSTALL ASSEMBLY WITH MAST ARM AT RIGHT ANGLES TO STREET.
- b. LOCATE STREETLIGHT IN CLOSE PROXIMITY TO STREET SIGN.
- c. T-INTERSECTION SHALL BE LIT WITH LIGHT ASSEMBLY LOCATED OPPOSITE OF CENTERLINE OF INTERSECTING STREET. (SEE DIAGRAM BELOW)
- d. SEE SHEET CS-22 FOR STREETLIGHT DETAILS.

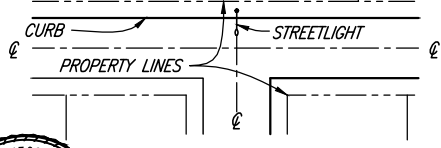


**MAILBOX/CBU NOTES:**


- A1. MAILBOXES SHALL NOT BE PLACED IN THE SIDEWALK.
- B1. CONTACT THE LOCAL POSTMASTER FOR APPROVAL ON THE LOCATION OF THE MAILBOX OR CBU PRIOR TO INSTALLATION.
- C1. FOLLOW USPS GUIDELINES & POLICIES FOR THE PLACEMENT, INSTALLATION, AND ACCESS REQUIREMENTS FOR ALL MAILBOX AND CBU UNITS.

**STREET SIGN NOTES:**


- A. STREET SIGN BACKGROUND SHALL BE REGULATORY GREEN, BOTH STREET AND TRAFFIC SIGNS SHALL BE AT THE VERY LEAST HIGH INTENSITY REFLECTIVE SHEETING (9FP-85 TYPE IIIA)
- B. LEGEND SHALL BE WHITE LETTERS, HIGH INTENSITY REFLECTIVE SHEETING (9FP-85 IIIA)
- C. SIGN BLANK SHALL BE 6081-T6 HEAT TREATED HIGH TENSILE DEGREASED ALUMINUM W/ALODINE 1200 FINISH-THICKNESS SHALL BE 0.08"
- D. EACH SIGN SHALL CONSIST OF TWO PLATES RIVETED TOGETHER & MOUNTED AS SHOWN
- E. SIGNS ON PRIVATE ROADS SHALL MEET ALL SPECIFICATIONS FOR STANDARD SIGNS, EXCEPT BACKGROUND SHALL BE BLUE.
- F. ALL STREETS WITH NAMES MUST ALSO SHOW LOCATIONS COORDINATE DESIGNATION
- G. CONTACT CITY PRIOR TO MAKING SIGNS TO VERIFY PROPER NAMES AND COORDINATES

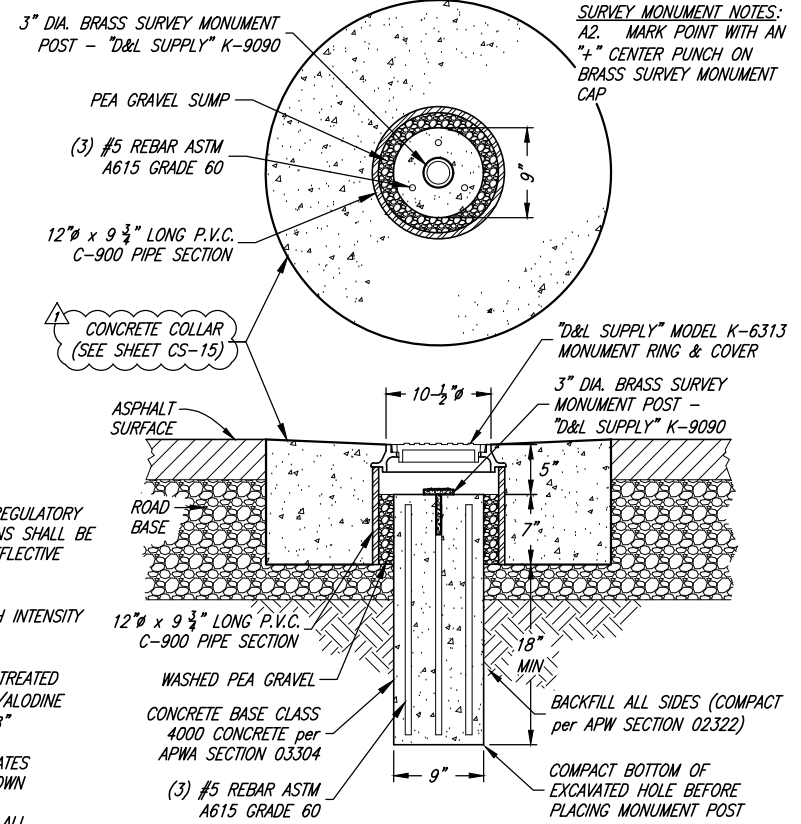


**SURVEY MONUMENT DETAIL**

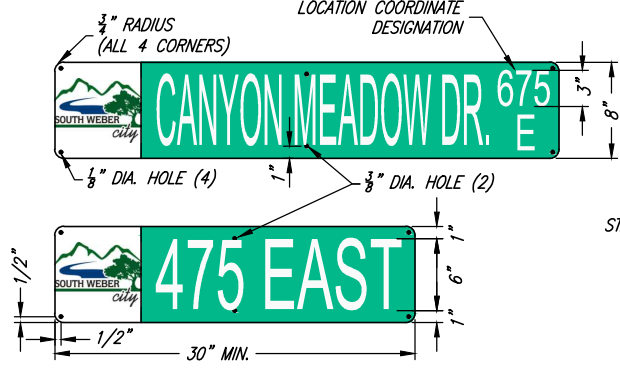

**PLATE DETAIL**

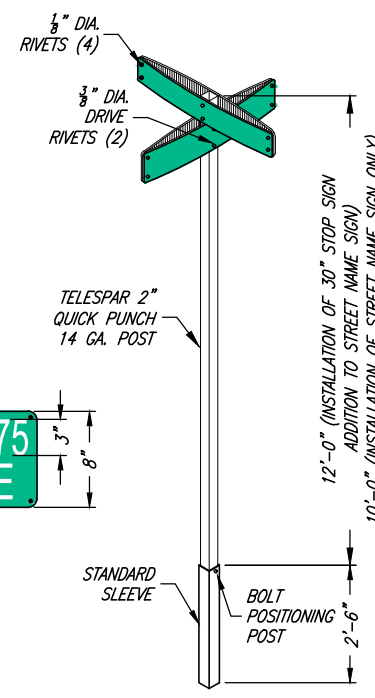

**STREET SIGN & POST**

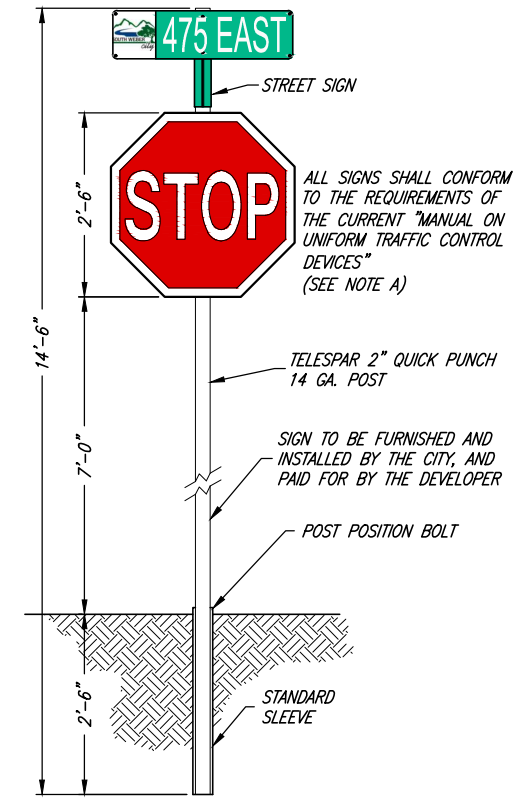

**STREET / TRAFFIC SIGN & POST**

BRANDON KENT JONES  
No. 5148758  
PROJECT ENGINEER  
2-12-2019  
DATE


1	JAN '19	BKJ	MODIFIED NOTES AND DIMENSIONS

SCALE:  
N. T.S.  
DESIGNED: BKJ  
DRAWN: BEB  
CHECKED: BKJ

**JA JONES & ASSOCIATES**  
CONSULTING ENGINEERS  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
www.jonescivil.com

**SOUTH WEBER CITY CORPORATION**  
PUBLIC WORKS STANDARDS  
**PUBLIC ROADS - TYPICAL INTERSECTION & STREET DETAILS**



SHEET:  
**CS-04**  
OF 24 SHEETS  
0

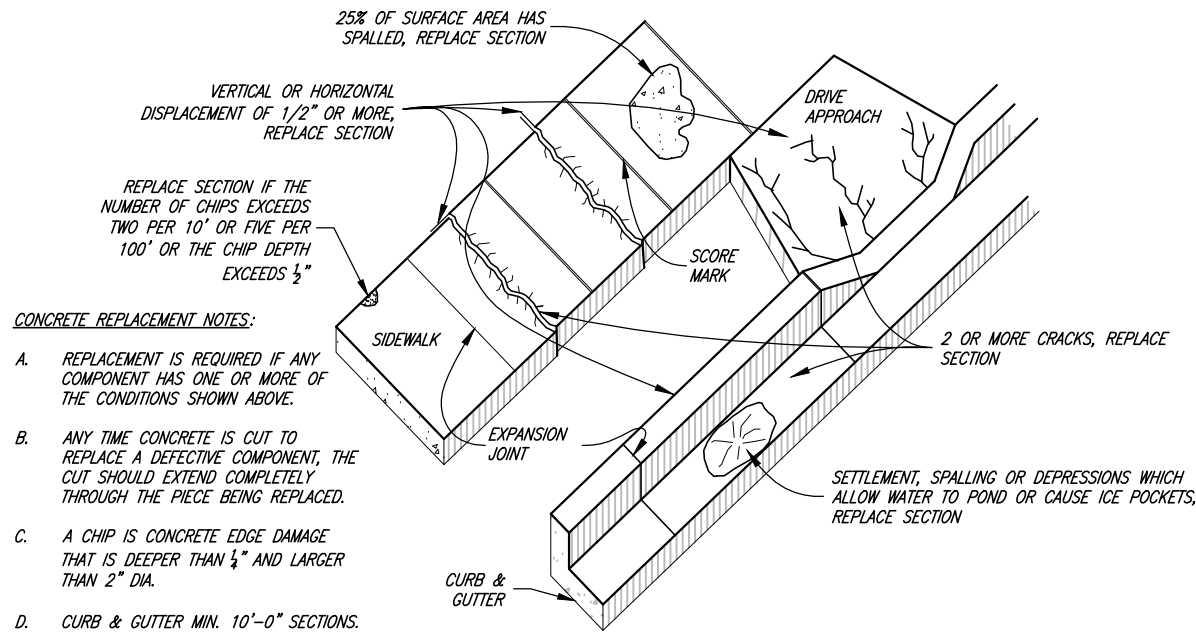


**CONCRETE REPLACEMENT NOTES:**

- A. REPLACEMENT IS REQUIRED IF ANY COMPONENT HAS ONE OR MORE OF THE CONDITIONS SHOWN ABOVE.
- B. ANY TIME CONCRETE IS CUT TO REPLACE A DEFECTIVE COMPONENT, THE CUT SHOULD EXTEND COMPLETELY THROUGH THE PIECE BEING REPLACED.
- C. A CHIP IS CONCRETE EDGE DAMAGE THAT IS DEEPER THAN 1/4" AND LARGER THAN 2" DIA.
- D. CURB & GUTTER MIN. 10'-0" SECTIONS.


**DEFECTIVE CONCRETE REPLACEMENT CRITERIA**

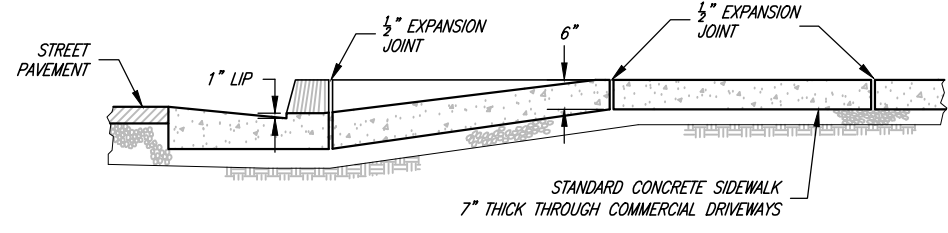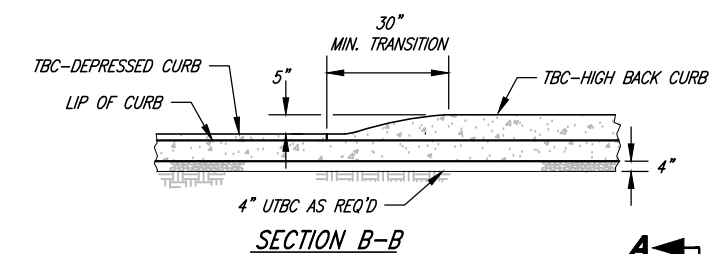


**SECTION A-A**

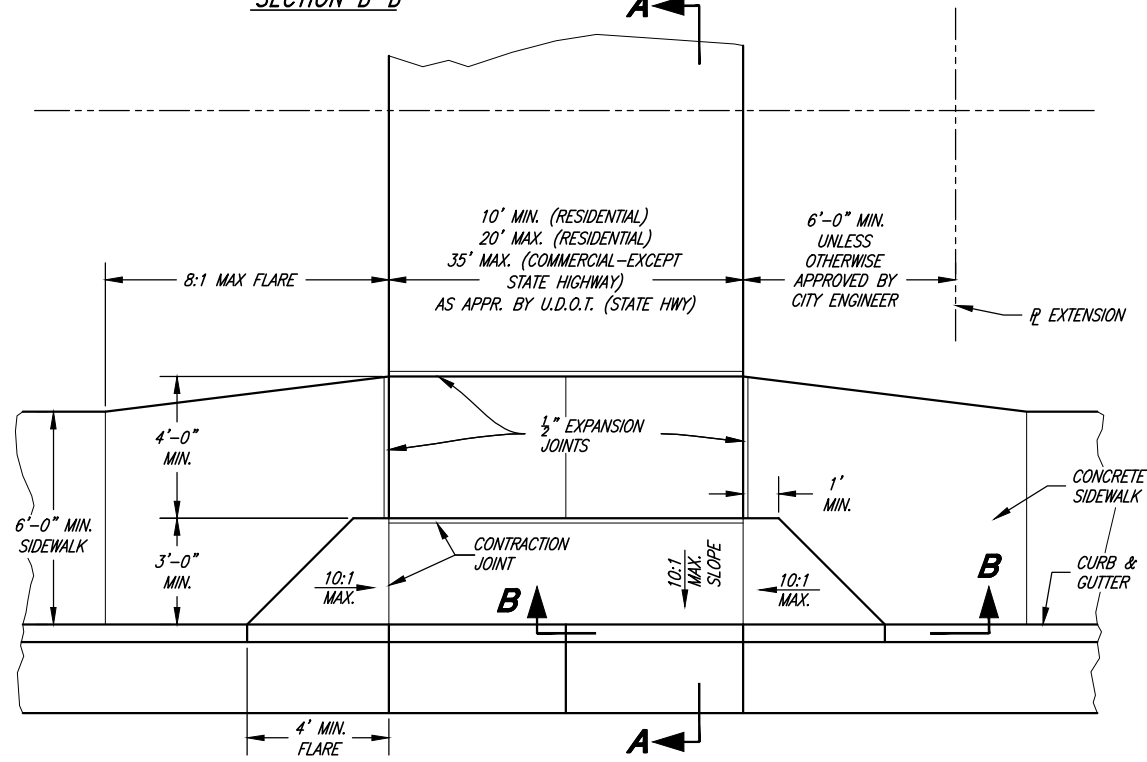


**DRIVEWAY APPROACH W/ ADJACENT SIDEWALK**

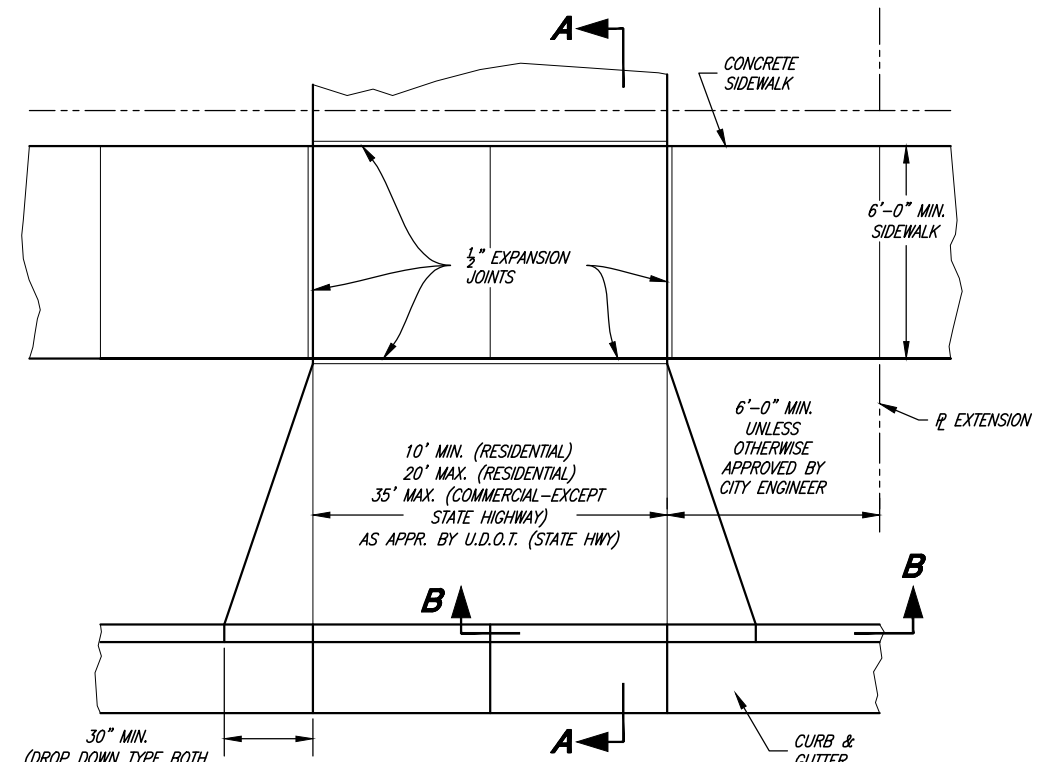

**DRIVEWAY APPROACH W/ PARKSTRIP**  
DROP DOWN STYLE (CITY STANDARD)

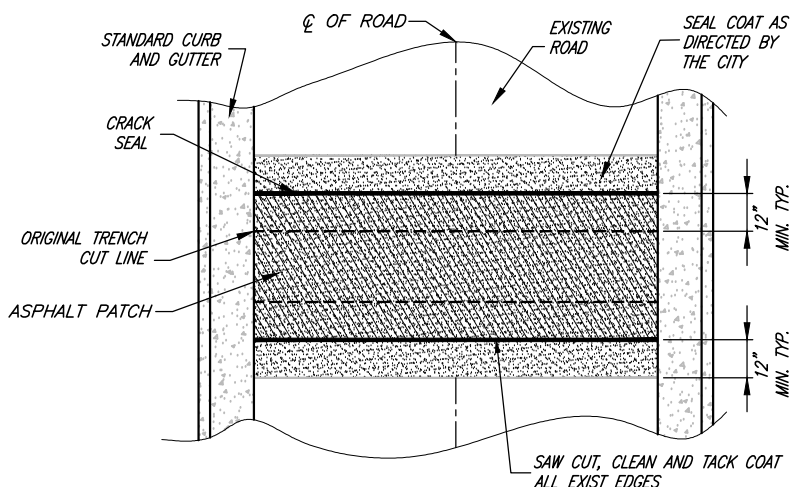

**TYPICAL HORIZONTAL ASPHALT PATCH PLAN**

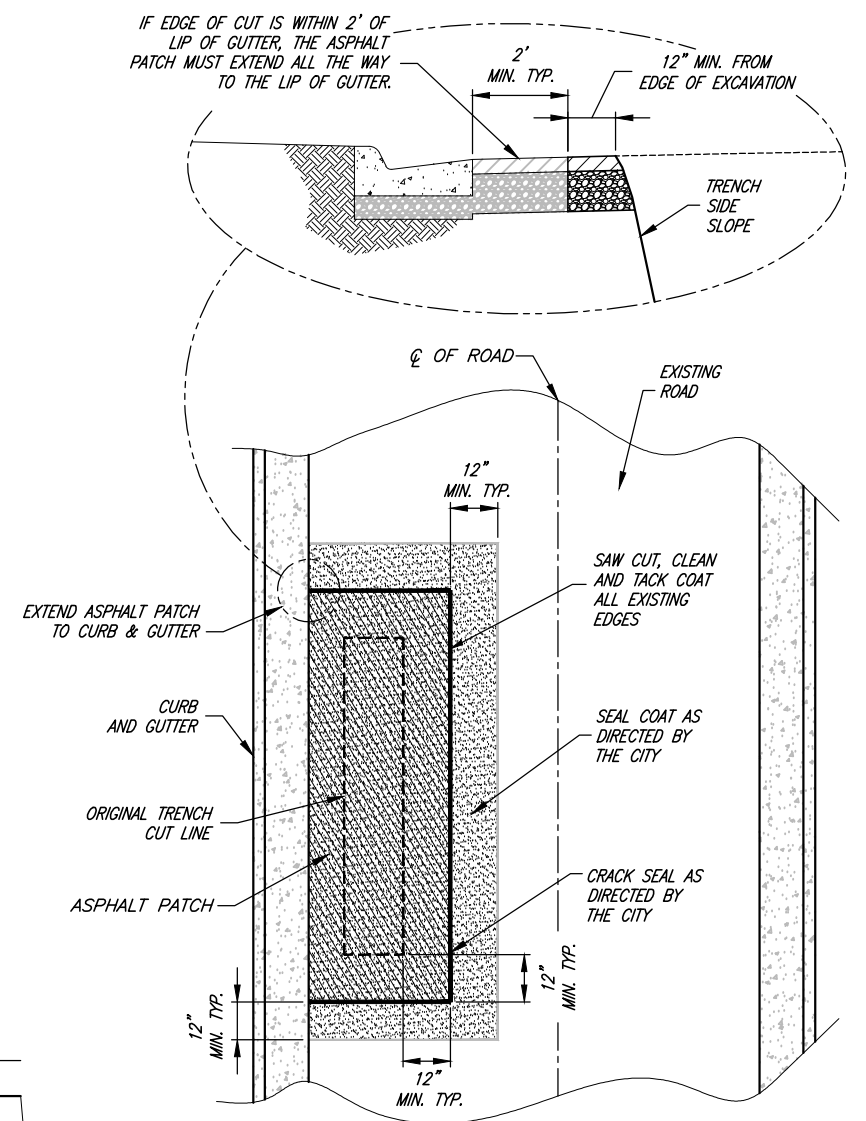

**TYPICAL PARALLEL ASPHALT PATCH PLAN**

**ASPHALT PATCH NOTE:**  
A1. ON ANY ROAD PAVED OR OVERLAYED WITHIN THE LAST 10 YEARS, THE PATCH MUST BE COMPLETED PER APWA PLAN 255 BITUMINOUS PAVEMENT T-PATCH. (SEE SHEET CS-05A)

- DRIVEWAY APPROACH NOTES:**
1. IN NEW SUBDIVISIONS WHERE FUTURE DRIVEWAY LOCATIONS ARE UNKNOWN, THE DRIVEWAY APPROACH SHALL BE MADE BY SAW CUTTING THE BACK OF THE EXISTING CURB TO THE REQUIRED DRIVEWAY WIDTH. ALL SAW CUTTING SHALL BE ACCOMPLISHED BY A CITY APPROVED LICENSED CONTRACTOR.
  2. SCORE SIDEWALK 1/4" OF SIDEWALK THICKNESS AT EACH 6'-0" SECTION. EXPANSION JOINTS AT EACH 48'-0"; PROVIDE ADDITIONAL CONTRACTION JOINTS ON OVERSIZED DRIVEWAYS AT 5'-0" MAX. SPACING

BRANDON KENT JONES  
No. 5148758  
State of Utah  
PROJECT ENGINEER  
DATE 2-12-2019

1	JAN '19	BKJ	ADDED NOTE

SCALE:  
N. T.S.

DESIGNED BKJ  
DRAWN BEB  
CHECKED BKJ


**JA JONES & ASSOCIATES**  
CONSULTING ENGINEERS  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
www.jonescivil.com

**SOUTH WEBER CITY CORPORATION**  
PUBLIC WORKS STANDARDS  
PUBLIC ROADS - TYPICAL DRIVE APPROACH, ASPHALT PATCH & DEFECTIVE CONCRETE REPLACEMENT DETAILS



**DETECTABLE WARNING SURFACE NOTES:**

1. LOCATE THE DETECTABLE WARNING SURFACE SO THE OUTSIDE CORNER NEAREST THE STREET IS WITHIN 1 INCH OF THE BACK OF CURB (TBC). PROVIDE 2'-FOOT MINIMUM DEPTH.
2. PROVIDE DETECTABLE WARNING SURFACE FOR FULL WIDTH OF CURB CUT.
3. THE DETECTABLE WARNING SURFACE DOMES SHALL BE ORIENTED SUCH THAT THE ROWS ARE PARALLEL WITH THE DIRECTION OF PEDESTRIAN TRAVEL TO THE RAMP ON THE OPPOSITE SIDE OF THE STREET.
4. THE STANDARD COLOR FOR THE DETECTABLE WARNING SURFACE SHALL BE YELLOW OR PRE-APPROVED CONTRASTING COLOR. WHEN THE EXISTING SIDEWALK COLOR IS NOT STANDARD CONCRETE, THE COLOR OF THE DETECTABLE WARNING SURFACE SHALL BE DETERMINED BY THE CITY ENGINEER OR AUTHORIZED REPRESENTATIVE.
5. WHEN A DETECTABLE WARNING SURFACE DOME IS CUT, THE REMAINING PORTION OF THE DOME SHALL BE BEVELED TO A MAXIMUM SLOPE OF 1:2.

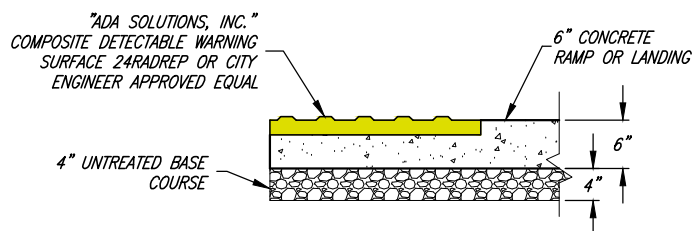

**DETECTABLE WARNING SURFACE DETAIL**


**ADA RAMP NOTES:**

- WHERE DESIGNATED BY THE CITY, ALTERNATE UDOT OR APWA RAMP DESIGNS MAY BE USED WITH THE PRIOR APPROVAL OF THE CITY ENGINEER AND THE CITY PUBLIC WORKS DEPARTMENT. SUBMIT ENGINEERED CONSTRUCTION PLANS TO CITY ENGINEER FOR REVIEW AND ACCEPTANCE PRIOR TO CONSTRUCTION.
- SITE CONDITIONS WILL VARY. CONFIGURATION OF RAMP, LANDING, AND TRANSITION MAY BE CHANGED, BUT THEY MUST MEET DIMENSIONS AND SLOPES AS SHOWN IN THE MOST RECENT EDITION OF THE U.D.O.T. STANDARDS & SPECIFICATIONS (SHEETS PA1 THROUGH PA5). THE USE OF FLARES, CURB WALLS, ETC. ARE AT THE DISCRETION OF THE ENGINEER.
- LOCATE CURB CUT WITHIN CROSSWALK.
- RAMP GRADE BREAK MUST BE PERPENDICULAR TO THE RUNNING SLOPE.

SLOPE TABLE			
	ITEM	MAX RUNNING SLOPE*	MAX. CROSS SLOPE*
(T)	TURNING SPACE <sup>2</sup>	2% (1V:48H)	2% (1V:48H)
(R)	RAMP	8.3% (1V:12H)	2% (1V:48H)
(S)	SIDEWALK	5% (1:20) <sup>1</sup>	2% (1V:48H)
(F1)	TRAVERSABLE SURFACE	10% (1V:10H)	--
(F2)	NON-TRAVERSABLE SURFACE	25% (1V:4H)	--
(B)	BLENDED TRANSITION	5% (1V:20H) 2% MIN.	2% (1V:48H)

\* RUNNING SLOPE IS IN THE DIRECTION OF PEDESTRIAN TRAVEL. CROSS SLOPE IS PERPENDICULAR TO PEDESTRIAN TRAVEL.


- <sup>1</sup> 5% MAX OR NATURAL SLOPE OF LAND
- <sup>2</sup> NOT TO EXCEED 2% IN ANY DIRECTION

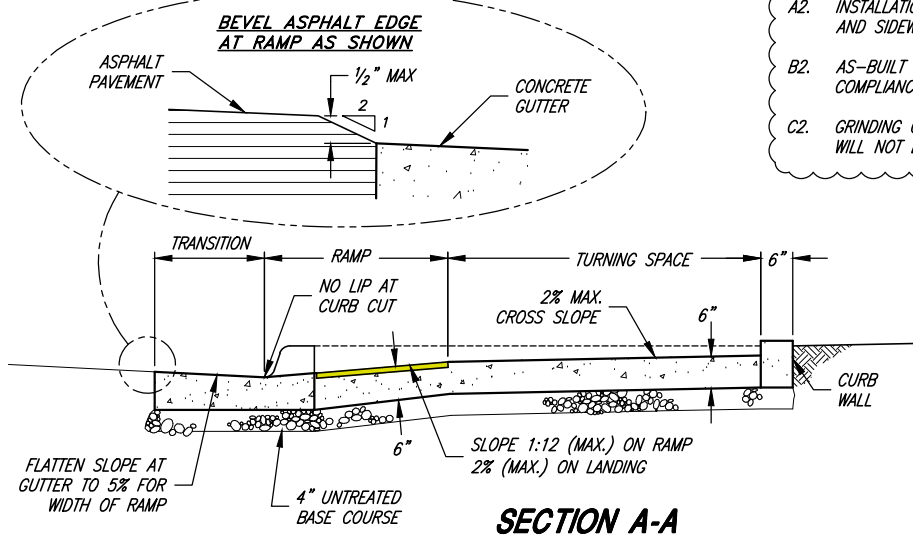

**SECTION A-A**

**GENERAL NOTES:**


- INSTALLATION TOLERANCES ON CURB & GUTTER AND SIDEWALK PER APWA 32 16 1.3, 3.7.
- AS-BUILT SURVEY MAY BE REQUIRED TO VERIFY COMPLIANCE WITH TOLERANCES.
- GRINDING OF CONCRETE, TO MEET TOLERANCES, WILL NOT BE ALLOWED.

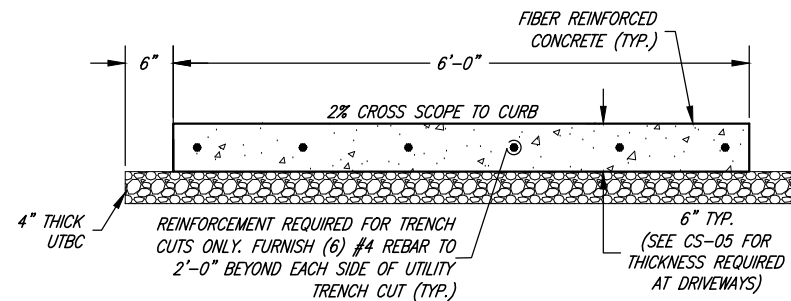


**SIDEWALK SECTION (CITY STANDARD)**

**CURB & GUTTER NOTES:**


- WHEN REPLACING CURB DUE TO CONSTRUCTION ACTIVITY, NEW CURB MUST EXTEND 5' MIN. PAST TRENCH ON EACH SIDE.
- CONCRETE CURB TO BE CONSTRUCTED USING SLIPFORMS, HAND FORMED OR STATIONARY FORMS ARE ONLY ALLOWED FOR CURB TIE-INS.
- THE SLOPE FOR CURB & GUTTER MUST BE A MINIMUM OF 0.5%.

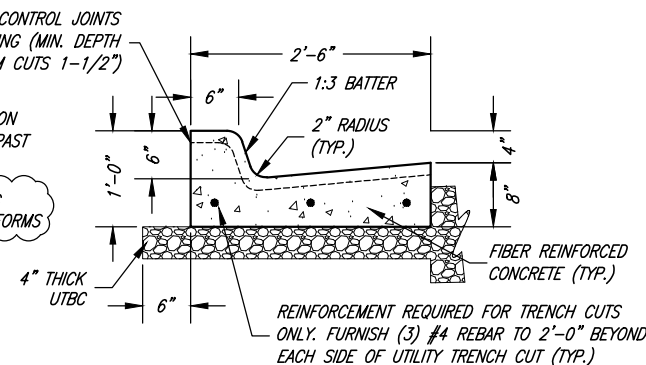


**CURB & GUTTER SECTION (CITY STANDARD)**

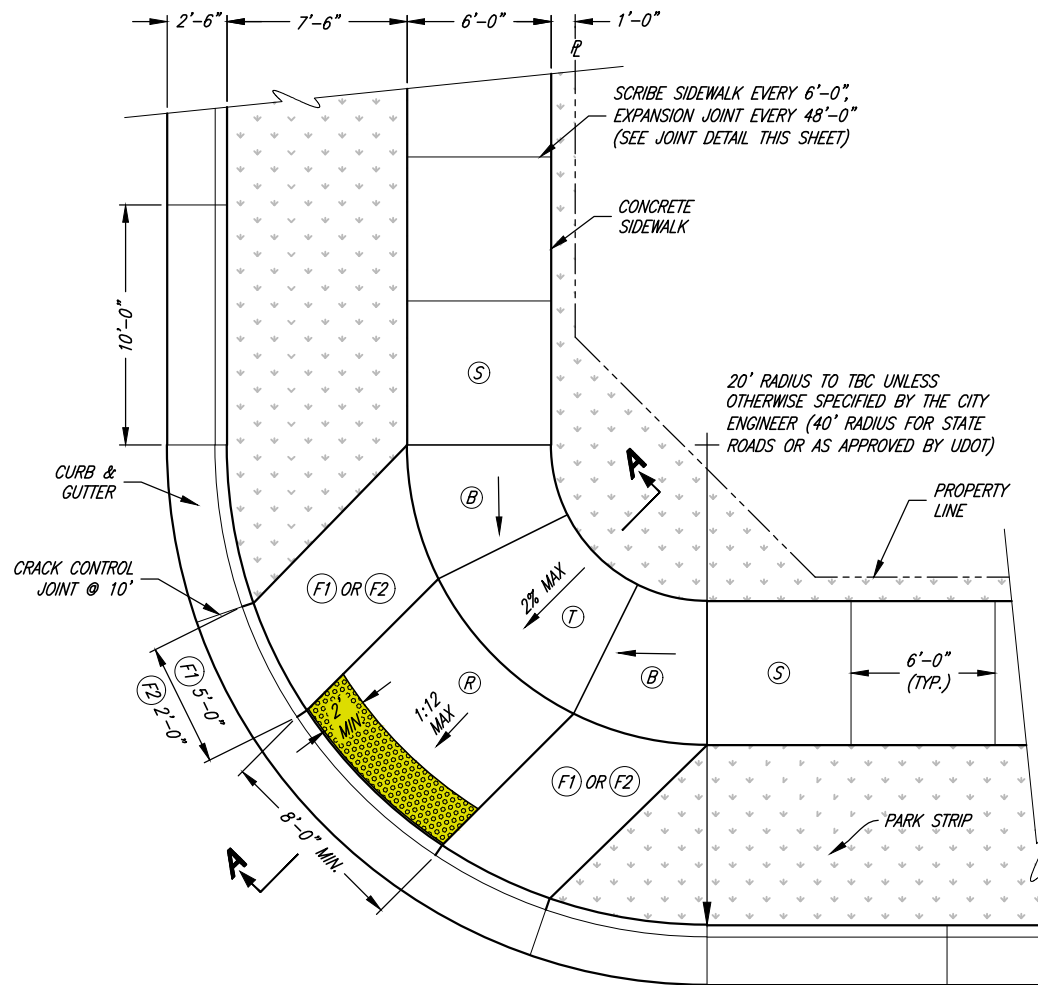

**TYPICAL ADA RAMP (WITH PARK STRIP)**

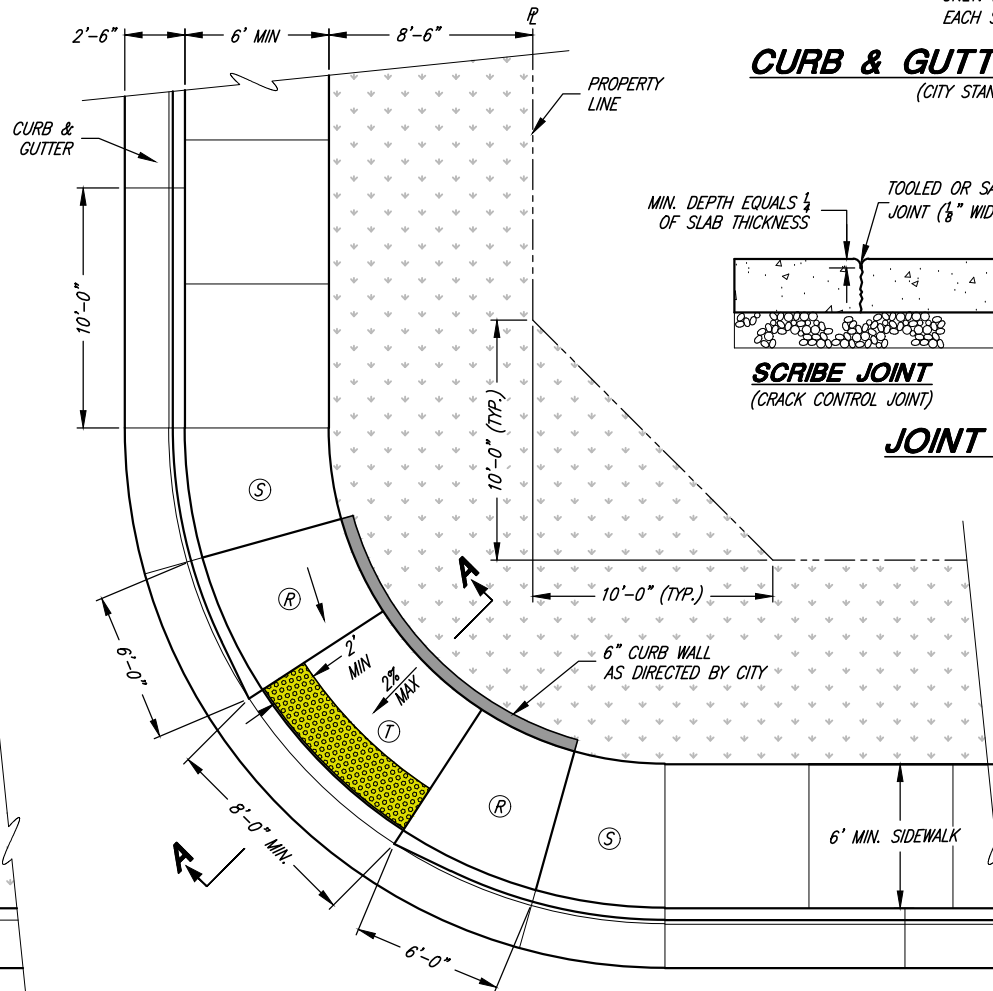

**ADA RAMP-DETAIL "B" (WITHOUT PARK STRIP)**

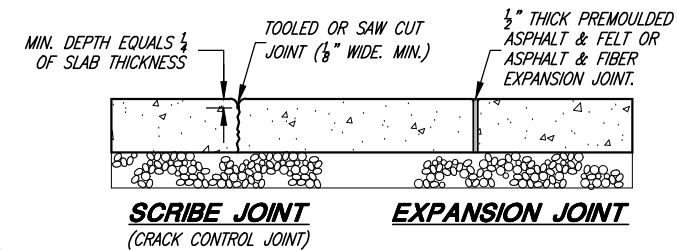

**JOINT DETAIL**



BRANDON K. JONES  
PROJECT ENGINEER  
2-12-2019  
DATE

REV.	DATE	APPR.	ADDED NOTES
1	JAN '19	BKJ	ADDED NOTES



SCALE: N.T.S.  
DESIGNED: BKJ  
DRAWN: BEB  
CHECKED: BKJ




**CONSULTING ENGINEERS**  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
www.jonescivil.com

**SOUTH WEBER CITY CORPORATION**  
**PUBLIC WORKS STANDARDS**  
**PUBLIC ROADS - TYPICAL ADA RAMP, SIDEWALK, CURB & GUTTER, AND CONCRETE JOINT DETAILS**

SHEET: **CS-06**  
OF 24 SHEETS  
0

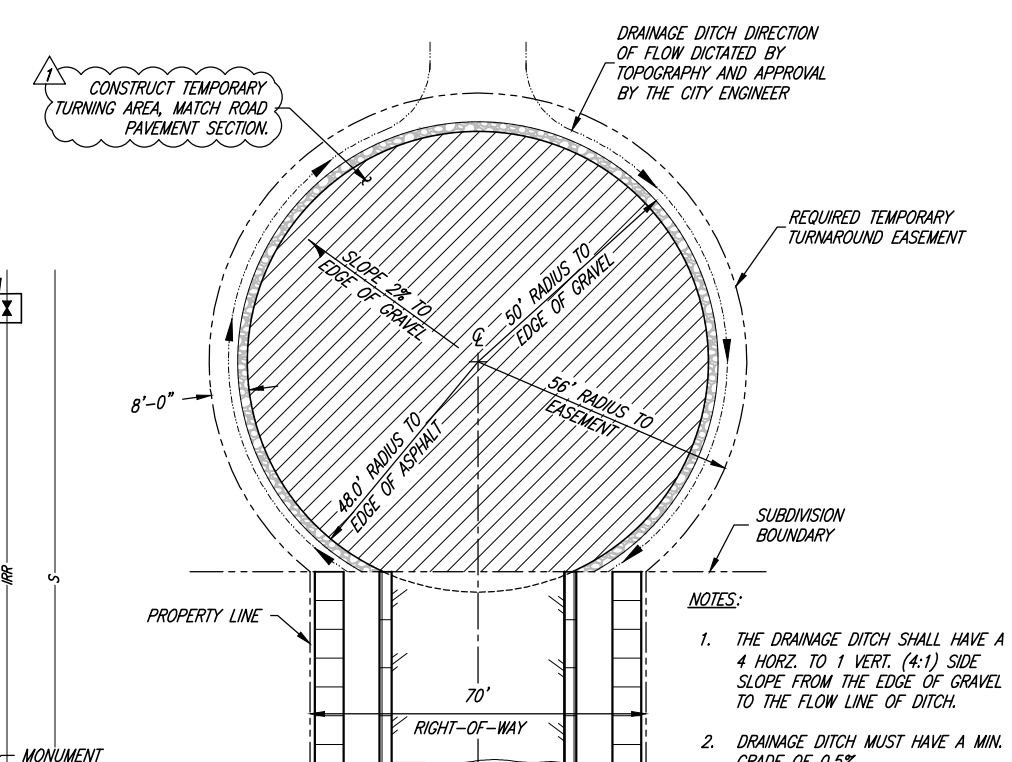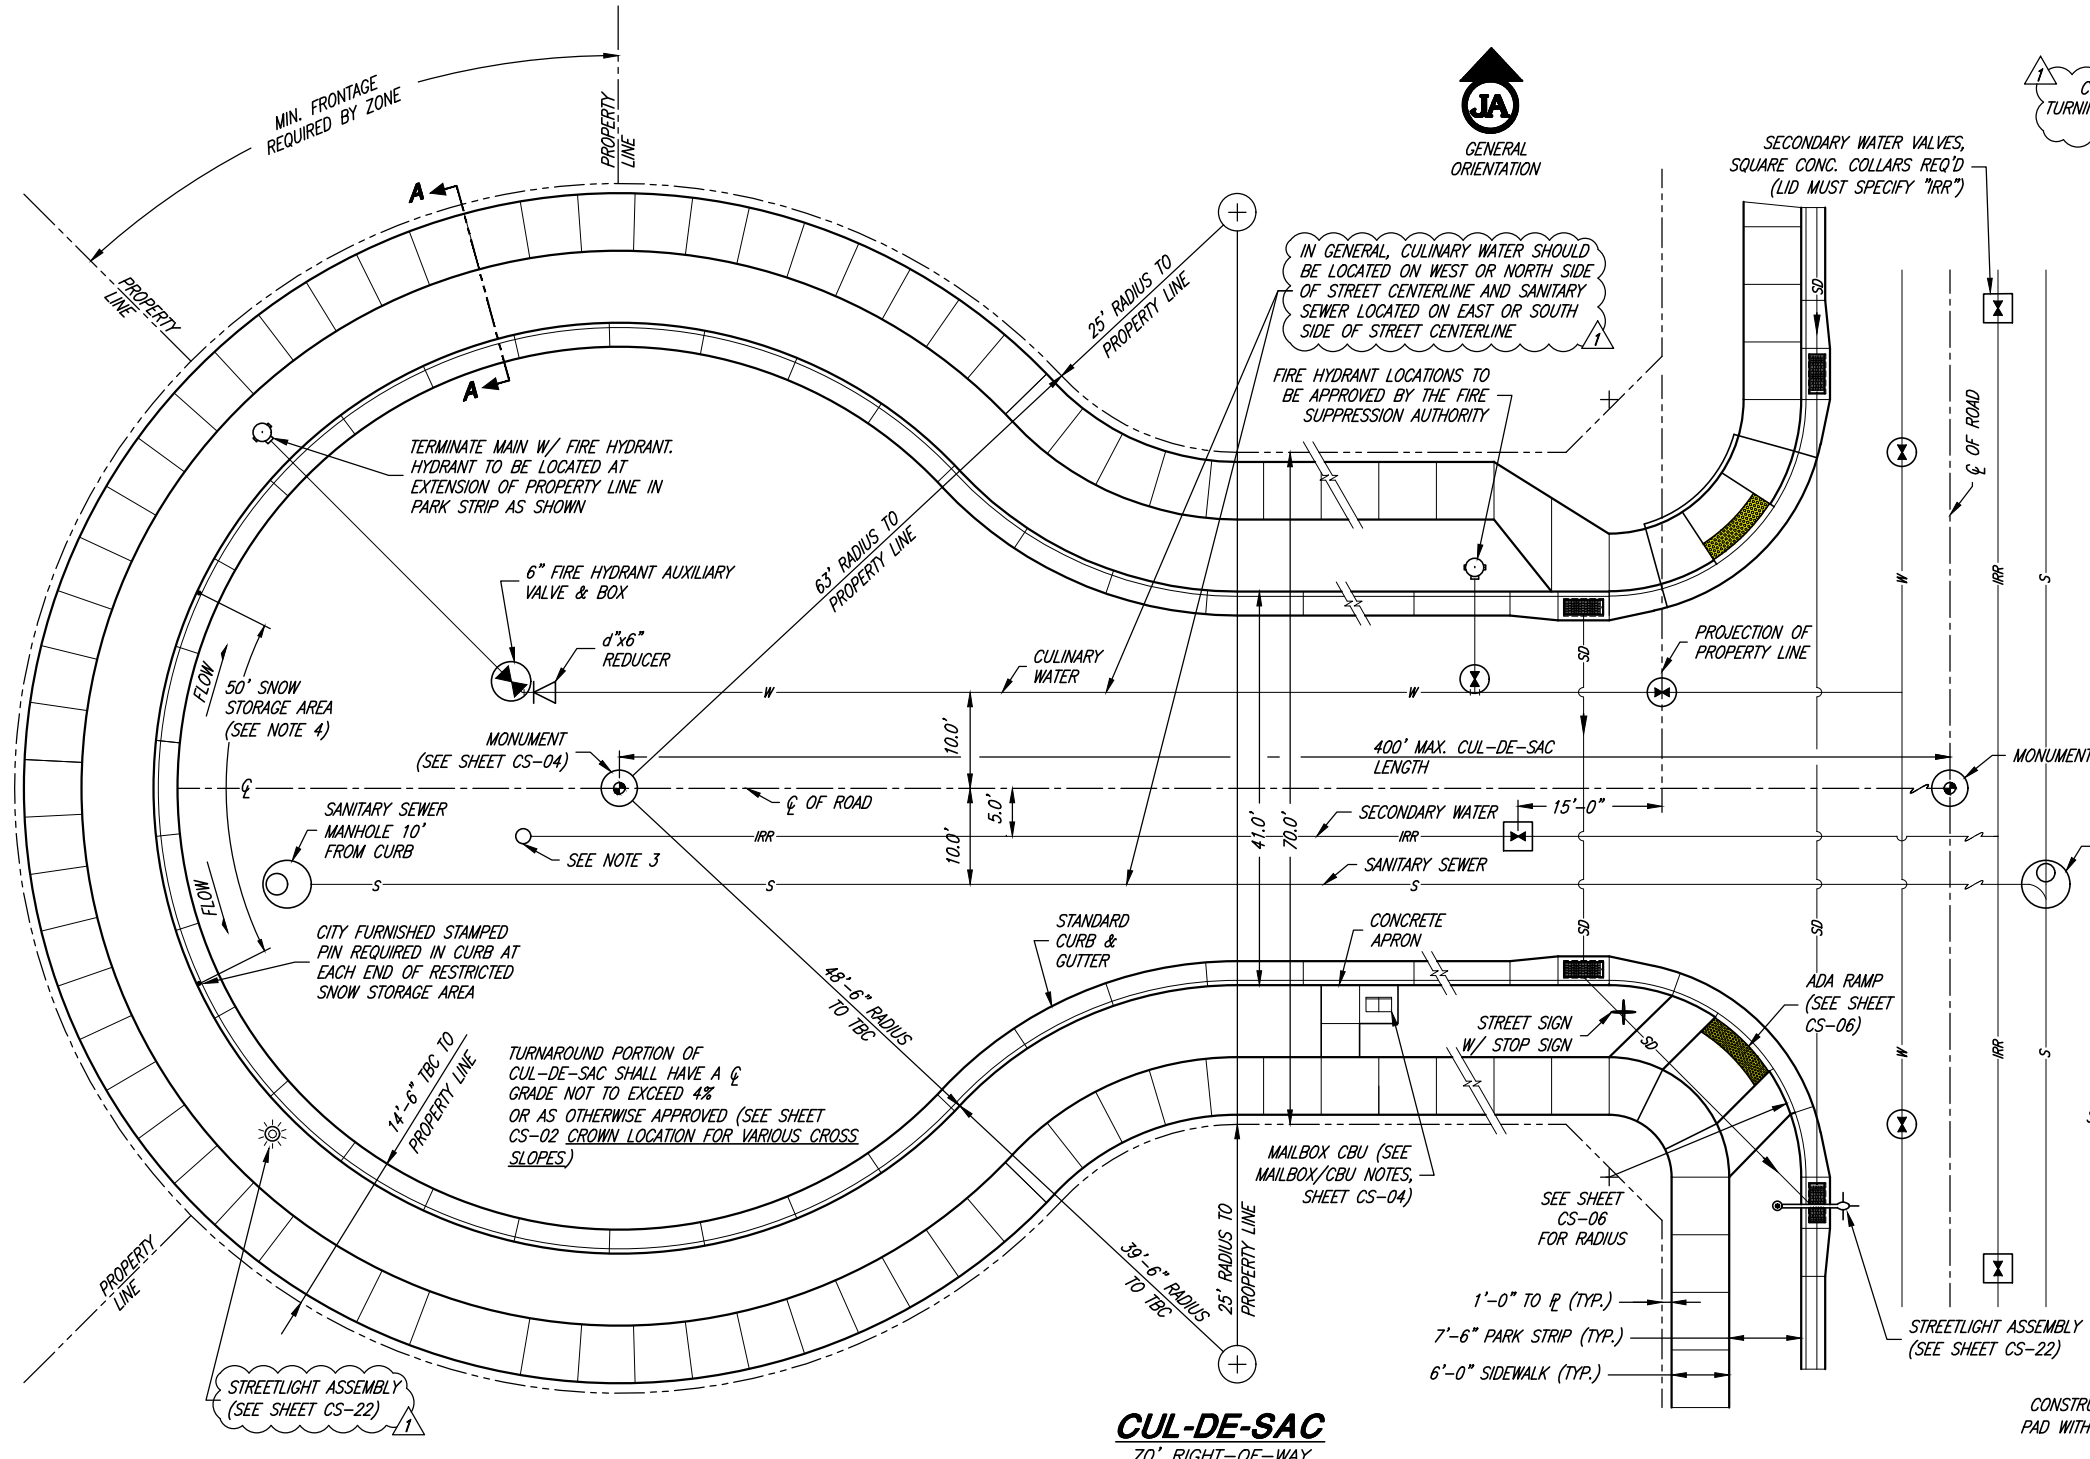


**CITY STANDARD  
TEMPORARY TURNAROUND**  
(FOR OUTSIDE OF SUBDIVISION BOUNDARY AND TO BE MAINTAINED BY PROPERTY OR EASEMENT OWNER)

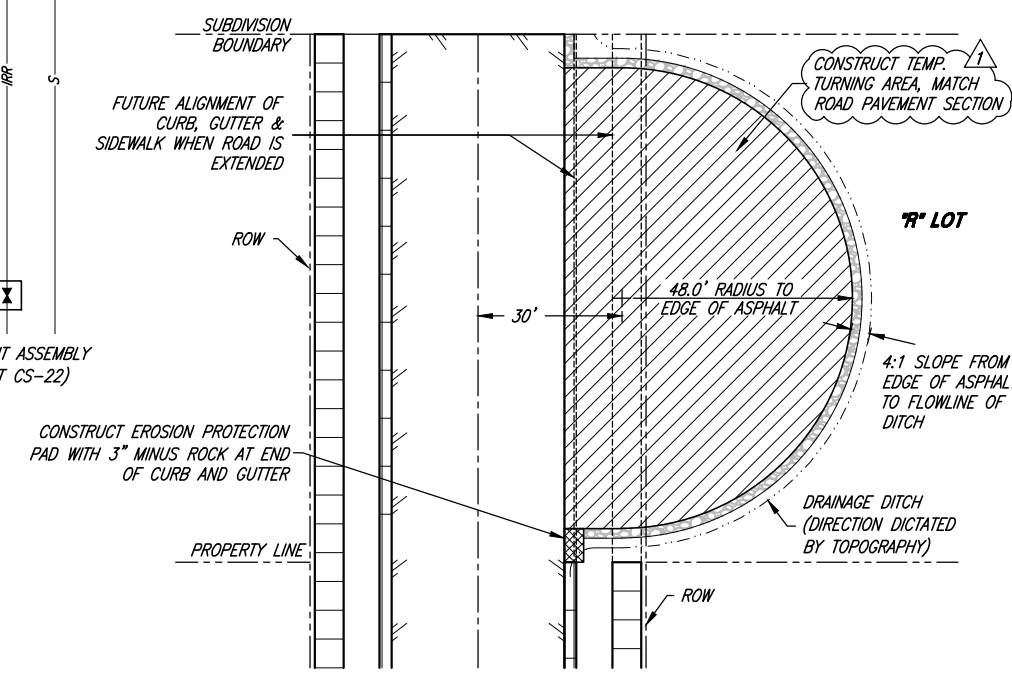

**TEMPORARY TURNAROUND**  
(FOR INSIDE SUBDIVISION BOUNDARY TO BE MAINTAINED BY PROPERTY OWNER)

**CUL-DE-SAC**  
70' RIGHT-OF-WAY

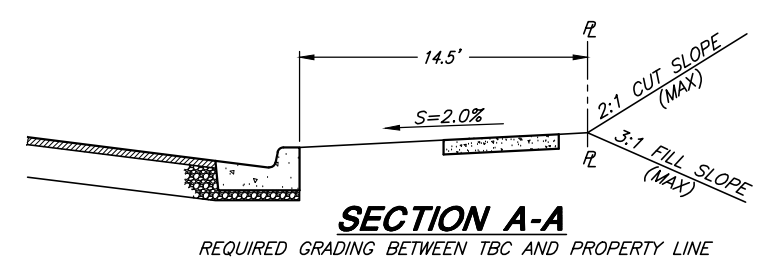

- GENERAL NOTES:**
1. THE CIRCULAR CUL-DE-SAC LAYOUT ON THIS SHEET IS TO BE CONSIDERED AS THE CITY STANDARD DESIGN. OTHER ALTERNATE DESIGNS MAY BE CONSIDERED AS APPROVED BY THE CITY ENGINEER.
  2. MODIFIED CUL-DE-SACS (KNUCKLE, EYEBROW, BULB, OR HALF CUL-DE-SACS) ARE NOT PERMITTED.
  3. DEVELOPER SHALL PROVIDE AN AIR RELIEF OR BLOW-OFF AS DETERMINED BY THE SECONDARY WATER PROVIDER AND IN ACCORDANCE WITH THEIR STANDARDS AND APPROVED BY THE CITY ENGINEER.
  4. NO DRIVEWAYS, FIRE HYDRANTS, OR MAIL BOXES ARE PERMITTED WITHIN THE 50' SNOW STORAGE AREA.

REGISTERED PROFESSIONAL ENGINEER  
BRANDON KENT JONES  
No. 5148758  
PROJECT ENGINEER  
2-12-2019  
DATE

1	JAN '19	BKJ	ADDED AND/OR MODIFIED NOTES, ADDED STREETLIGHT

SCALE:  
N.T.S.

DESIGNED BKJ  
DRAWN BEB  
CHECKED BKJ


**JA**  
JONES & ASSOCIATES

**CONSULTING ENGINEERS**  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
www.jonescivil.com

**SOUTH WEBER CITY CORPORATION**  
**PUBLIC WORKS STANDARDS**


**PUBLIC ROADS - CUL-DE-SAC & TEMP. TURNAROUND DETAILS**

SHEET:  
**CS-07**  
OF 24 SHEETS  
0

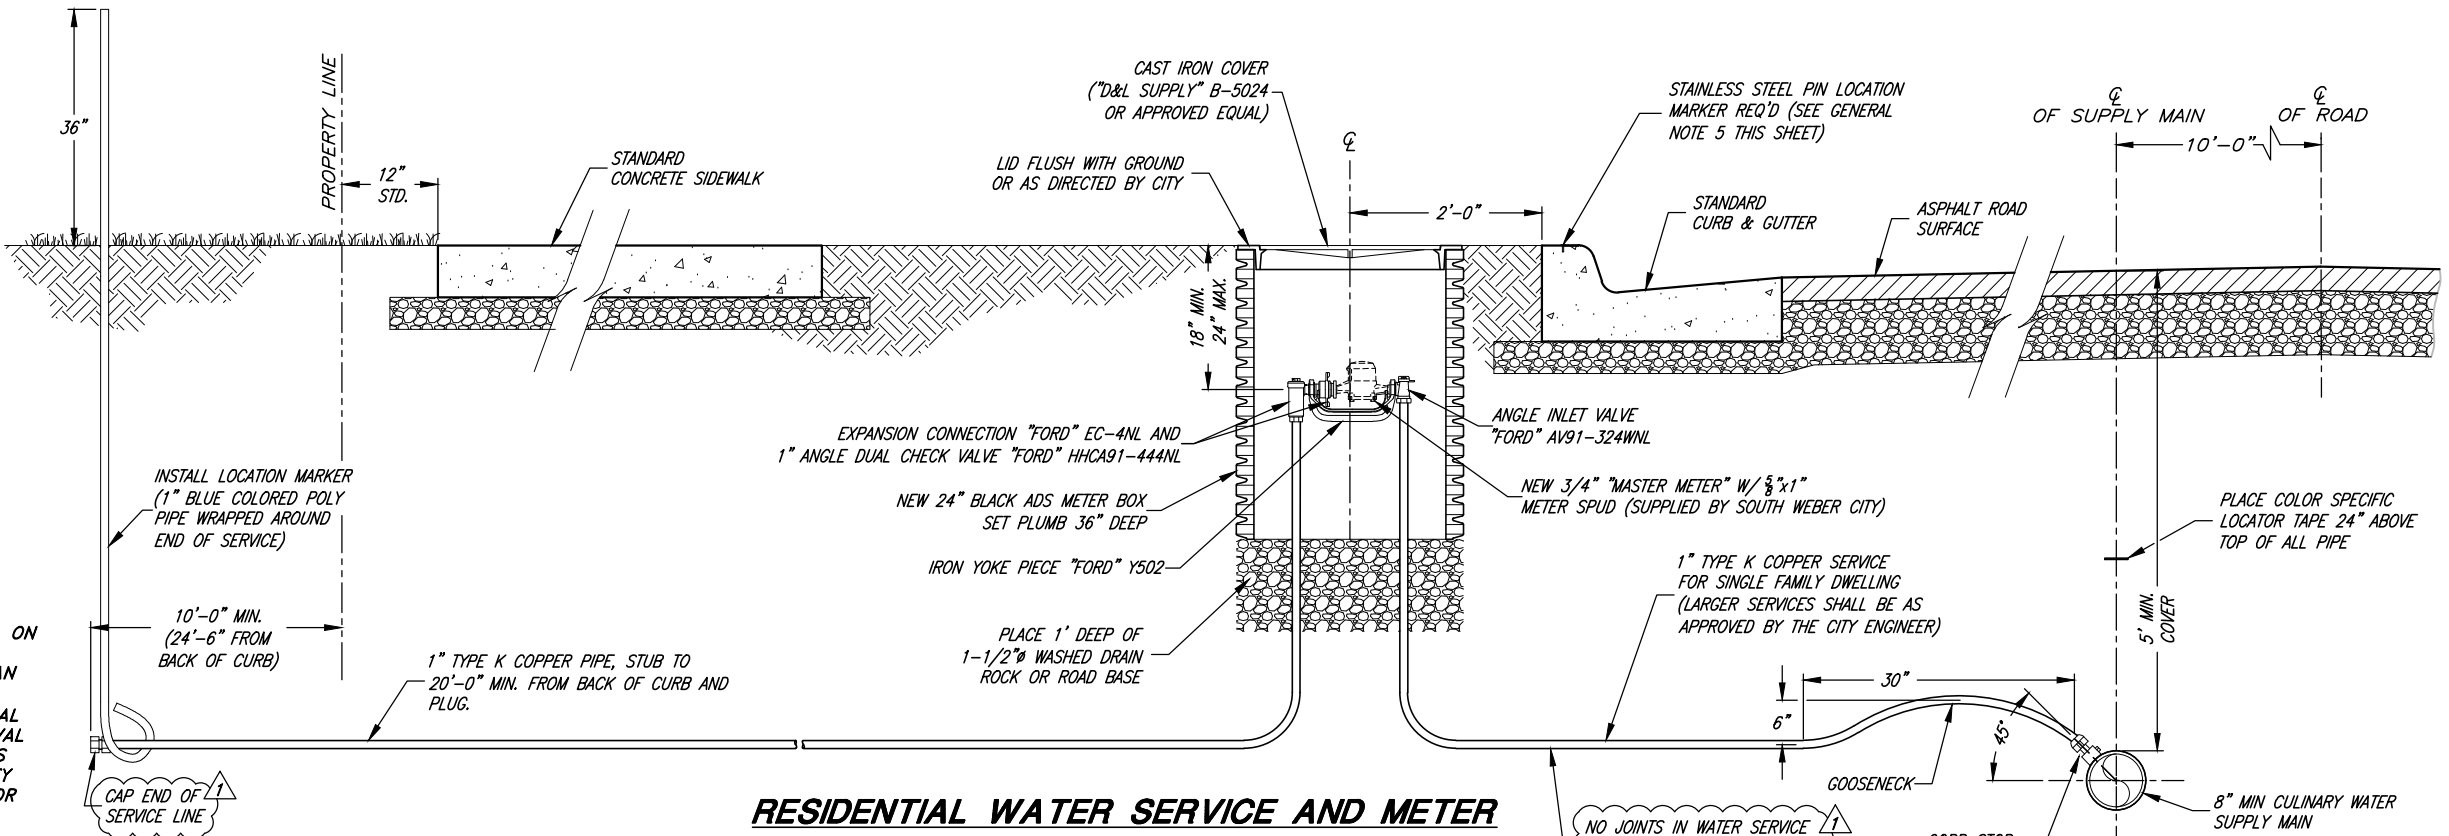


**METER LOCATION NOTE:**  
 \*\*ALL CULINARY WATER METERS SHALL BE CENTERED ON THE LOT AND SHOULD NOT BE LOCATED WITHIN THE DRIVEWAY AREA. IF A DRIVEWAY IS PLACED OVER AN EXISTING METER, THE "ENTIRE" SERVICE AND METER SHALL BE RELOCATED OR A HIGH TRAFFIC RESIDENTIAL METER PIT MAY BE INSTALLED WITH WRITTEN APPROVAL FROM THE WATER SYSTEM SUPERINTENDENT. THIS IS DETERMINED ON A CASE BY CASE BASIS BY THE CITY WATER SYSTEM SUPERINTENDENT AND TO BE PAID FOR BY THE OWNER.

**RESIDENTIAL WATER SERVICE AND METER**  
 CITY STANDARD

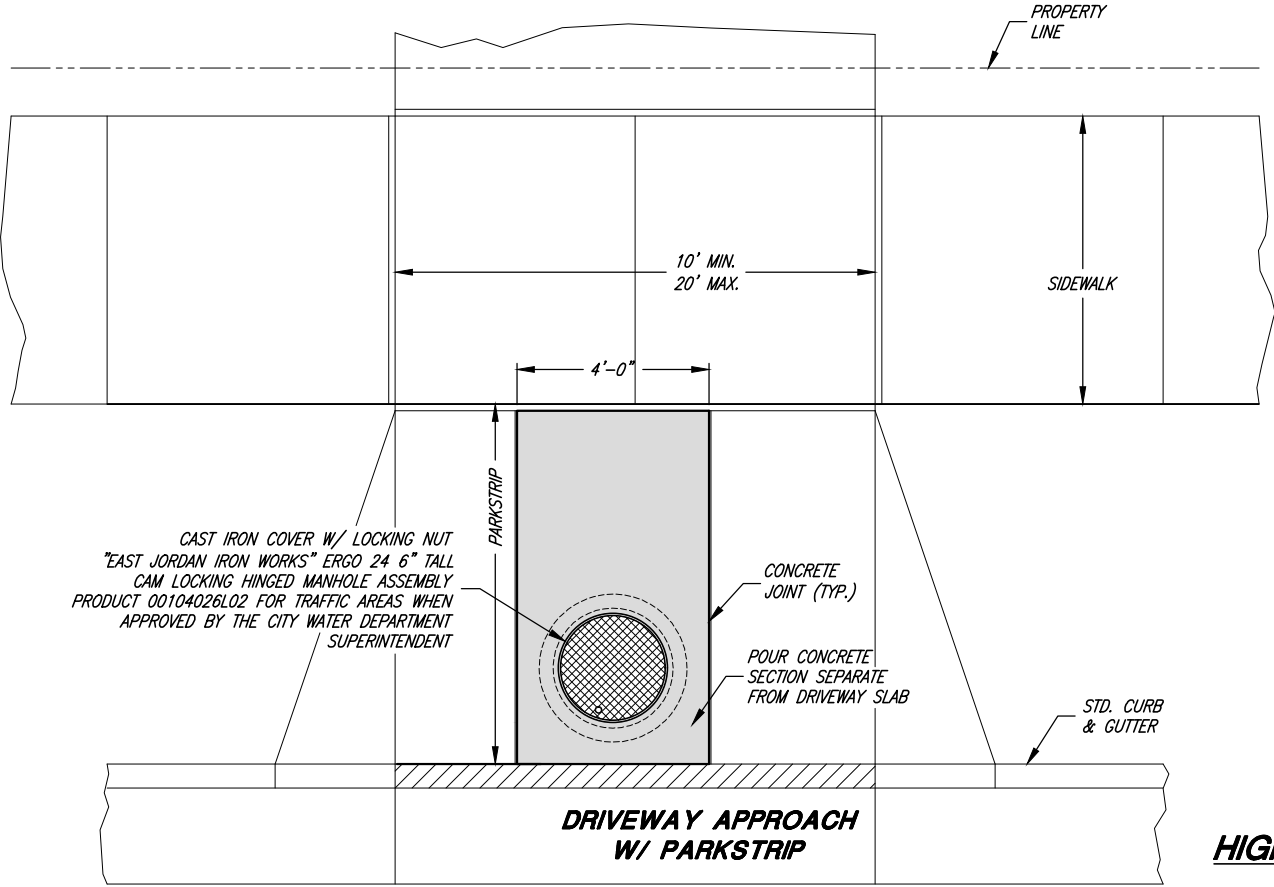

CAST IRON COVER W/ LOCKING NUT  
 "EAST JORDAN IRON WORKS" ERGO 24 6" TALL  
 CAM LOCKING HINGED MANHOLE ASSEMBLY  
 PRODUCT 00104026L02 FOR TRAFFIC AREAS WHEN  
 APPROVED BY THE CITY WATER DEPARTMENT  
 SUPERINTENDENT

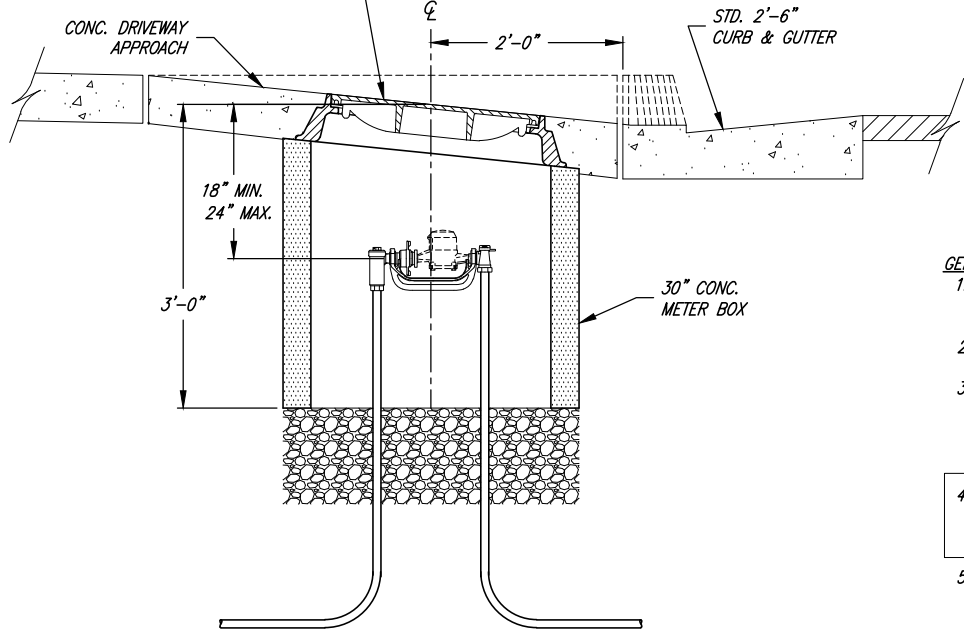

**HIGH TRAFFIC RESIDENTIAL METER PIT DETAIL**

THE USE OF A HIGH TRAFFIC RESIDENTIAL SERVICE METER PIT IS SITE SPECIFIC AND REQUIRES WRITTEN APPROVAL FROM THE WATER SYSTEM SUPERINTENDENT PRIOR TO INSTALLATION

- GENERAL NOTES:**
1. ALL FITTINGS SHALL BE "MUELLER" COMPRESSION TYPE UNLESS OTHERWISE NOTED.
  2. "BLUE" BOLTS AND NUTS ARE REQUIRED BY THE CITY.
  3. ALL SUPPLIES, LABOR, MACHINERY, ETC. WILL BE SUPPLIED BY THE CONTRACTOR. SOUTH WEBER CITY WILL SUPPLY AND SET THE METER ONLY ON 1" CONNECTIONS. THE CONTRACTOR SHALL SUPPLY METERS FOR CONNECTIONS GREATER THAN 1" (SEE SHEET CS-11).
  4. ALL SPECIFIED BRANDS OF MATERIALS SHOWN ON THESE DRAWINGS ARE "CITY STANDARDS." OTHER EQUIVALENT BRANDS MAY BE USED WITH THE PRIOR APPROVAL OF THE CITY ENGINEER AND THE CITY WATER SYSTEM SUPERINTENDENT.
  5. STAMPED STAINLESS STEEL PINS USED FOR LATERAL LOCATING ARE REQUIRED BY THE CITY. BLANK S.S. PINS SHALL BE PROVIDED BY THE CITY AND INSTALLED AND STAMPED BY THE CONTRACTOR DURING ALL NEW CONSTRUCTION OR RESTORED WHEN REPLACING DAMAGED CURB & GUTTER DUE TO ANY CONSTRUCTION RELATED ACTIVITY. S.S. PINS SHALL BE STAMPED "S" FOR SANITARY SEWER, "W" FOR CULINARY WATER, AND "L" FOR LAND DRAIN.



BRANDON KENT JONES  
 PROJECT ENGINEER  
 2-12-2019  
 DATE


REV.	DATE	APPR.	ADDED NOTES
1	JAN '19	BKJ	ADDED NOTES

SCALE:  
 N. T. S.  
 DESIGNED BKJ  
 DRAWN BEB  
 CHECKED BKJ

**JA JONES & ASSOCIATES**  
 CONSULTING ENGINEERS  
 6080 Fashion Point Drive  
 South Ogden, Utah 84403 (801) 476-9767  
 www.jonescivil.com

**SOUTH WEBER CITY CORPORATION**  
 PUBLIC WORKS STANDARDS  
**CULINARY WATER - RESIDENTIAL WATER SERVICE DETAILS**

SHEET:  
**CS-08**  
 OF 24 SHEETS  
 0

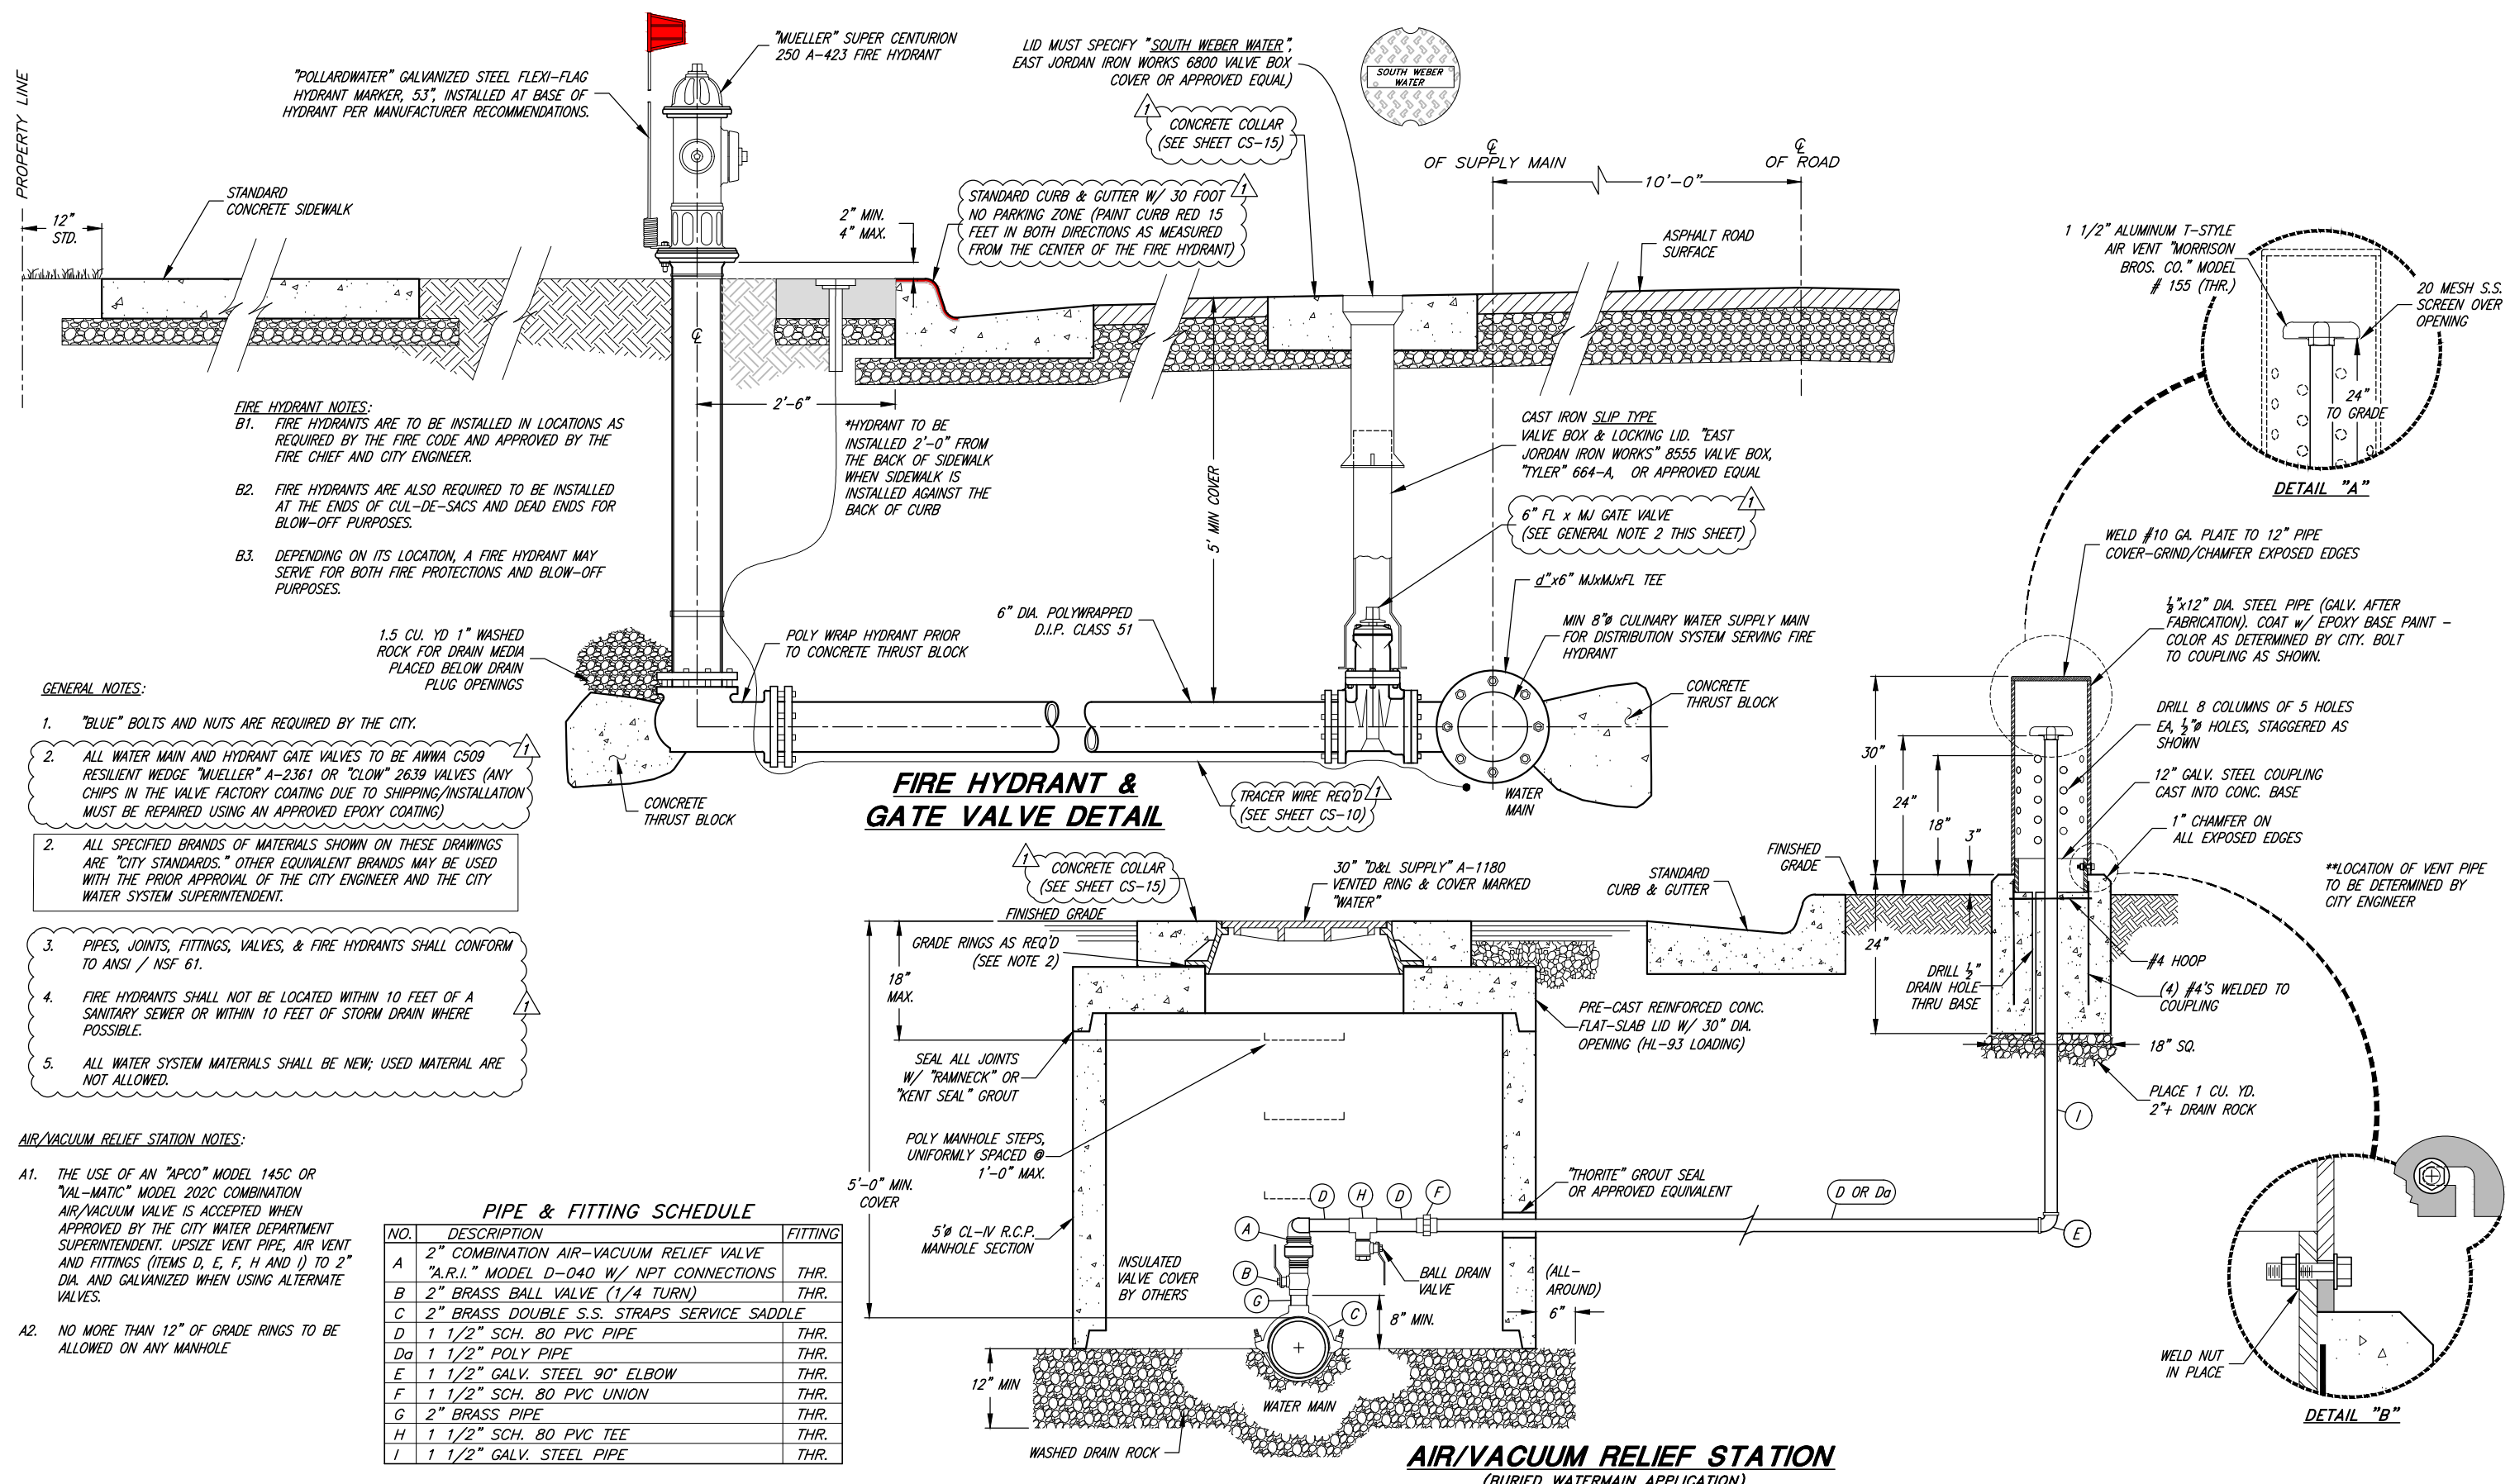

"POLLARDWATER" GALVANIZED STEEL FLEXI-FLAG HYDRANT MARKER, 5.3", INSTALLED AT BASE OF HYDRANT PER MANUFACTURER RECOMMENDATIONS.

"MUELLER" SUPER CENTURION 250 A-423 FIRE HYDRANT

LID MUST SPECIFY "SOUTH WEBER WATER," EAST JORDAN IRON WORKS 6800 VALVE BOX COVER OR APPROVED EQUAL

CONCRETE COLLAR (SEE SHEET CS-15)

STANDARD CURB & GUTTER W/ 30 FOOT NO PARKING ZONE (PAINT CURB RED 15 FEET IN BOTH DIRECTIONS AS MEASURED FROM THE CENTER OF THE FIRE HYDRANT)

CAST IRON SLIP TYPE VALVE BOX & LOCKING LID. "EAST JORDAN IRON WORKS" 8555 VALVE BOX, "TYLER" 664-A, OR APPROVED EQUAL

6" FL x MJ GATE VALVE (SEE GENERAL NOTE 2 THIS SHEET)

4" x 6" MJxMJxFL TEE

MIN 8" CULINARY WATER SUPPLY MAIN FOR DISTRIBUTION SYSTEM SERVING FIRE HYDRANT

CONCRETE THRUST BLOCK

TRACER WIRE REQ'D (SEE SHEET CS-10)

**FIRE HYDRANT & GATE VALVE DETAIL**

CONCRETE COLLAR (SEE SHEET CS-15)

30" "D&L SUPPLY" A-1180 VENTED RING & COVER MARKED "WATER"

STANDARD CURB & GUTTER

FINISHED GRADE

PRE-CAST REINFORCED CONC. FLAT-SLAB LID W/ 30" DIA. OPENING (HL-93 LOADING)

"THORITE" GROUT SEAL OR APPROVED EQUIVALENT

D OR D<sub>a</sub>

\*\*LOCATION OF VENT PIPE TO BE DETERMINED BY CITY ENGINEER

WELD NUT IN PLACE

**AIR/VACUUM RELIEF STATION (BURIED WATERMAIN APPLICATION)**

- FIRE HYDRANT NOTES:**
- B1. FIRE HYDRANTS ARE TO BE INSTALLED IN LOCATIONS AS REQUIRED BY THE FIRE CODE AND APPROVED BY THE FIRE CHIEF AND CITY ENGINEER.
  - B2. FIRE HYDRANTS ARE ALSO REQUIRED TO BE INSTALLED AT THE ENDS OF CUL-DE-SACS AND DEAD ENDS FOR BLOW-OFF PURPOSES.
  - B3. DEPENDING ON ITS LOCATION, A FIRE HYDRANT MAY SERVE FOR BOTH FIRE PROTECTIONS AND BLOW-OFF PURPOSES.

- GENERAL NOTES:**
1. "BLUE" BOLTS AND NUTS ARE REQUIRED BY THE CITY.
  2. ALL WATER MAIN AND HYDRANT GATE VALVES TO BE ANWA C509 RESILIENT WEDGE "MUELLER" A-2361 OR "CLOW" 2639 VALVES (ANY CHIPS IN THE VALVE FACTORY COATING DUE TO SHIPPING/INSTALLATION MUST BE REPAIRED USING AN APPROVED EPOXY COATING)
  2. ALL SPECIFIED BRANDS OF MATERIALS SHOWN ON THESE DRAWINGS ARE "CITY STANDARDS." OTHER EQUIVALENT BRANDS MAY BE USED WITH THE PRIOR APPROVAL OF THE CITY ENGINEER AND THE CITY WATER SYSTEM SUPERINTENDENT.
  3. PIPES, JOINTS, FITTINGS, VALVES, & FIRE HYDRANTS SHALL CONFORM TO ANSI / NSF 61.
  4. FIRE HYDRANTS SHALL NOT BE LOCATED WITHIN 10 FEET OF A SANITARY SEWER OR WITHIN 10 FEET OF STORM DRAIN WHERE POSSIBLE.
  5. ALL WATER SYSTEM MATERIALS SHALL BE NEW; USED MATERIAL ARE NOT ALLOWED.

- AIR/VACUUM RELIEF STATION NOTES:**
- A1. THE USE OF AN "APCO" MODEL 145C OR "VAL-MATIC" MODEL 202C COMBINATION AIR/VACUUM VALVE IS ACCEPTED WHEN APPROVED BY THE CITY WATER DEPARTMENT SUPERINTENDENT. UPSIZE VENT PIPE, AIR VENT AND FITTINGS (ITEMS D, E, F, H AND I) TO 2" DIA. AND GALVANIZED WHEN USING ALTERNATE VALVES.
  - A2. NO MORE THAN 12" OF GRADE RINGS TO BE ALLOWED ON ANY MANHOLE

**PIPE & FITTING SCHEDULE**

NO.	DESCRIPTION	FITTING
A	2" COMBINATION AIR-VACUUM RELIEF VALVE "A.R.I." MODEL D-040 W/ NPT CONNECTIONS	THR.
B	2" BRASS BALL VALVE (1/4 TURN)	THR.
C	2" BRASS DOUBLE S.S. STRAPS SERVICE SADDLE	
D	1 1/2" SCH. 80 PVC PIPE	THR.
D <sub>a</sub>	1 1/2" POLY PIPE	THR.
E	1 1/2" GALV. STEEL 90° ELBOW	THR.
F	1 1/2" SCH. 80 PVC UNION	THR.
G	2" BRASS PIPE	THR.
H	1 1/2" SCH. 80 PVC TEE	THR.
I	1 1/2" GALV. STEEL PIPE	THR.

REGISTERED PROFESSIONAL ENGINEER  
 BRANDON KENT JONES  
 No. 5148758  
 State of Utah  
 PROJECT ENGINEER  
 Brandon K. Jones  
 DATE 2-12-2019

REV.	DATE	APPR.	DESCRIPTION
1	12/29/2017	BKJ	UPDATED FIRE HYDRANT MARKER TO FLEXI-FLAG
1	JAN '19	BKJ	ADDED AND/OR MODIFIED NOTES



SCALE: N.T.S.

DESIGNED: BKJ  
 DRAWN: BEB  
 CHECKED: BKJ

**JA JONES & ASSOCIATES**  
 CONSULTING ENGINEERS  
 6080 Fashion Point Drive  
 South Ogden, Utah 84403 (801) 476-9767  
 www.jonescivil.com



**SOUTH WEBER CITY CORPORATION**  
 PUBLIC WORKS STANDARDS  
**CULINARY WATER - AIR/VACUUM RELIEF STATION & FIRE HYDRANT DETAILS**

SHEET: **CS-09**  
 OF 24 SHEETS  
 0

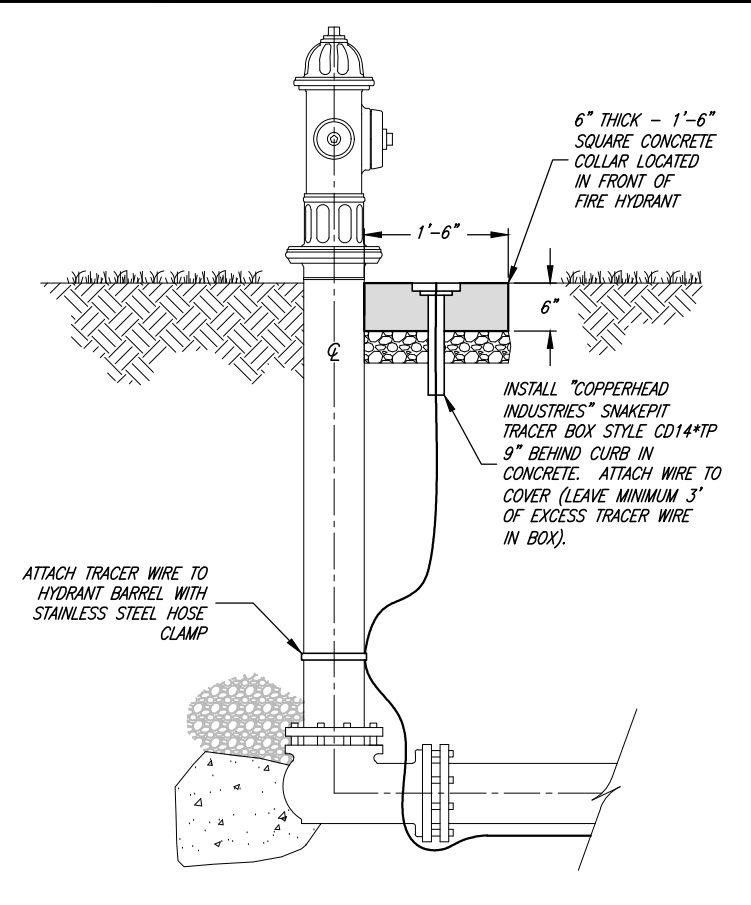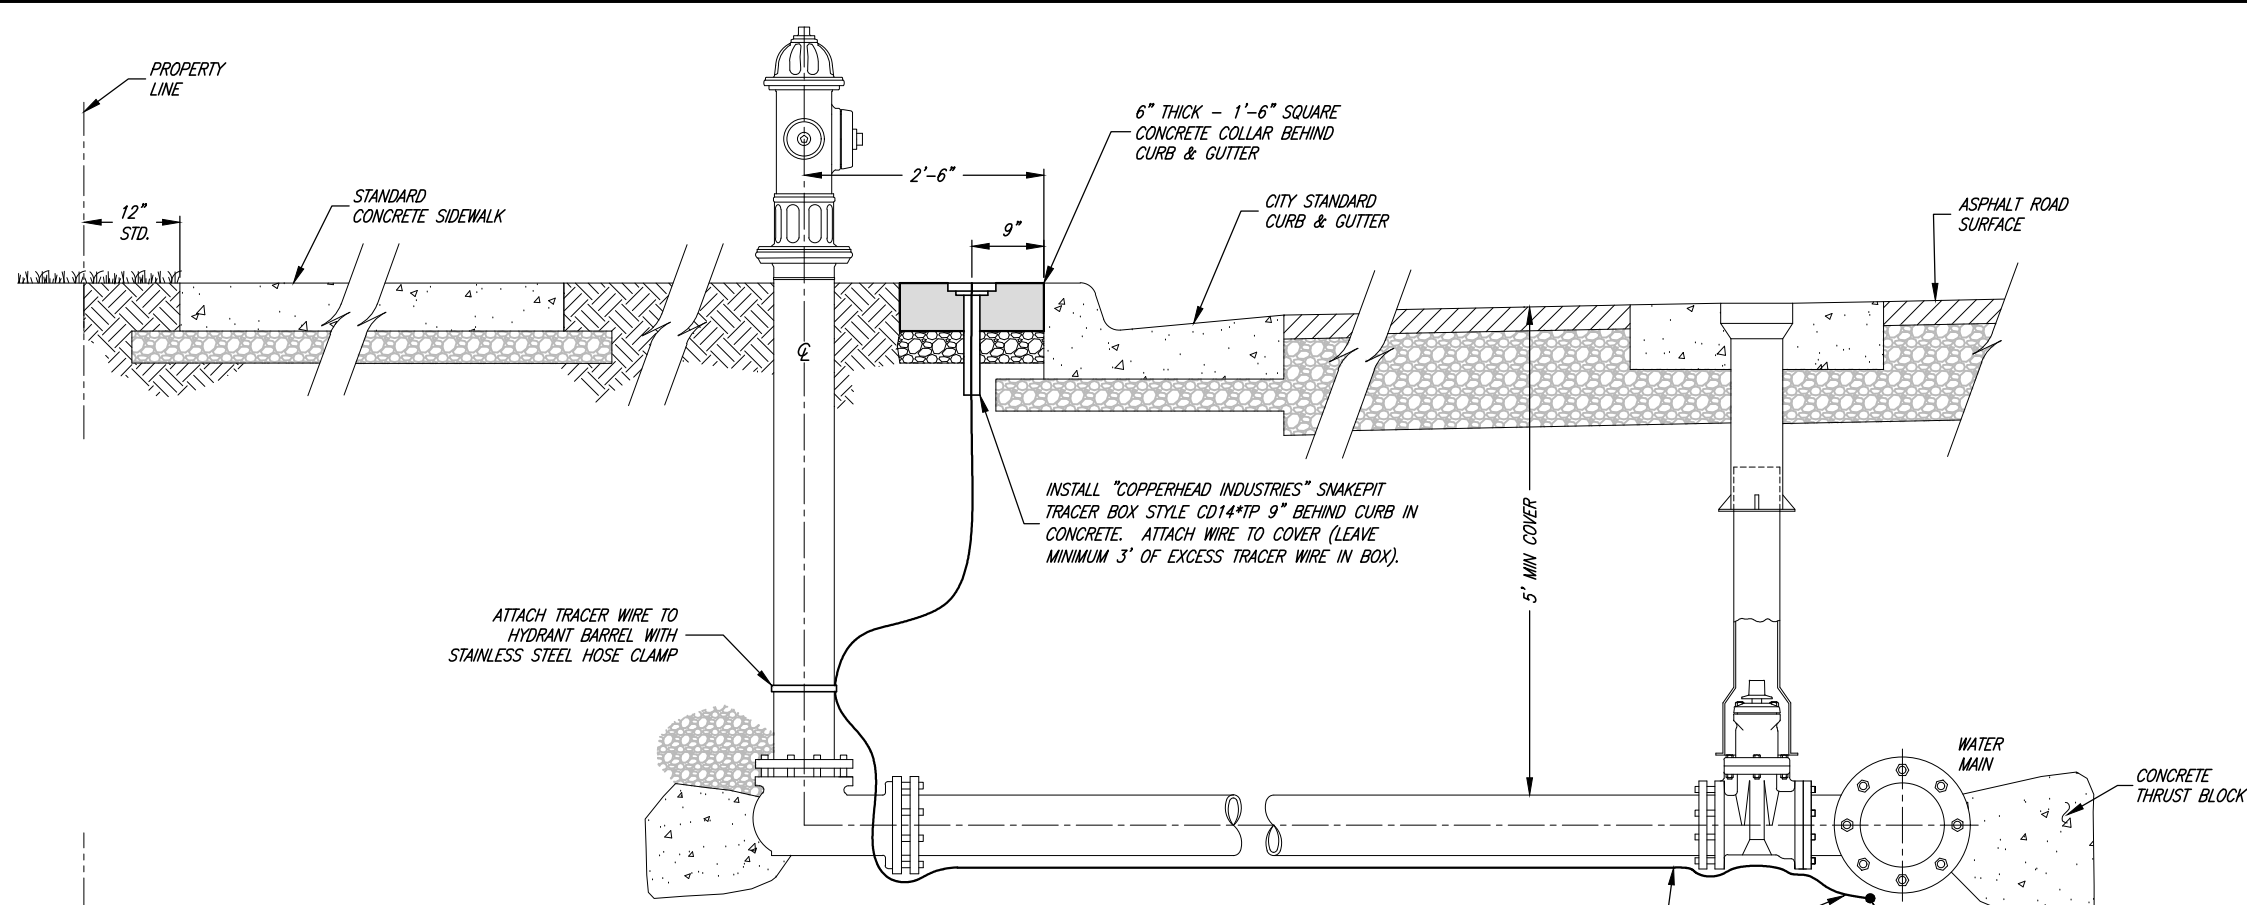

**ALTERNATE TRACER WIRE INSTALLATION**

WHERE APPROVED BY THE WATER SYSTEM SUPERINTENDENT ON STREET SECTIONS WITH NO CURB & GUTTER

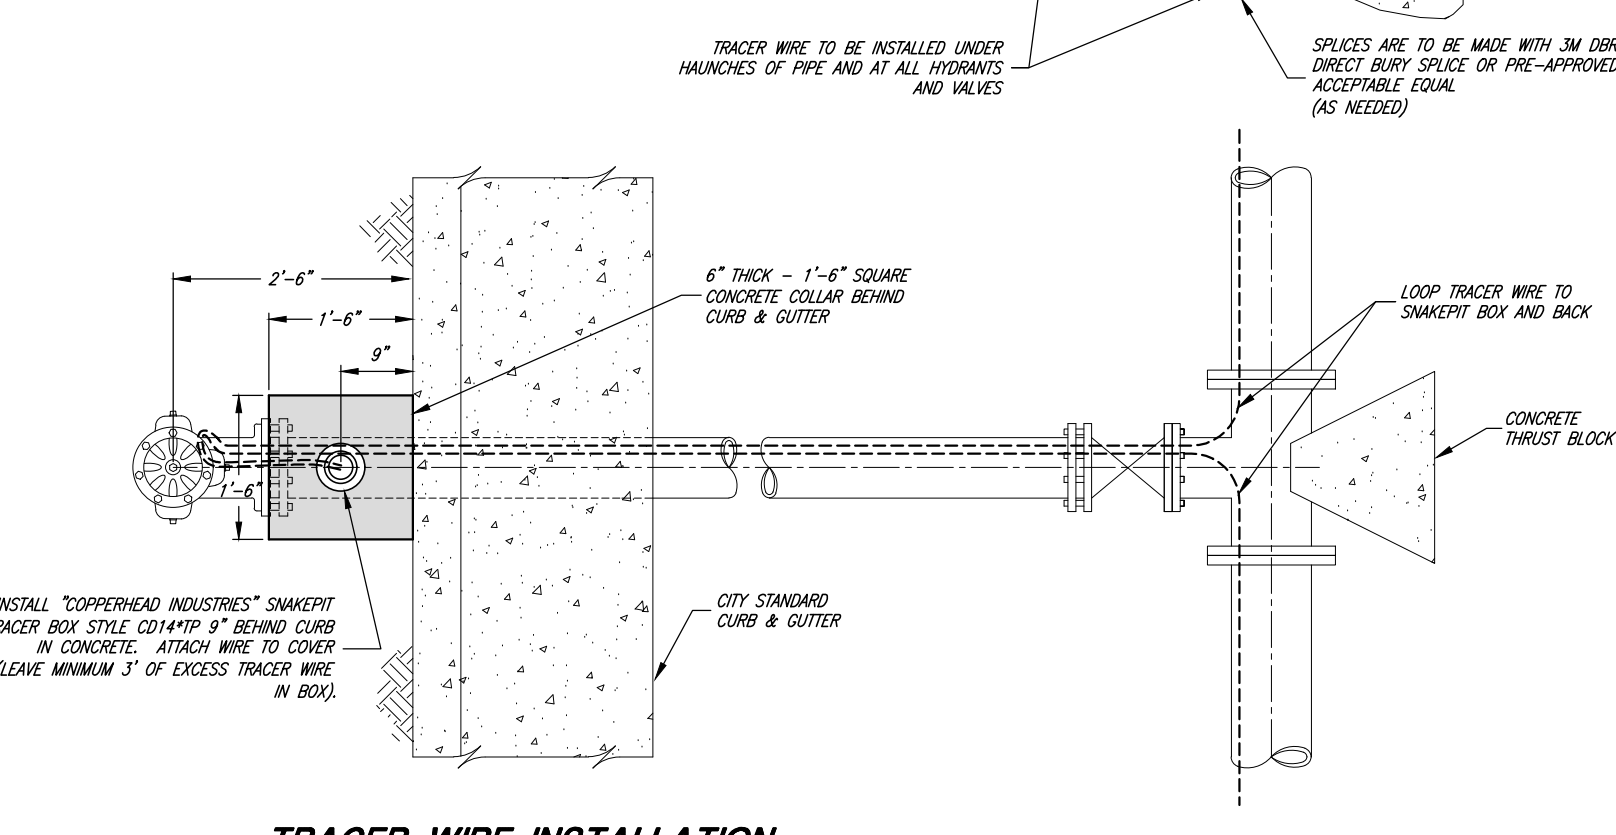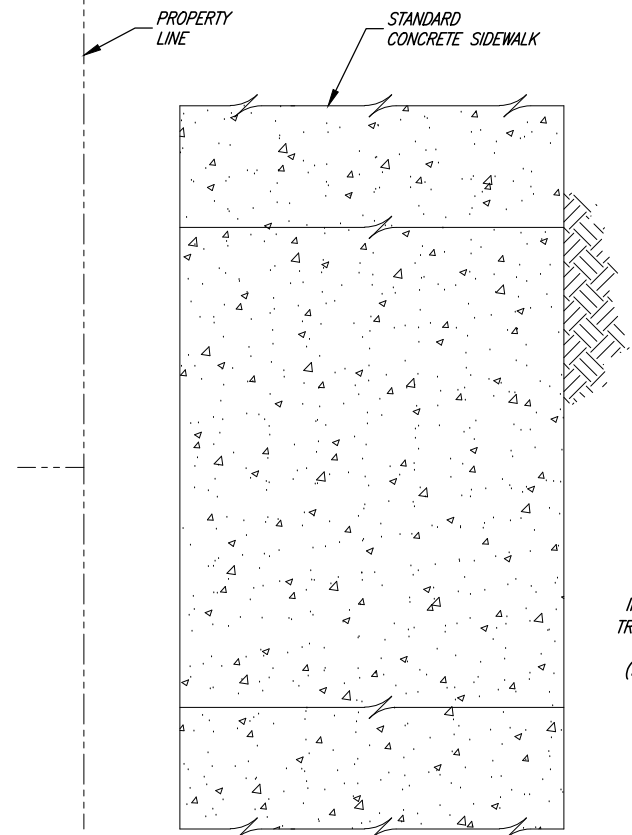

**TRACER WIRE INSTALLATION**  
CITY STANDARD STREET SECTION (CURB & GUTTER)

NOTES:

1. ALL WATERLINES SHALL HAVE A MINIMUM 12 GA. INSULATED TRACER WIRE INSTALLED UNDER THE HAUNCHES OF THE PIPE PRIOR TO BACKFILLING.
2. TRACER WIRES SHALL TERMINATE AT ALL FIRE HYDRANTS, AT SERVICE SADDLES AND TAPPING SLEEVES, THE TRACER WIRE SHALL NOT BE ALLOWED TO BE PLACED BETWEEN THE SADDLE AND THE PIPE. A GROUNDING ROD SHALL BE INSTALLED AT ALL TRACER SYSTEM TERMINAL POINTS.
3. TRACER WIRE SHALL BE COPPER WIRE WITH BLUE INSULATION RATED FOR DIRECT BURIAL. ALL WIRE CONNECTORS SHALL BE 3M DBR DIRECT BURY SPLICE OR PRE-APPROVED ACCEPTABLE EQUAL AND SHALL BE WATERTIGHT TO PROVIDE ELECTRICAL CONTINUITY.
4. ALL TRACER WIRE SHALL BE TESTED FOR CONTINUITY IN THE PRESENCE OF THE PUBLIC WORKS INSPECTOR PRIOR TO ASPHALT PLACEMENT. ANY TRACER WIRE FOUND NOT TO BE CONTINUOUS AFTER TESTING SHALL BE REPAIRED OR REPLACED BY THE CONTRACTOR PRIOR TO ASPHALT PLACEMENT.



Brandon K. Jones  
PROJECT ENGINEER  
2-12-2019  
DATE

REV.	DATE	APPR.
1	JAN '19	BKJ

SCALE:  
N. T. S.



DESIGNED BKJ  
DRAWN BEB  
CHECKED BKJ

**JA JONES & ASSOCIATES**  
CONSULTING ENGINEERS  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
www.jonescivil.com

**SOUTH WEBER CITY CORPORATION**  
PUBLIC WORKS STANDARDS  
CULINARY WATER - TRACER WIRE  
INSTALLATION DETAILS

SHEET:  
**CS-10**  
OF 24 SHEETS  
0



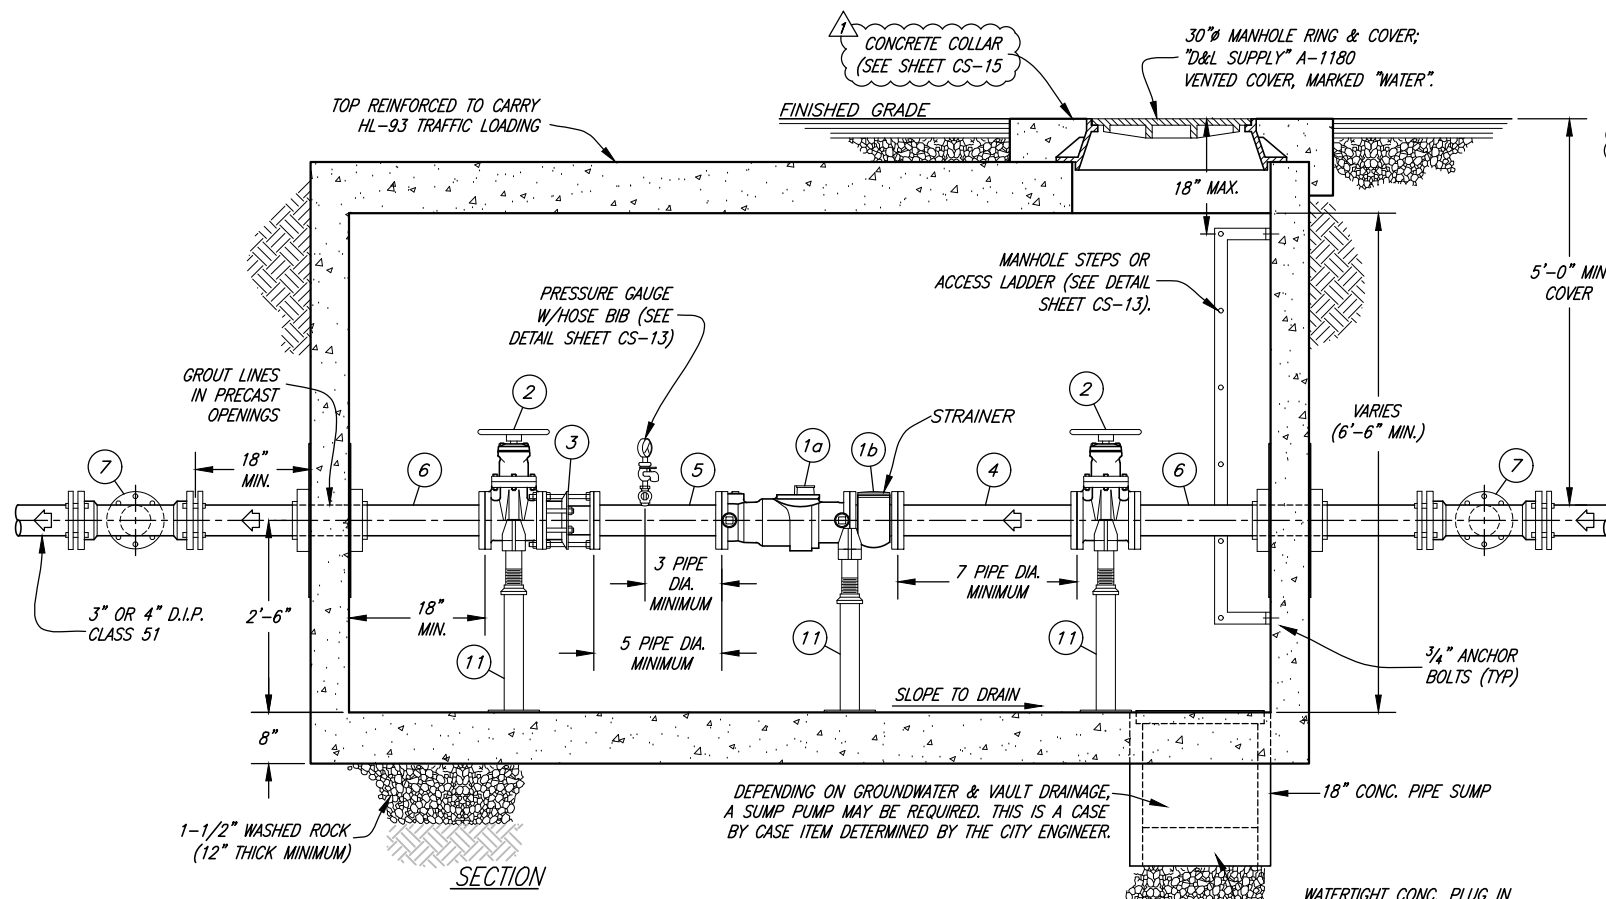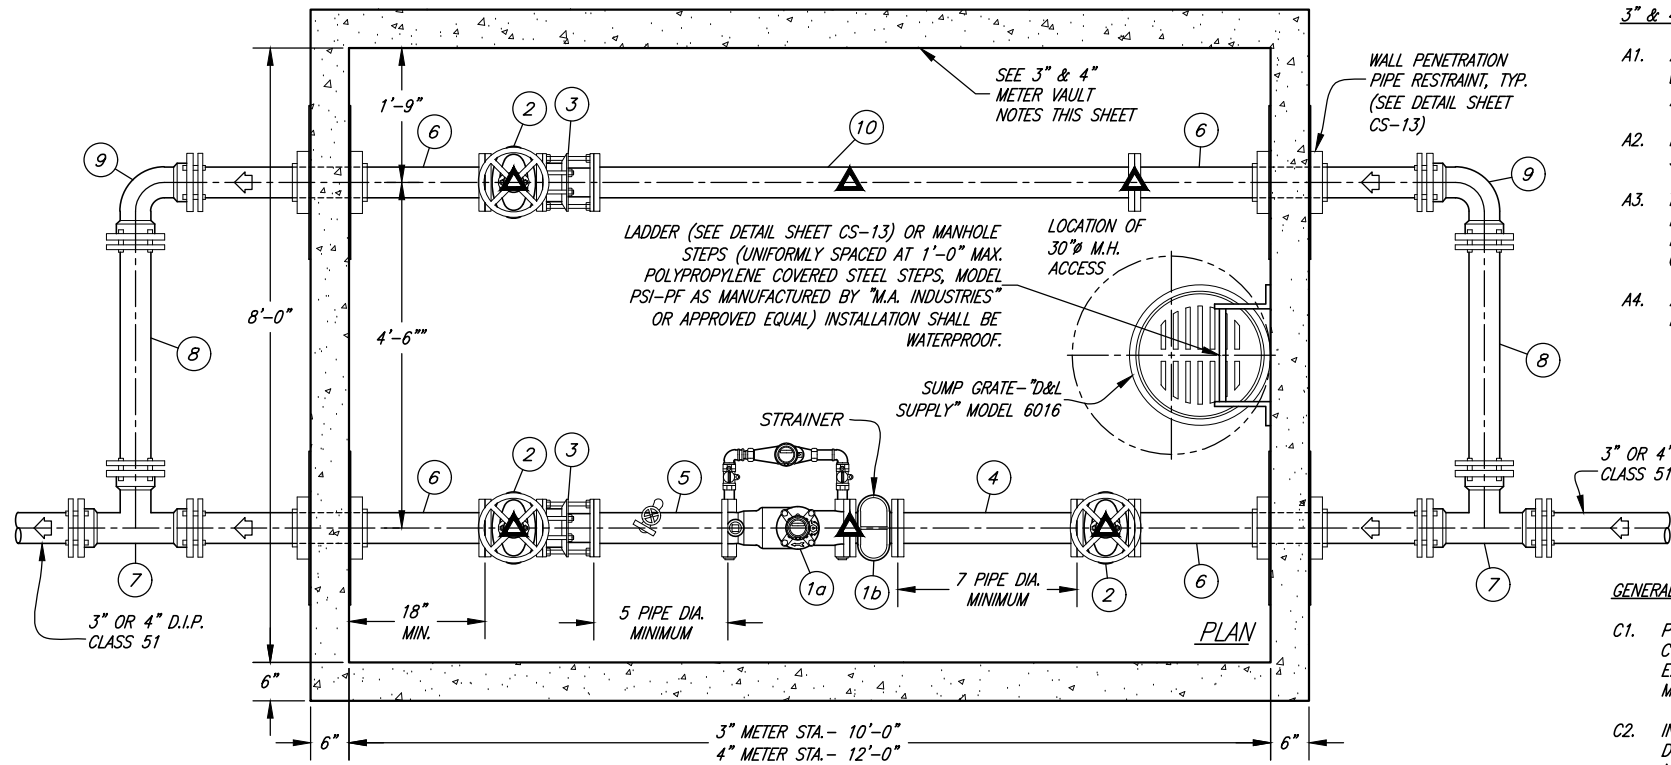

**3" & 4" WATER METER STATION**

- 3" & 4" METER VAULT NOTES:**
- A1. ALL FITTINGS OUTSIDE OF THE VAULT ARE TO BE DUCTILE IRON MJ WITH THRUST RESTRAINT RETAINER GLANDS ("ROMAC", MJRG, OR APPROVED EQUAL).
  - A2. PENETRATION WALLS NEED TO BE ADEQUATELY DESIGNED STRUCTURALLY FOR ANTICIPATED THRUST.
  - A3. THE PRECAST VAULT MANUFACTURER IS RESPONSIBLE FOR DESIGN RELATED TO TRAFFIC LOADING AND THRUST. VERIFICATION OF PROPER DESIGN MUST BE PROVIDED TO THE CITY BY THE DEVELOPER, CONTRACTOR, OR PROPERTY OWNER AS THE CASE MAY BE.
  - A4. ALL FITTINGS SHALL BE AWWA C-110 WITH 125 LB. FLANGES. ALL PIPING SHALL BE DUCTILE IRON PIPE CLASS 350 P.S.I. MIN.

NOTE: ALL SPECIFIED BRANDS OF MATERIALS SHOWN ON THESE DRAWINGS ARE "CITY STANDARDS." OTHER EQUIVALENT BRANDS MAY BE USED WITH THE PRIOR APPROVAL OF THE CITY ENGINEER AND THE CITY WATER SYSTEM SUPERINTENDENT.


- GENERAL NOTES:**
- C1. PROPERTY OWNER OR CONTRACTOR SHALL PAY FOR ALL COSTS OF INSTALLATION INCLUDING ALL MATERIALS, ALL EXCAVATION AND FILL, ASPHALT REPLACEMENT AND WATER MAIN CONNECTION.
  - C2. INSPECTION OF ALL WATER LINE INSTALLATIONS WILL BE DONE BY THE CITY WATER DEPARTMENT, WITH A 48 HOUR MINIMUM NOTICE REQUIRED PRIOR TO START OF WORK.
  - C3. IF APPLICABLE, A CITY EXCAVATION PERMIT MUST BE REQUESTED AND APPROVED PRIOR TO START OF WORK.
  - C4. "BLUE" BOLTS AND NUTS ARE REQUIRED BY THE CITY.
  - C5. CONTRACTOR TO SUPPLY ALL METERS 1 1/2" OR LARGER.

- 1 1/2" & 2" METER NOTES:**
- B1. 1 1/2" SERVICE LINE-13" METER  
2" SERVICE LINE-17" METER
  - B2. NO MORE THAN 12" OF GRADE RINGS TO BE ALLOWED ON ANY MANHOLE
  - B3. MANHOLE STEPS (FOR MANHOLES OVER 6' DEEP.) UNIFORMLY SPACED (1'-0" MAX.) POLYPROPYLENE COVERED STEEL STEPS, MODEL PSI-PF AS MANUFACTURED BY "M.A. INDUSTRIES" OR APPROVED EQUAL - INSTALLATION OF STEPS SHALL BE WATERPROOF.

**PIPE & FITTING SCHEDULE**

NO.	DESCRIPTION (3" & 4" METER STA.)	JOINT TYPE	3" LINE	4" LINE
1a	"MASTER METER" DUAL BODY COMPOUND (DBC) METER W/ STRAINER & 3G INTEGRATED REGISTER	FL	3"	4"
2	"MUELLER" RESILIENT WEDGE GATE VALVE W/ HANDWHEEL	FL	3" A-2362	4" A-2361
3	"ROMAC" DJ400 DISMANTLING JOINT	FL	3"	4"
4	SPOOL PIECE (7 PIPE DIA. MINIMUM)	FL	3"	4"
5	SPOOL PIECE (5 PIPE DIA. MINIMUM)	FL	3"	4"
6	NIPPLE	FLxPE	3"	4"
7	TEE	MJ	3"	4"
8	PIPE SECTION	PE	3"	4"
9	90° ELBOW	MJ	3"	4"
10	SPOOL PIECE	FL	3"	4"
11	"CLOW" F-1608 OR "ANVIL" #264 GALV. PIPE SUPPORT W/ COMPANION FLANGE & VARIABLE HEIGHT NIPPLE (6 EA REQ'D)			

NO.	DESCRIPTION (1 1/2" & 2" METER STA.)	JOINT TYPE	1 1/2" LINE	2" LINE
12	"MASTER METER" INTERMEDIATE MULTI-JET METER W/3G INTEGRATED REGISTER	FL	1 1/2"	2"
13	"MUELLER" B-2423-2 METER YOKE (18" RISER)	-	1 1/2"	2"
14	"MUELLER" 110 COMPRESSION CONN. COUPLING	-	1 1/2"	2"

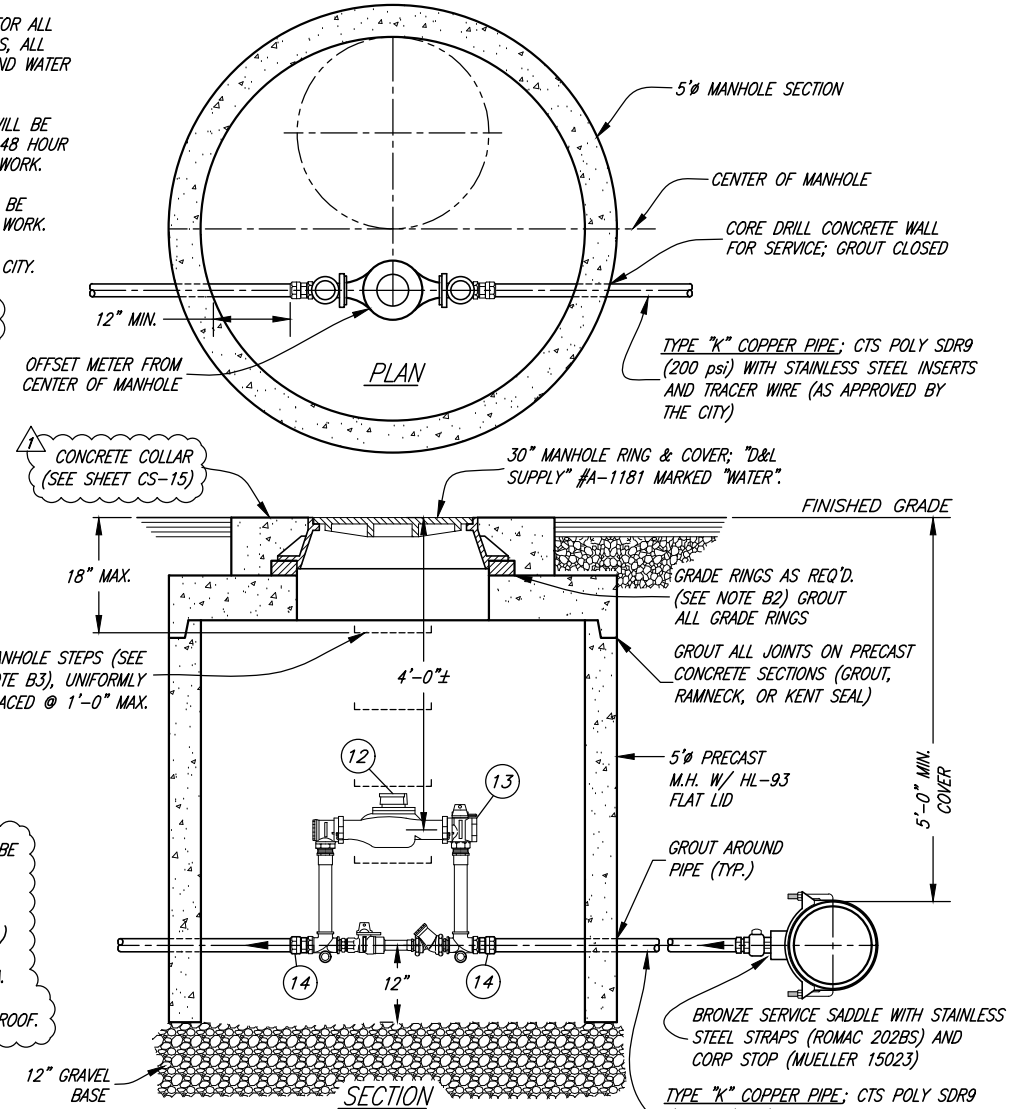

**1 1/2" & 2" WATER METER STATION**


BRANDON KENT JONES  
No. 5148758  
REGISTERED PROFESSIONAL ENGINEER  
State of Utah

REV.	DATE	APPR.	MODIFIED NOTES
1	JAN '19	BKJ	MODIFIED NOTES


SCALE: N.T.S.  
DESIGNED: BKJ  
DRAWN: BEB  
CHECKED: BKJ

**JA JONES & ASSOCIATES**  
CONSULTING ENGINEERS  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
www.jonescivil.com

**SOUTH WEBER CITY CORPORATION**  
PUBLIC WORKS STANDARDS  
**CULINARY WATER - STANDARD WATER METER STATIONS**

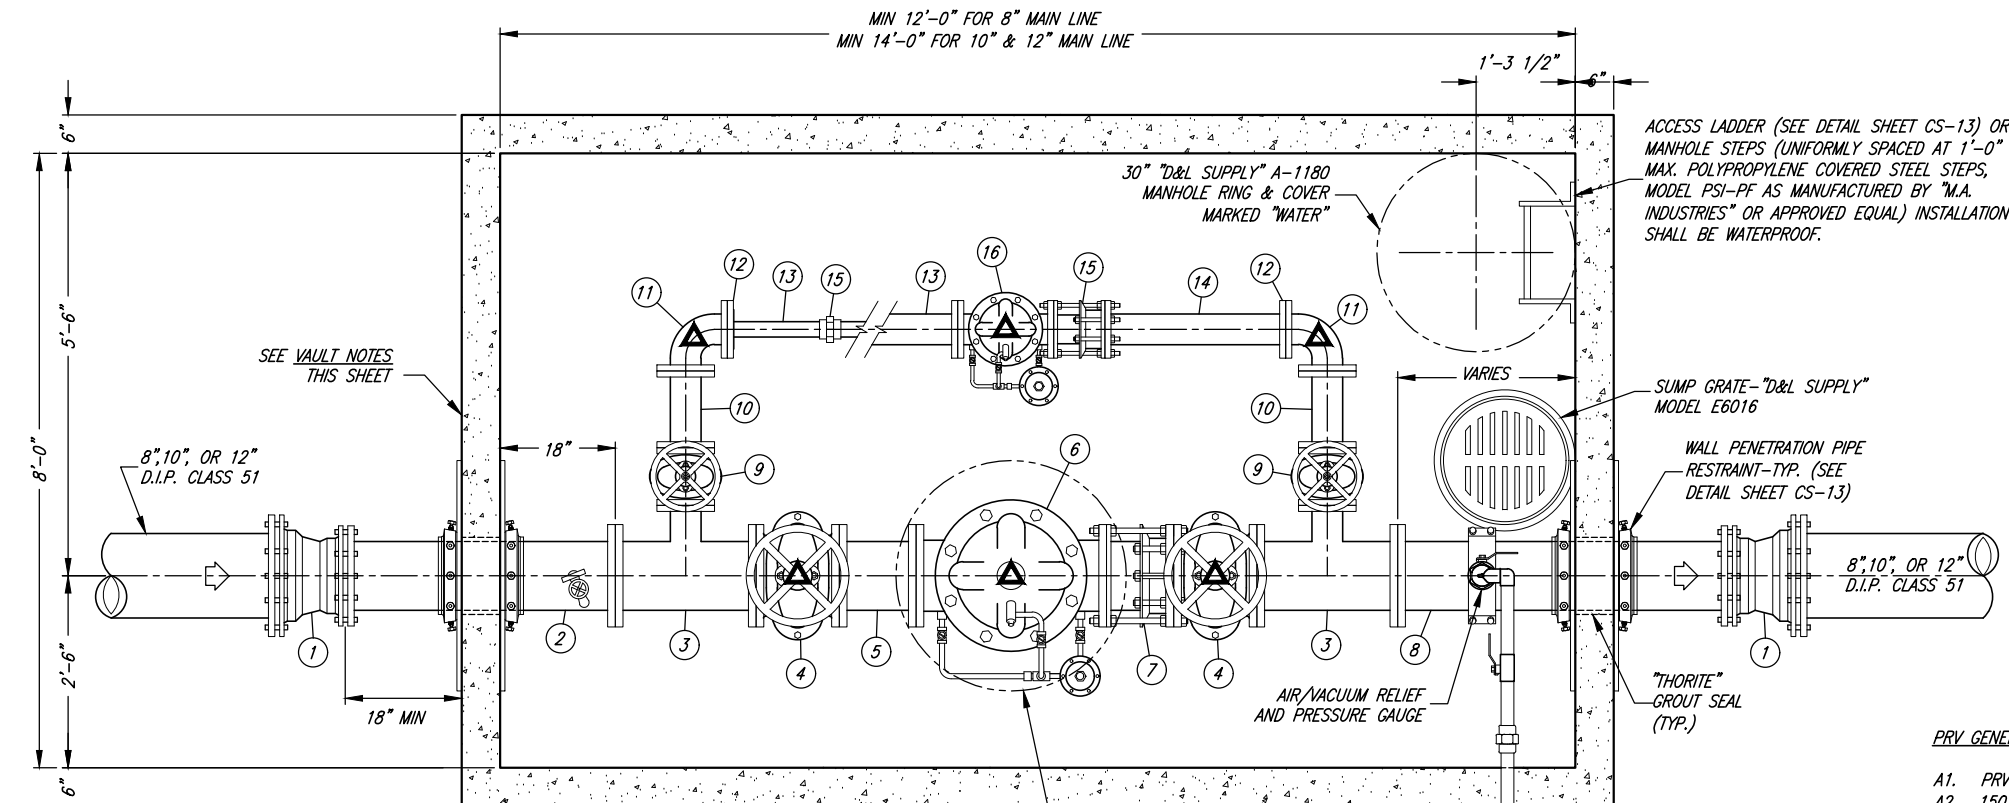

NO.	DESCRIPTION	JOINT TYPE	8" LINE	10" LINE	12" LINE
1	D.I. REDUCER (2)	MJM	8"x6"	10"x8"	12"x10"
2	D.I. NIPPLE PIECE	FLxPE	6"	8"	10"
3	D.I. REDUCING TEE (2)	FL	6"x6"x4"	8"x8"x4"	10"x10"x4"
4	"MUELLER" A-2361 GATE VALVE W/ HANDWHEEL (2)	FL	6"	8"	10"
5	12" D.I. SPOOL PIECE	FL	6"	8"	10"
6	"CLA-VAL" 90-01 PRESSURE REDUCTION VALVE	FL	6"	8"	10"
7	"ROMAC" DJ400 DISMANTLING JOINT	FL	6"	8"	10"
8	D.I. NIPPLE PIECE	FLxPE	6"	8"	10"
9	"MUELLER" A-2361 GATE VALVE W/ HANDWHEEL (2)	FL	4"	4"	4"
10	12" D.I. SPOOL PIECE	FL	4"	4"	4"
11	D.I. 90° ELBOW (2)	FL	4"	4"	4"
12	BLIND FLANGE W/ THR. CONNECTION (2)	FLxTHR.	4"x2"	--	--
13	D.I. SPOOL PIECE BRASS PIPE	THR.	2"	--	--
14	D.I. SPOOL PIECE BRASS PIPE	THR.	2"	--	--
15	"ROMAC" DJ400 DISMANTLING JOINT BRASS UNION	THR.	2"	--	--
16	"CLA-VAL" 90-01 PRESSURE REDUCTION VALVE	THR.	2"	4"	4"
17	"CLOW" F-1608 OR "ANVIL" #264 GALV. PIPE SUPPORT W/ 3" COMPANION FLANGE & VARIABLE HEIGHT 3" NIPPLE (6 EA REQ'D.)	THR.	--	4"	4"

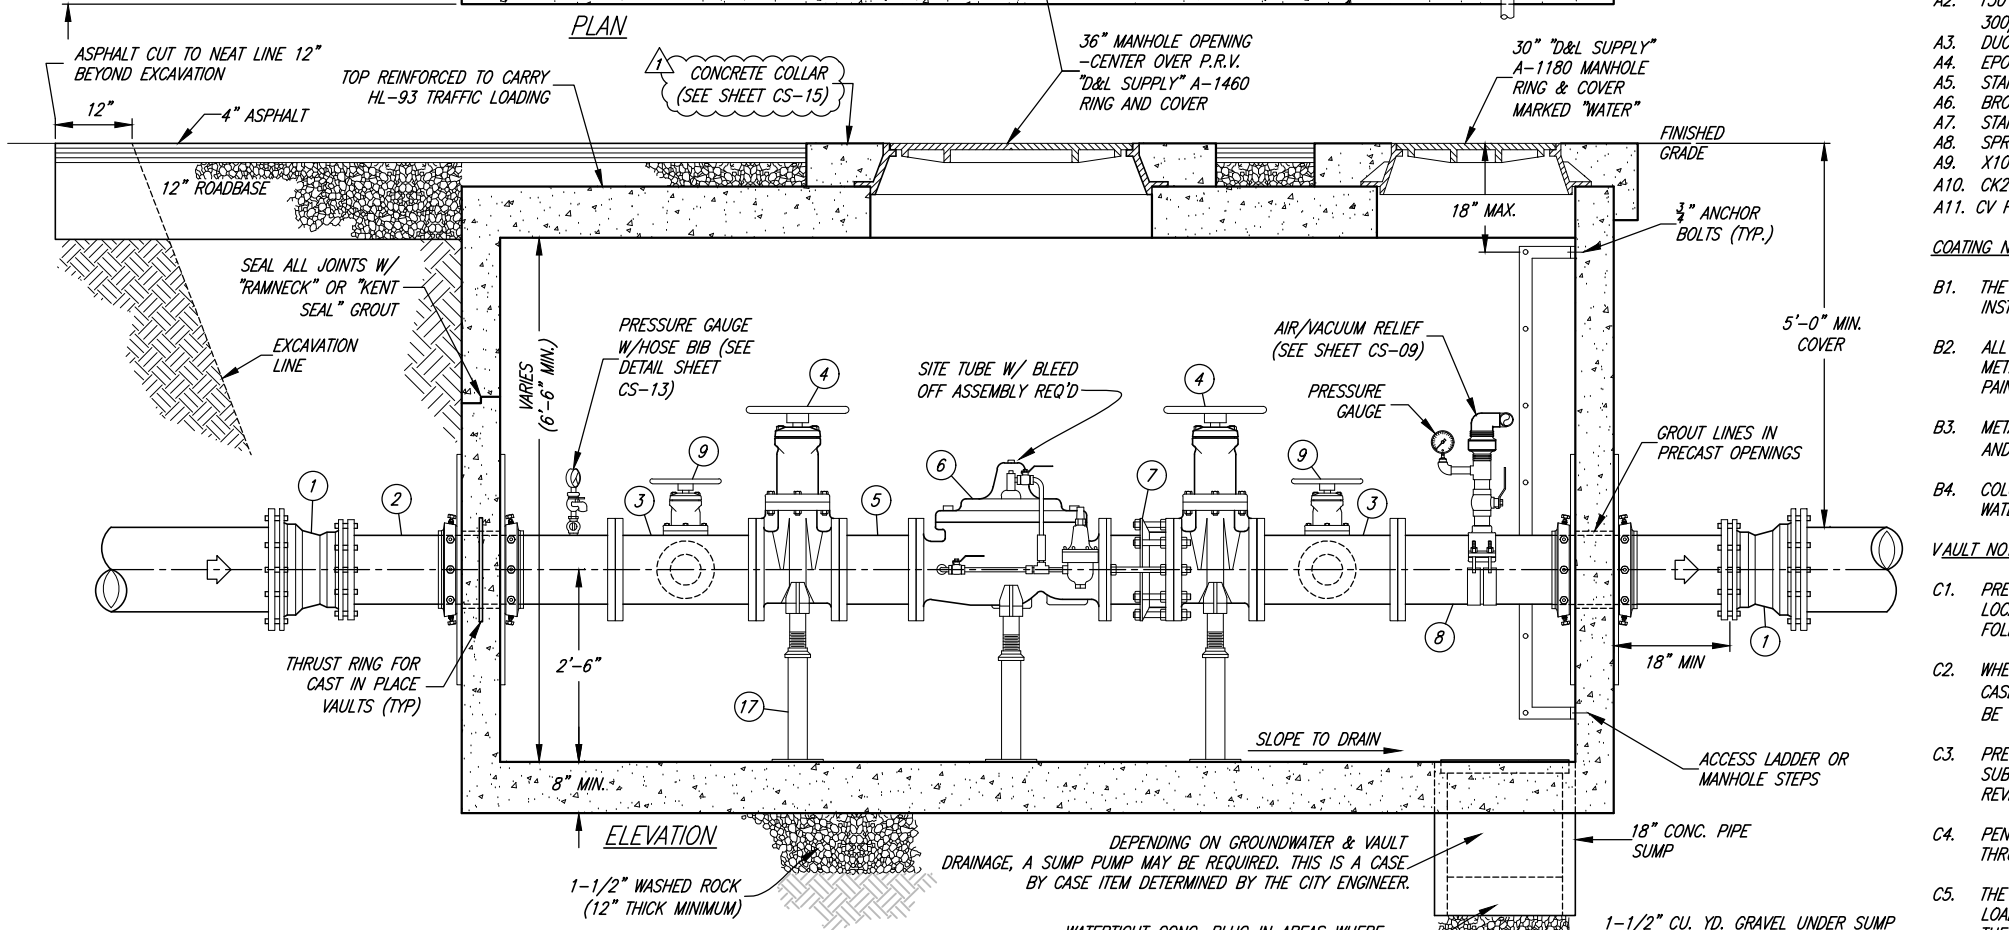

**PRESSURE REDUCTION STATION**

**PRV GENERAL SPECIFICATIONS:**

- A1. PRV TO BE CLA-VAL #90-01 YBCSKC
- A2. 150 # FLANGED FOR 250 PSI WORKING PRESSURE, 300# FLANGED IF GREATER THAN 250 PSI
- A3. DUCTILE IRON BODY GLOBE PATTERN
- A4. EPOXY LINED AND COATED
- A5. STAINLESS STEEL INTERNAL TRIM
- A6. BRONZE PILOT CONTROLS
- A7. STAINLESS STEEL TUBES & FITTINGS
- A8. SPRING RANGES FOR PRESSURE REDUCING PILOT
- A9. X101 VALVE POSITION INDICATOR
- A10. CK2 ISOLATION BALL VALVES (STAINLESS)
- A11. CV FLOW CONTROL (OPENING)

**COATING NOTES:**

- B1. THE P.R.V. VALVE SHALL INCLUDE FACTORY INSTALLED INTERIOR EPOXY COATING.
- B2. ALL NEW AND EXISTING PIPING, VALVES, FITTINGS, METERS, ETC., INSIDE THE VAULT SHALL BE EPOXY PAINTED.
- B3. METAL SURFACES TO BE PAINTED SHALL BE PRIMED AND THEN PAINTED W/ TWO COATS OF EPOXY PAINT.
- B4. COLORS AS DIRECTED BY THE CITY ENGINEER OR CITY WATER SYSTEM SUPERINTENDENT.

**VAULT NOTES:**

- C1. PRE-PLUMBED PRV VAULTS ARE THE PREFERRED OPTION FOR INSTALLATION. THE USE AND LOCATION OF A PRE-PLUMBED PRV VAULT SHALL BE AS DIRECTED BY THE CITY ENGINEER FOLLOWING REVIEW OF CURRENT SITE CONDITIONS.
- C2. WHERE APPLICABLE, PRESSURE RELIEF VALVE ASSEMBLY MAY BE REQUIRED. THIS IS A CASE BY CASE ITEM DETERMINED BY THE CITY WATER DEPARTMENT (PRV VAULT WILL NEED TO BE LENGTHENED TO ACCOMMODATE SUCH VALVE)
- C3. PRECAST CONCRETE STRUCTURE CAN BE REPLACED WITH CAST-IN-PLACE CONCRETE VAULT. SUBMIT ENGINEERED CONSTRUCTION PLANS WITH REBAR DETAILS TO CITY ENGINEER FOR REVIEW AND ACCEPTANCE PRIOR TO CONSTRUCTION.
- C4. PENETRATION WALLS NEED TO BE ADEQUATELY DESIGNED STRUCTURALLY FOR ANTICIPATED THRUST.
- C5. THE PRECAST VAULT MANUFACTURER IS RESPONSIBLE FOR DESIGN RELATED TO HL-93 TRAFFIC LOADING AND THRUST. VERIFICATION OF PROPER DESIGN MUST BE PROVIDED TO THE CITY BY THE DEVELOPER, CONTRACTOR, OR PROPERTY OWNER AS THE CASE MAY BE.

**GENERAL NOTES:**

- A. "BLUE" BOLTS AND NUTS ARE REQUIRED BY THE CITY.
- B. ALL FITTINGS OUTSIDE OF THE VAULT ARE TO BE DUCTILE IRON M/J WITH THRUST RESTRAINT RETAINER GLANDS ("ROMAC", M/JRC, OR APPROVED EQUAL)
- C. STRUCTURE, PIPING & VALVE SIZES FOR P.R.V. STATIONS ON LINE SIZES GREATER THAN 12" SHALL BE SPECIFIED BY THE CITY ENGINEER.
- D. ALL SPECIFIED BRANDS OF MATERIALS SHOWN ON THESE DRAWINGS ARE "CITY STANDARDS." OTHER EQUIVALENT BRANDS MAY BE USED WITH THE PRIOR APPROVAL OF THE CITY ENGINEER AND THE CITY WATER SYSTEM SUPERINTENDENT.

REV.	DATE	APPR.	MODIFIED NOTES
1	JAN '19	BKJ	MODIFIED NOTES

SCALE: N.T.S.  
 DESIGNED: BKJ  
 DRAWN: BEB  
 CHECKED: BKJ

**J&A CONSULTING ENGINEERS**  
 6080 Fashion Point Drive  
 South Ogden, Utah 84403 (801) 476-9767  
 www.jonescivil.com


**SOUTH WEBER CITY CORPORATION**  
**PUBLIC WORKS STANDARDS**  
**CULINARY WATER - PRESSURE REDUCTION STATION**





**CONCRETE COLLAR NOTES:**


- A1. ALL CONCRETE COLLARS TO BE INSTALLED WITHIN 14 DAYS AFTER PAVING.
- B1. COLLARS AROUND MANHOLES AND CULINARY WATER VALVES ARE TO BE ROUND.
- C1. COLLARS AROUND IRRIGATION VALVES ARE TO BE SQUARE.
- D1. FIBER MESH SHALL BE ADDED TO ALL CONCRETE.

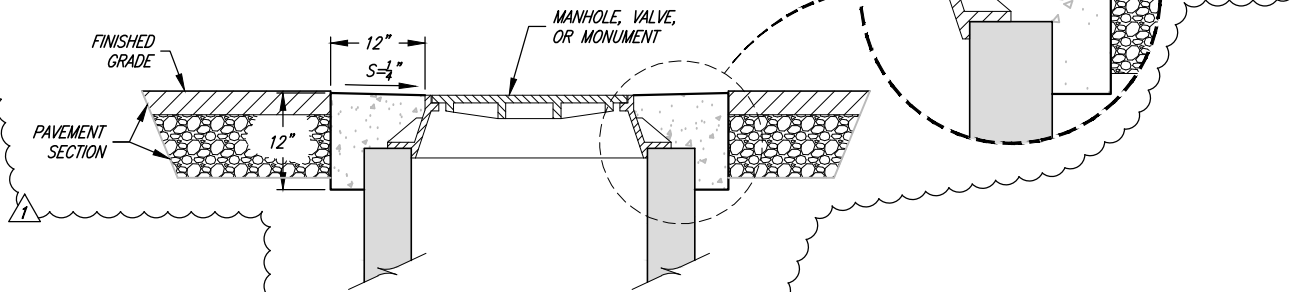


**CONCRETE COLLAR DETAIL**

**DROP MANHOLE NOTES:**


- A. USE DROP MANHOLE ONLY WHEN DROP EXCEEDS 2'-0" (UAC R317-3)
- B. DROP MANHOLE SHALL CONSIST OF ASTM D3034 SDR 35 PVC PIPE WITH SDR 35 PVC GASKETED FITTINGS.
- C. DUE TO THE UNEQUAL EARTH PRESSURES THAT WOULD RESULT FROM THE BACKFILLING OPERATION IN THE VICINITY OF THE MANHOLE, THE ENTIRE OUTSIDE DROP CONNECTIONS SHALL BE ENCASED IN CONCRETE. (UAC R317-3)
- D. DROP MANHOLES SHOULD BE USED ON STREETS WITH GRADES 8% OR GREATER OR AS OTHERWISE DIRECTED BY THE CITY ENGINEER.

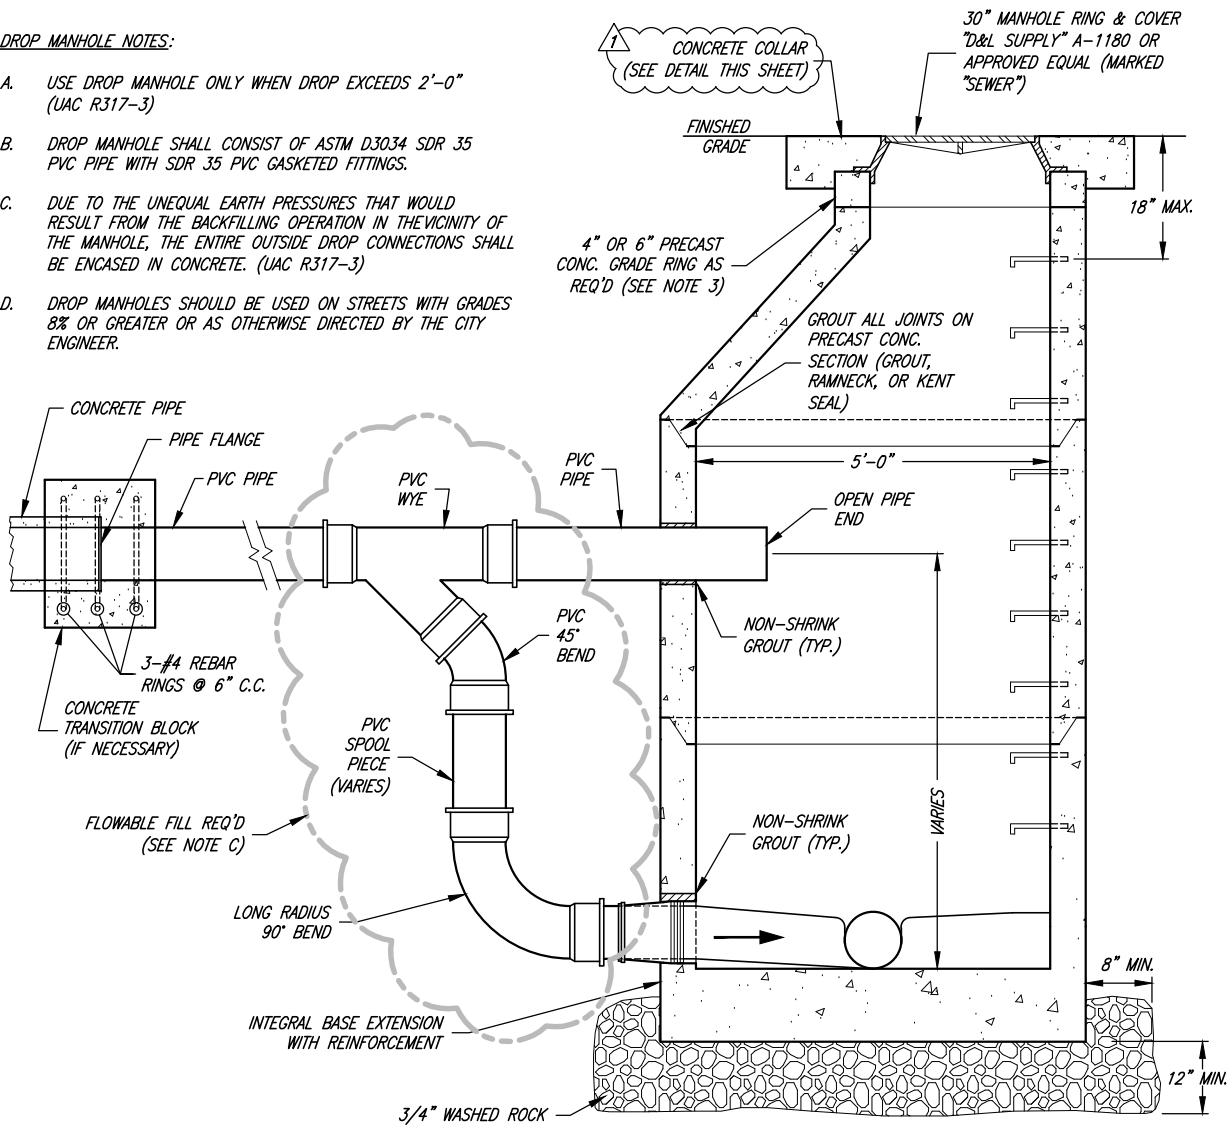


**TYPICAL DROP MANHOLE SECTION**

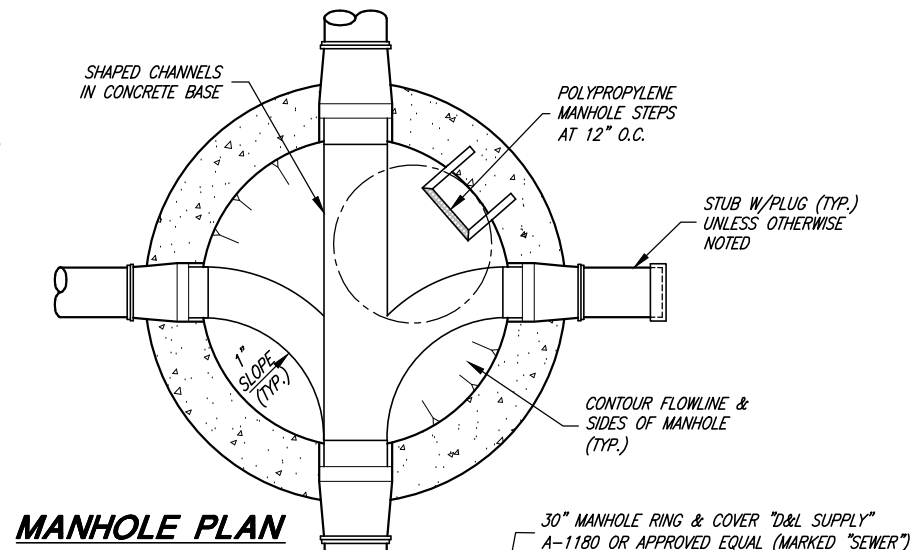

**MANHOLE PLAN**

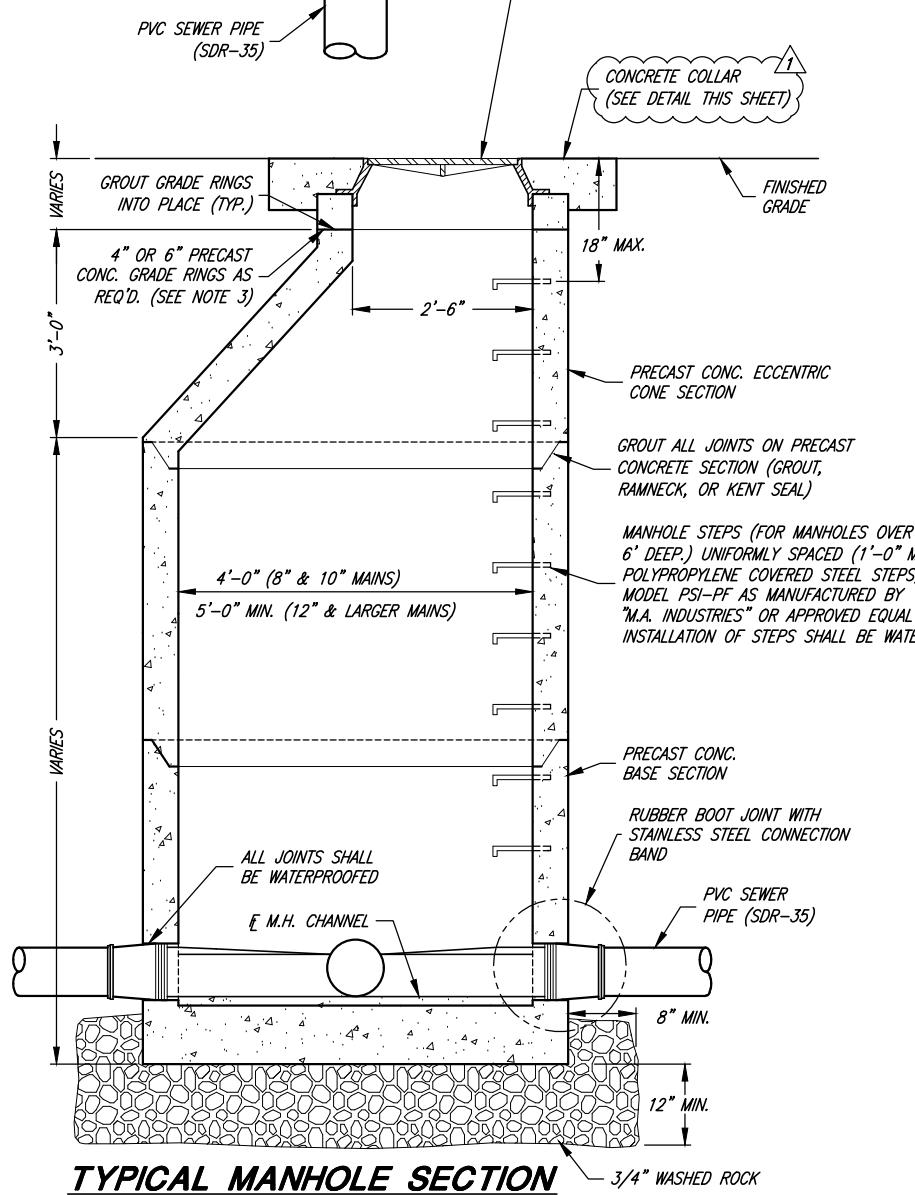

**TYPICAL MANHOLE SECTION**

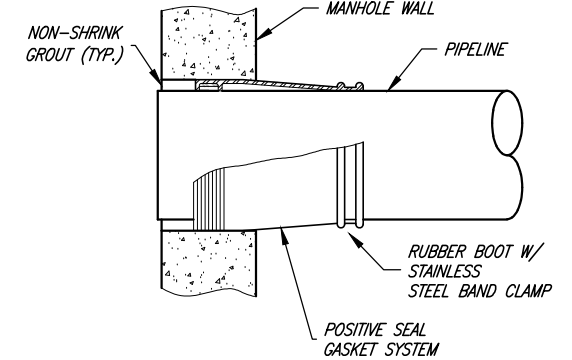

**RUBBER BOOT DETAIL**

**GENERAL NOTES:**

- 1. SECURE INVERTS IN ALL MANHOLES DURING CONSTRUCTION SO AS TO PREVENT GRAVEL AND OTHER DEBRIS FROM COLLECTING INSIDE.
- 2. A LARGER DIAMETER MANHOLE MAY BE REQUIRED BY THE DESIGN ENGINEER AFTER EVALUATION OF THE NUMBER, SIZE, AND ANGLE OF THE PIPES THAT CONNECT TO THE MANHOLE.
- 3. NO MORE THAN 12" OF GRADE RINGS TO BE ALLOWED ON ANY MANHOLE.
- 4. ALL TERMINATING SEWER MAINS SHALL END WITH A CITY STANDARD MANHOLE.
- 5. SERVICE LATERAL CONNECTIONS SHALL NOT BE ALLOWED IN SEWER MANHOLES.
- 6. ALL SANITARY SEWER LINES SHALL BE INSPECTED BY MEANS OF VIDEO CAMERA AND AIR TESTED WHEN CONSTRUCTED. SEE APWA 33 08 00 AND CITY MODIFICATIONS FOR MORE INFORMATION.
- 7. WHERE THE DIFFERENCE IN ELEVATION BETWEEN THE INCOMING SEWER AND MANHOLE INVERT IS LESS THAN 24 INCHES, THE INVERT SHOULD BE FILLETED.
- 8. FLAT MANHOLE RINGS & COVERS (SLAB CONSTRUCTION) ARE NOT ALLOWED ON ANY MANHOLE CONE SECTION.



BRANDON KENT JONES  
No. 5148758  
PROJECT ENGINEER  
2-12-2019  
DATE


REV.	DATE	APPR.	NOTES
1	JAN '19	BKJ	ADDED DETAIL; ADDED AND/OR MODIFIED NOTES

SCALE: N.T.S.  
DESIGNED: BKJ  
DRAWN: BEB  
CHECKED: BKJ

**JA CONSULTING ENGINEERS**  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
www.jonescivil.com


**SOUTH WEBER CITY CORPORATION**  
**PUBLIC WORKS STANDARDS**  
**SANITARY SEWER - TYPICAL MANHOLES & DETAILS**



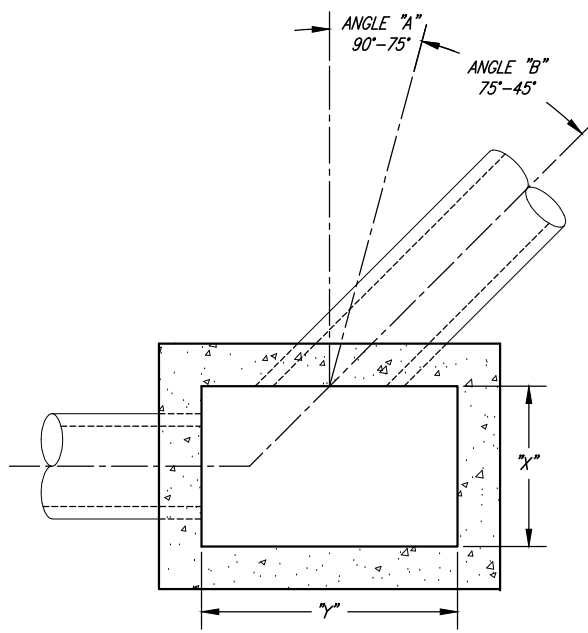




PIPE SIZE (IN.)	INLET BOX			"Z" MIN.
	"X"	"Y" (ANGLE A)	"Y" (ANGLE B)	
15	2'-6"	4'-0"	4'-0"	2'-0"
18	2'-6"	4'-0"	4'-0"	2'-6"
21	4'-0"	4'-0"	4'-0"	3'-0"
24	4'-0"	4'-0"	5'-0"	3'-0"
30	4'-0"	4'-0"	6'-0"	3'-6"
36	4'-0"	4'-0"	6'-0"	4'-0"
42	6'-0"	6'-0"	7'-0"	5'-0"
48	6'-0"	6'-0"	8'-0"	5'-6"

**GENERAL NOTE:**  
STORM DRAIN LINES SHALL BE 15 INCH MINIMUM DIAMETER REINFORCED CONCRETE PIPE (RCP), OF APPROPRIATE CLASS.

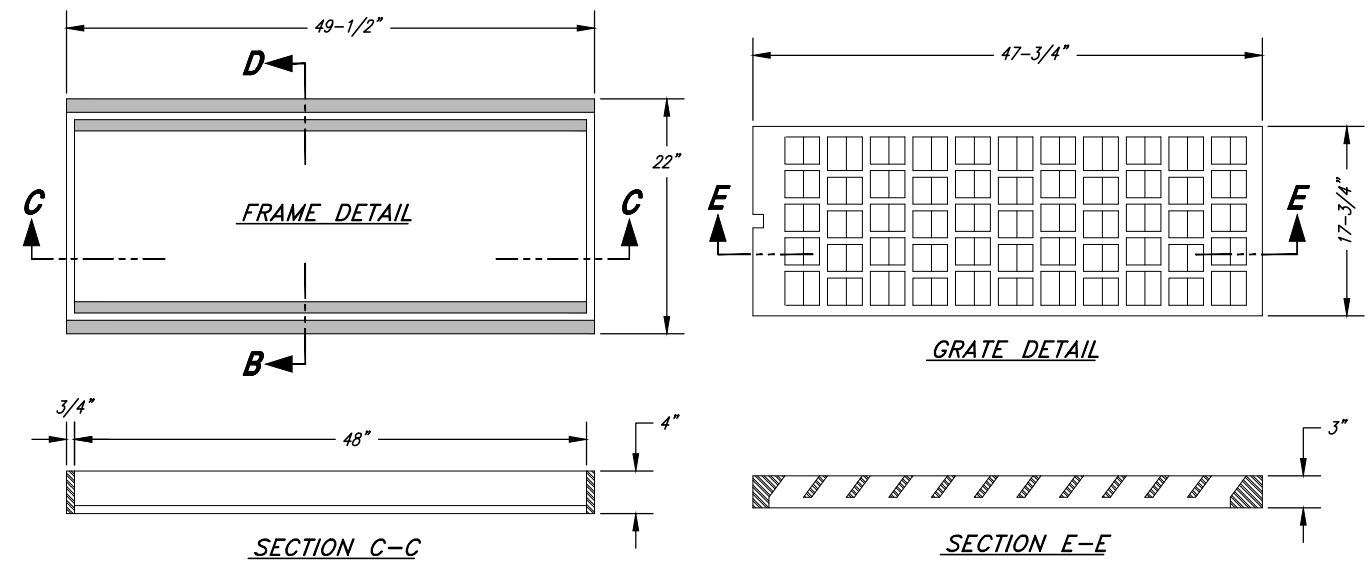


**FRAME & GRATE DETAILS**

- FRAME AND GRATE NOTES:**
- A1. GRATE AND FRAME SHALL BE AS MANUFACTURED BY "D&L SUPPLY" I-1803
  - B1. BICYCLE SAFE GRATE REQUIRED.
  - C1. "OR EQUAL" GRATES AND FRAMES WILL BE CONSIDERED AS APPROVED BY THE CITY ENGINEER.

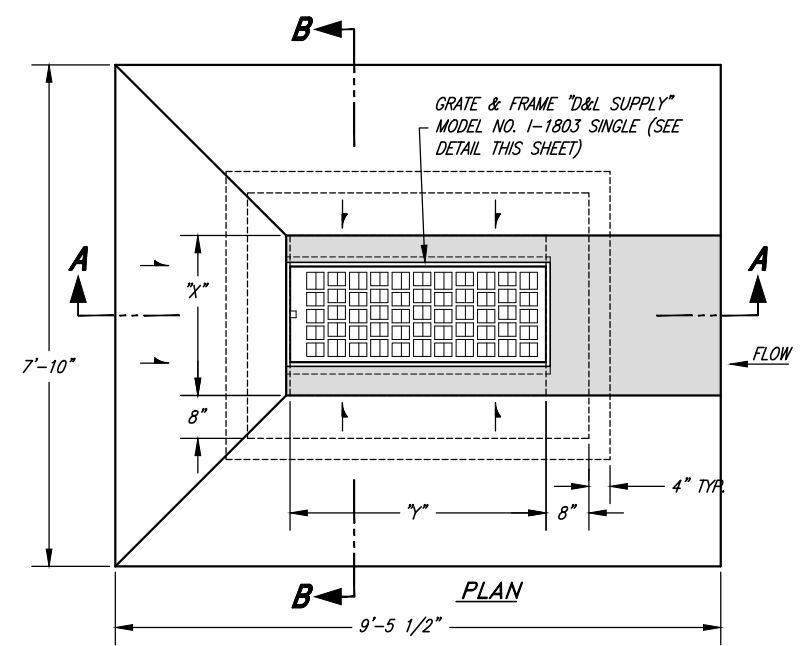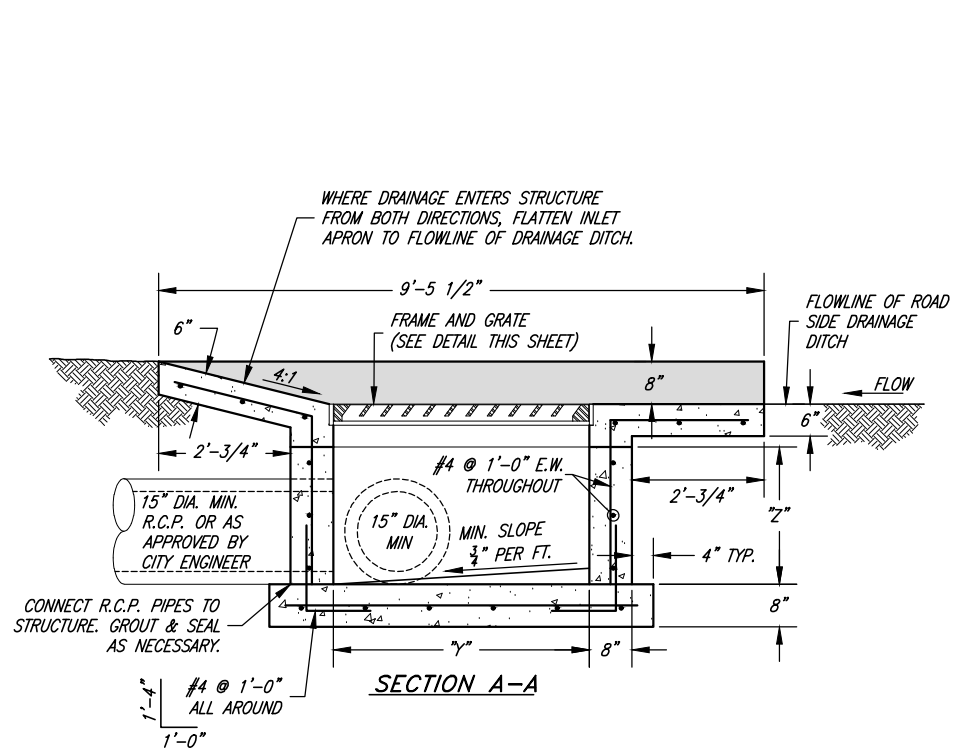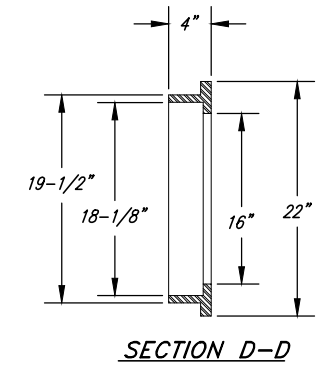

**DRAINAGE DITCH / PARKING LOT INLET BOX**

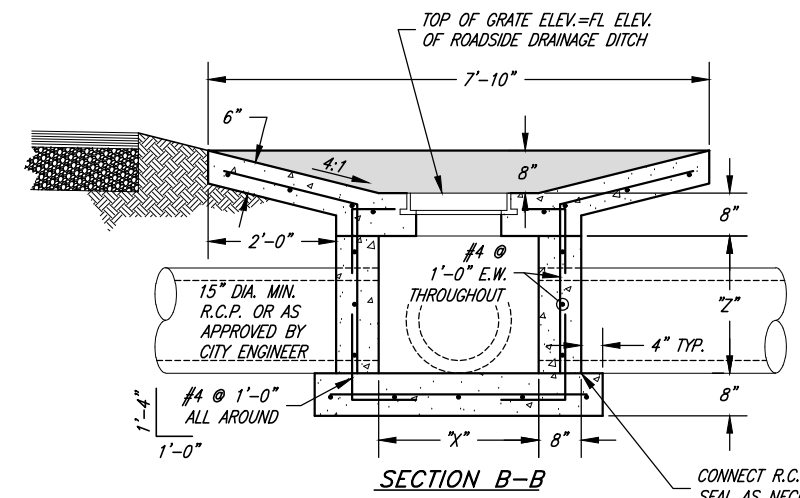

- DRAINAGE BOX NOTES:**
- 1. ALL BOX SIZES REFLECT DIMENSIONS FOR THE MINIMUM 15" PIPE SIZE. BOX DIMENSIONS MUST INCREASE PROPORTIONALLY TO ACCOMMODATE LARGER PIPE SIZES. (SEE TABLE THIS SHEET)
  - 2. CAST-IN-PLACE CONCRETE STRUCTURES CAN BE REPLACED WITH PRECAST CONCRETE STRUCTURES WITH HL-93 DECK LOADING AND COMPARABLE SIZE.
  - 3. ALL BOXES SHALL BE FORMED ON THE INSIDE AND OUTSIDE OF THE BOX AND INSPECTED BY THE CITY PRIOR TO THE PLACING OF CONCRETE.

REGISTERED PROFESSIONAL ENGINEER  
BRANDON KENT JONES  
No. 5148758  
State of Utah  
PROJECT ENGINEER  
2-12-2019  
DATE

REV.	DATE	APPR.

SCALE:  
N.T.S.  
DESIGNED BKJ  
DRAWN BEB  
CHECKED BKJ


**JA JONES & ASSOCIATES**  
CONSULTING ENGINEERS  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
www.jonescivil.com

**SOUTH WEBER CITY CORPORATION**  
PUBLIC WORKS STANDARDS  
**STORM DRAIN - DRAINAGE INLET BOX & GENERAL GRATE AND FRAME DETAILS**


SHEET:  
**CS-17**  
OF 24 SHEETS  
0






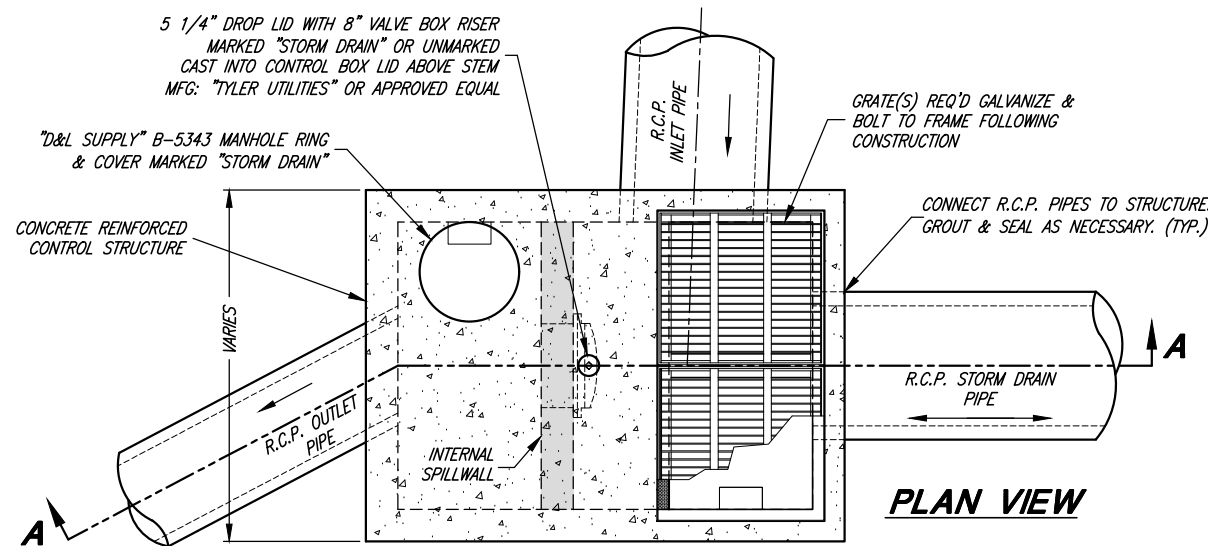


**DETENTION INLET/OUTLET CONTROL STRUCTURE**  
(PRECAST OR CAST-IN-PLACE)

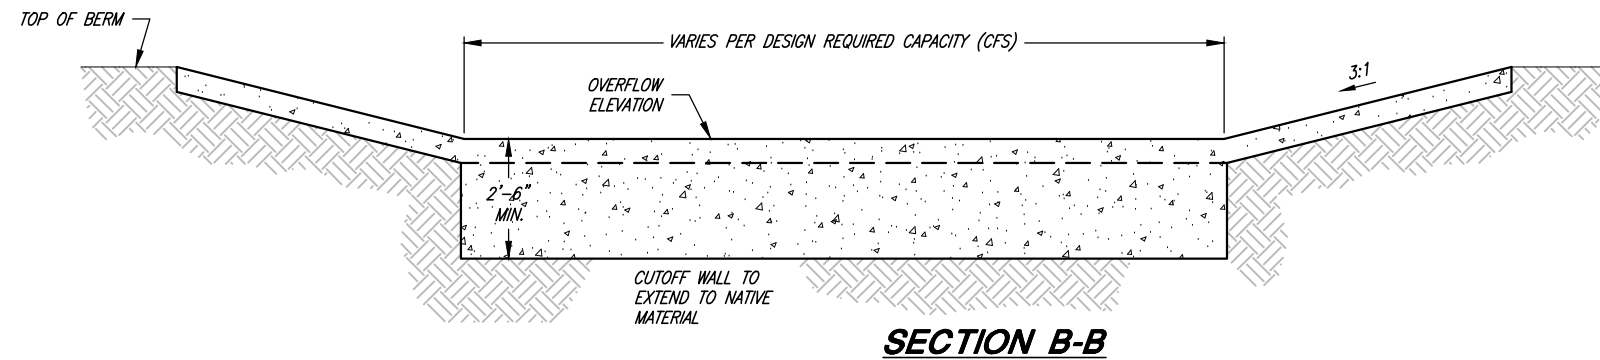


**SECTION B-B**

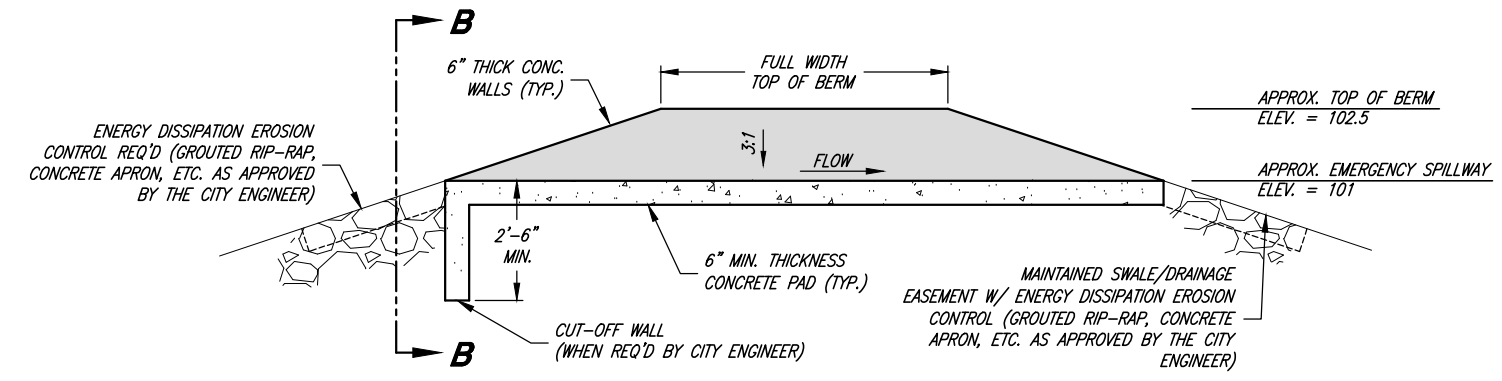

**EMERGENCY OVERFLOW**

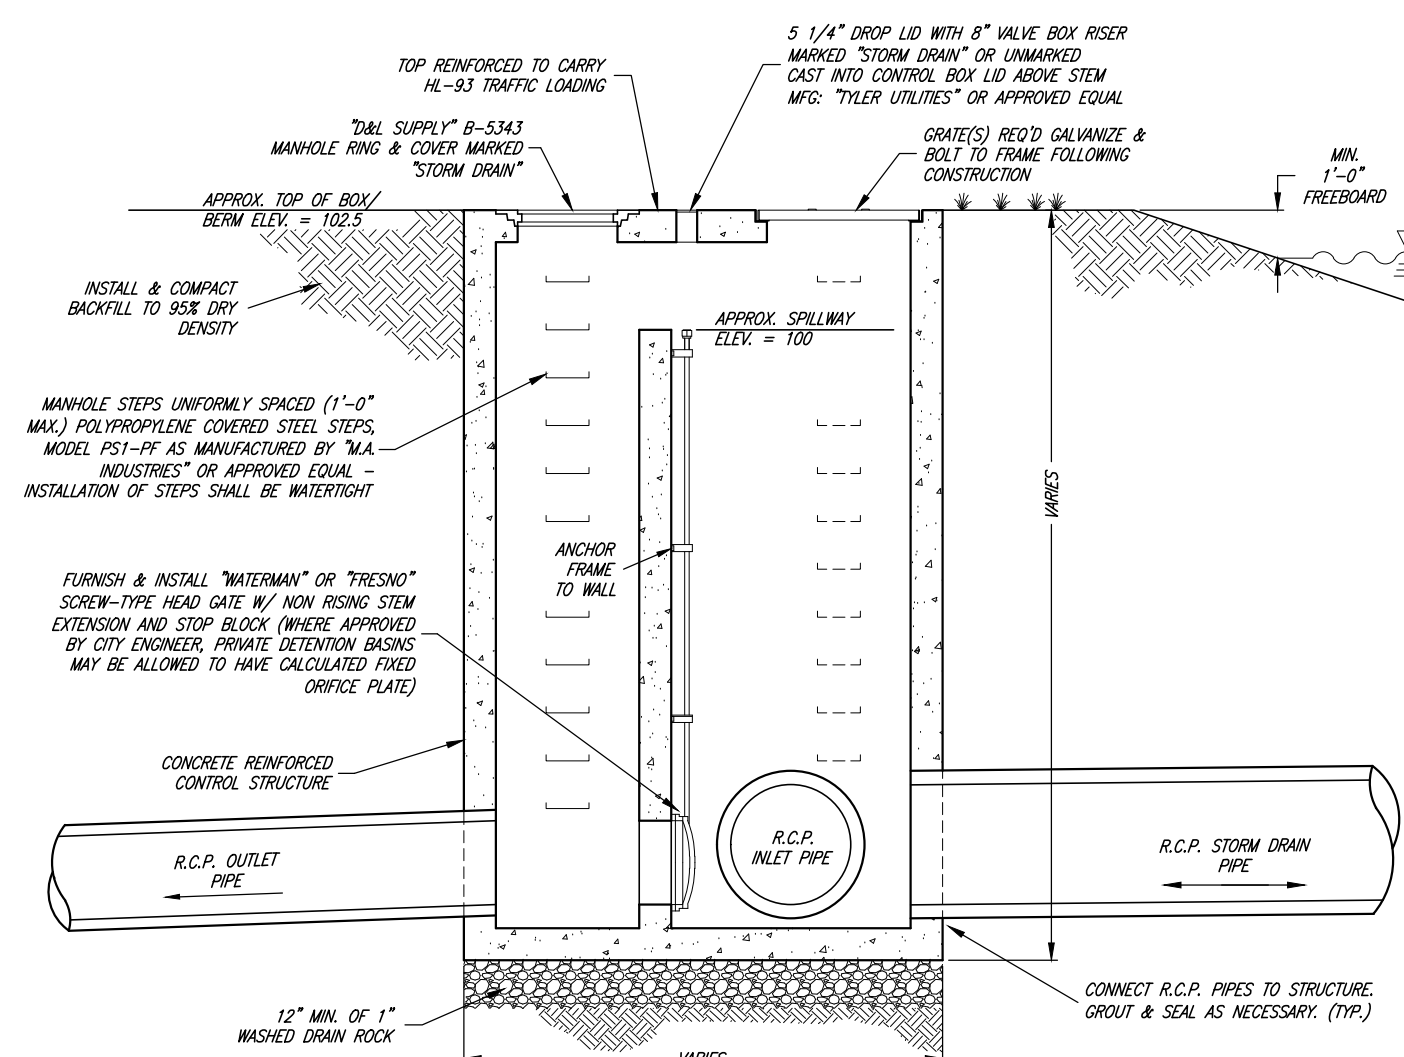

**SECTION A-A**

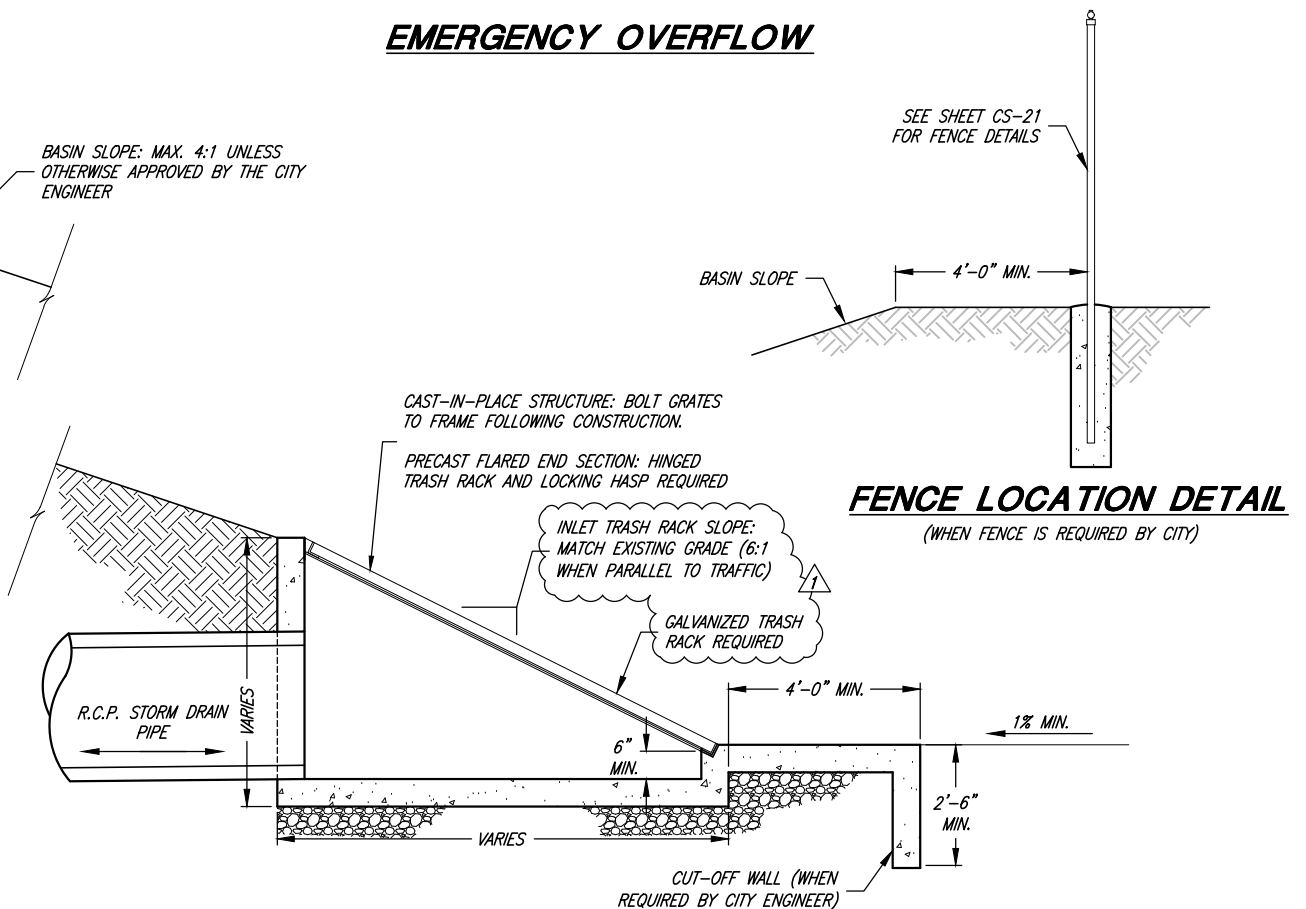

**INCLINED GRATE STORM DRAIN INLET**

**FENCE LOCATION DETAIL**  
(WHEN FENCE IS REQUIRED BY CITY)

GENERAL AND STRUCTURAL NOTES:  
SEE SHEET CS-20

REGISTERED PROFESSIONAL ENGINEER  
BRANDON KENT JONES  
No. 5148758  
State of Utah  
PROJECT ENGINEER  
2-12-2019  
DATE

REV.	DATE	APPR.	MODIFIED NOTES
1	JAN '19	BKJ	MODIFIED NOTES


SCALE:  
N.T.S.

DESIGNED: BKJ  
DRAWN: BEB  
CHECKED: BKJ


**JA JONES & ASSOCIATES**  
CONSULTING ENGINEERS  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
www.jonescivil.com

**SOUTH WEBER CITY CORPORATION**  
PUBLIC WORKS STANDARDS  
**STORM DRAIN - LARGE DETENTION BASIN DETAILS**

SHEET:  
**CS-19**  
OF 24 SHEETS  
0

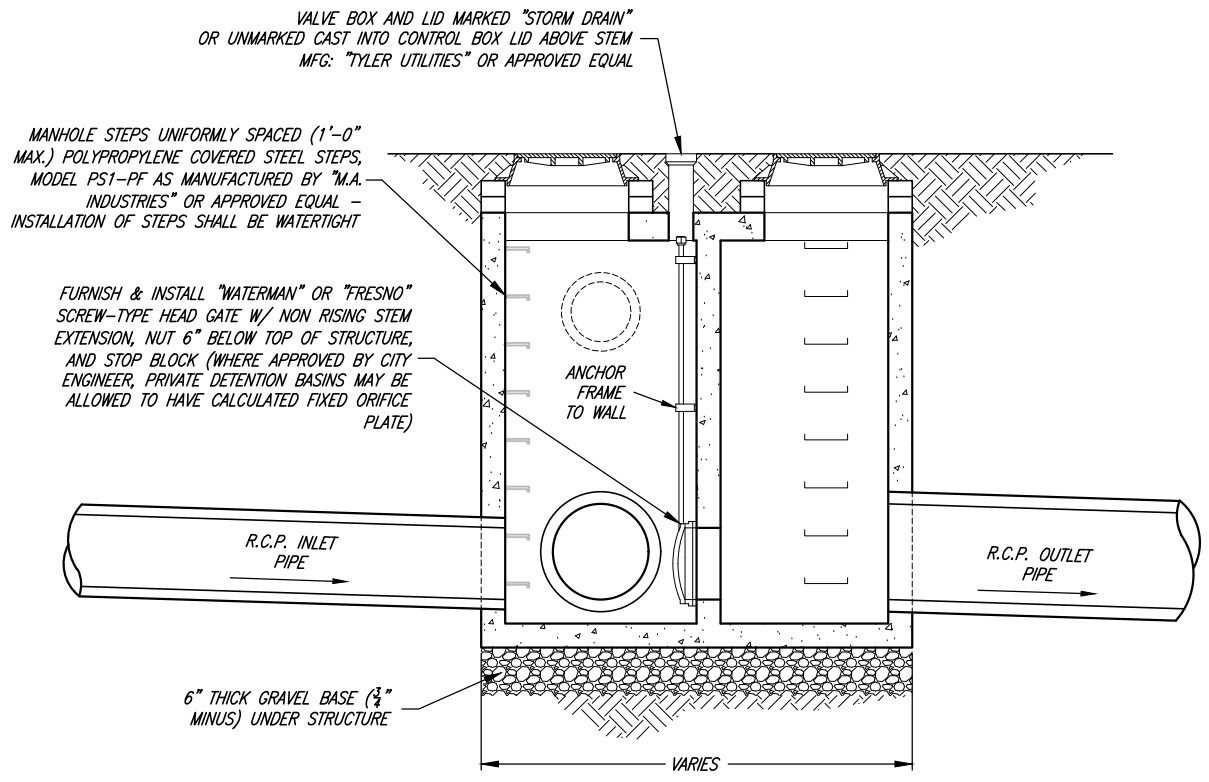


**SECTION B-B**

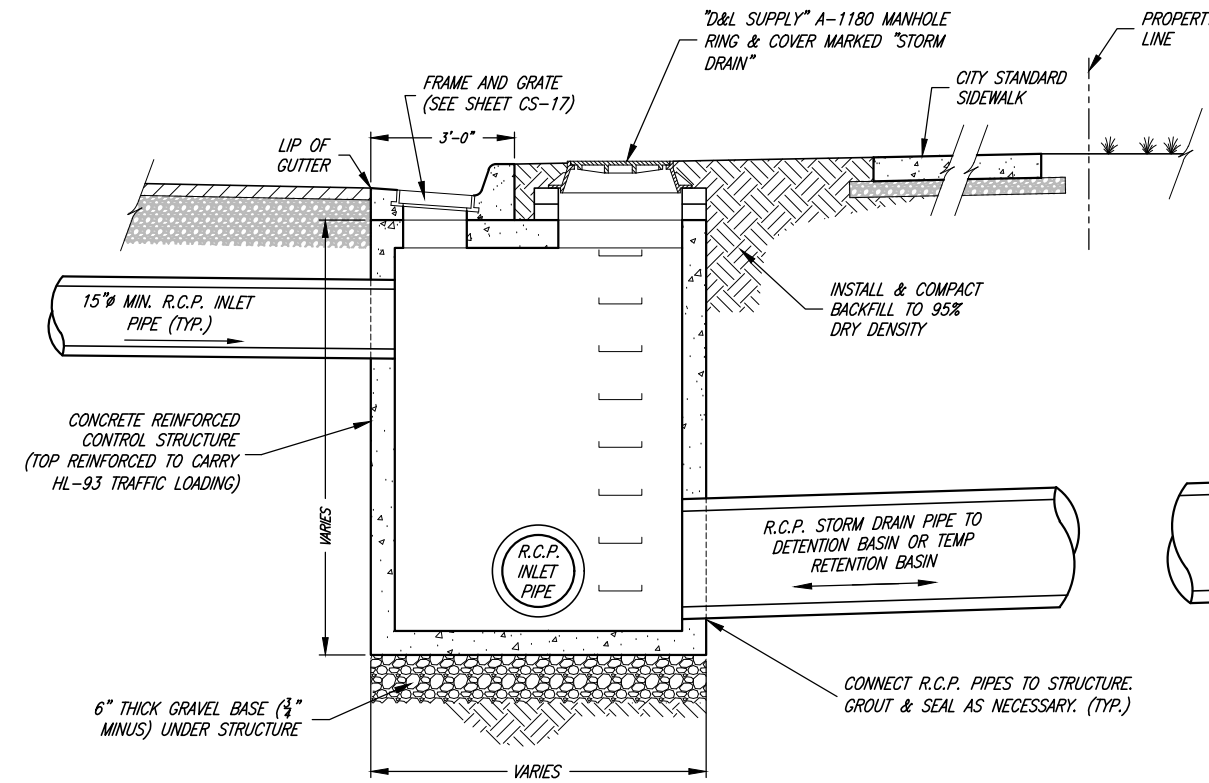

**SECTION A-A**

- GENERAL NOTES:**
1. ALL BASINS REGARDLESS OF LOCAL OR REGIONAL SHALL BE DESIGNED TO ACCOMMODATE A 100 YEAR STORM EVENT.
  2. A DAM SAFETY (UTAH DIVISION OF WATER RIGHTS) HAZARD PERMIT MAY BE REQUIRED.
  3. STRUCTURE DESIGN AND FLOW CALCULATIONS MUST BE APPROVED BY CITY ENGINEER PRIOR TO CONSTRUCTION.
  4. STORM DRAIN LINES SHALL BE 15 INCH MINIMUM DIAMETER REINFORCED CONCRETE PIPE (RCP), OF APPROPRIATE CLASS.
  5. THE SURFACE AREA OF THE BASIN SHALL BE SODDED AND SHALL BE PROVIDED WITH AN AUTOMATED SPRINKLER SYSTEM APPROVED BY THE CITY ENGINEER.
  6. GRATES SHALL BE REMOVABLE FOR MAINTENANCE PURPOSES
  7. GRATES SHALL BE HOT DIPPED GALVANIZED WITH BARS AT MAXIMUM 3 INCH SPACING.
  8. LOW FLOWS MUST BE PIPED CONTINUOUSLY TO THE CONTROL STRUCTURE. NO OPEN FLOW IS PERMITTED THROUGH THE BASIN.
  9. INCLINED GRATES ARE REQUIRED ON ALL PIPES/INLETS WHERE OPEN CHANNELS, DITCHES, OR PONDS DISCHARGE DIRECTLY INTO THE STORM DRAIN SYSTEM.
  10. AN INTERNAL SPILLWAY MAY BE CONSTRUCTED INSIDE THE STRUCTURE DEPENDING ON SITE CONDITIONS AND ELEVATIONS.
  11. BASIN STRUCTURES ARE DETERMINED BY THE SIZE OF THE DETENTION BASIN OR AS REQUIRED BY THE CITY ENGINEER. (SEE SHEET CS-19 OR CS-20)
    - a. SMALL DETENTION BASIN: LESS THAN OR EQUAL TO 1 ACRE FOOT
    - b. LARGE DETENTION BASIN: GREATER THAN 1 ACRE FOOT

- STRUCTURAL NOTES:**
- A. PRECAST CONCRETE STRUCTURE CAN BE REPLACED WITH CAST-IN-PLACE CONCRETE VAULT. SUBMIT ENGINEERED CONSTRUCTION PLANS WITH REBAR DETAILS TO CITY ENGINEER FOR REVIEW AND ACCEPTANCE PRIOR TO CONSTRUCTION.
  - B. ADD REINFORCEMENT AROUND OPENINGS EQUAL TO REINFORCEMENT DISPLACED BY OPENING.
  - C. THE PRECAST VAULT MANUFACTURER IS RESPONSIBLE FOR DESIGN RELATED TO TRAFFIC LOADING AND THRUST. VERIFICATION OF PROPER DESIGN MUST BE PROVIDED TO THE CITY BY THE DEVELOPER, CONTRACTOR, OR PROPERTY OWNER AS THE CASE MAY BE.
  - D. REINFORCEMENT TO CONFORM WITH ASTM A 615 GRADE 60
  - E. CONCRETE SHALL HAVE A 28-DAY COMPRESSIVE STRENGTH OF 5,000 PSI
  - F. USE AN AIR-ENTRAINING AGENT ON ALL CONCRETE EXPOSED TO THE WEATHER.
  - G. HL-93 LOADING

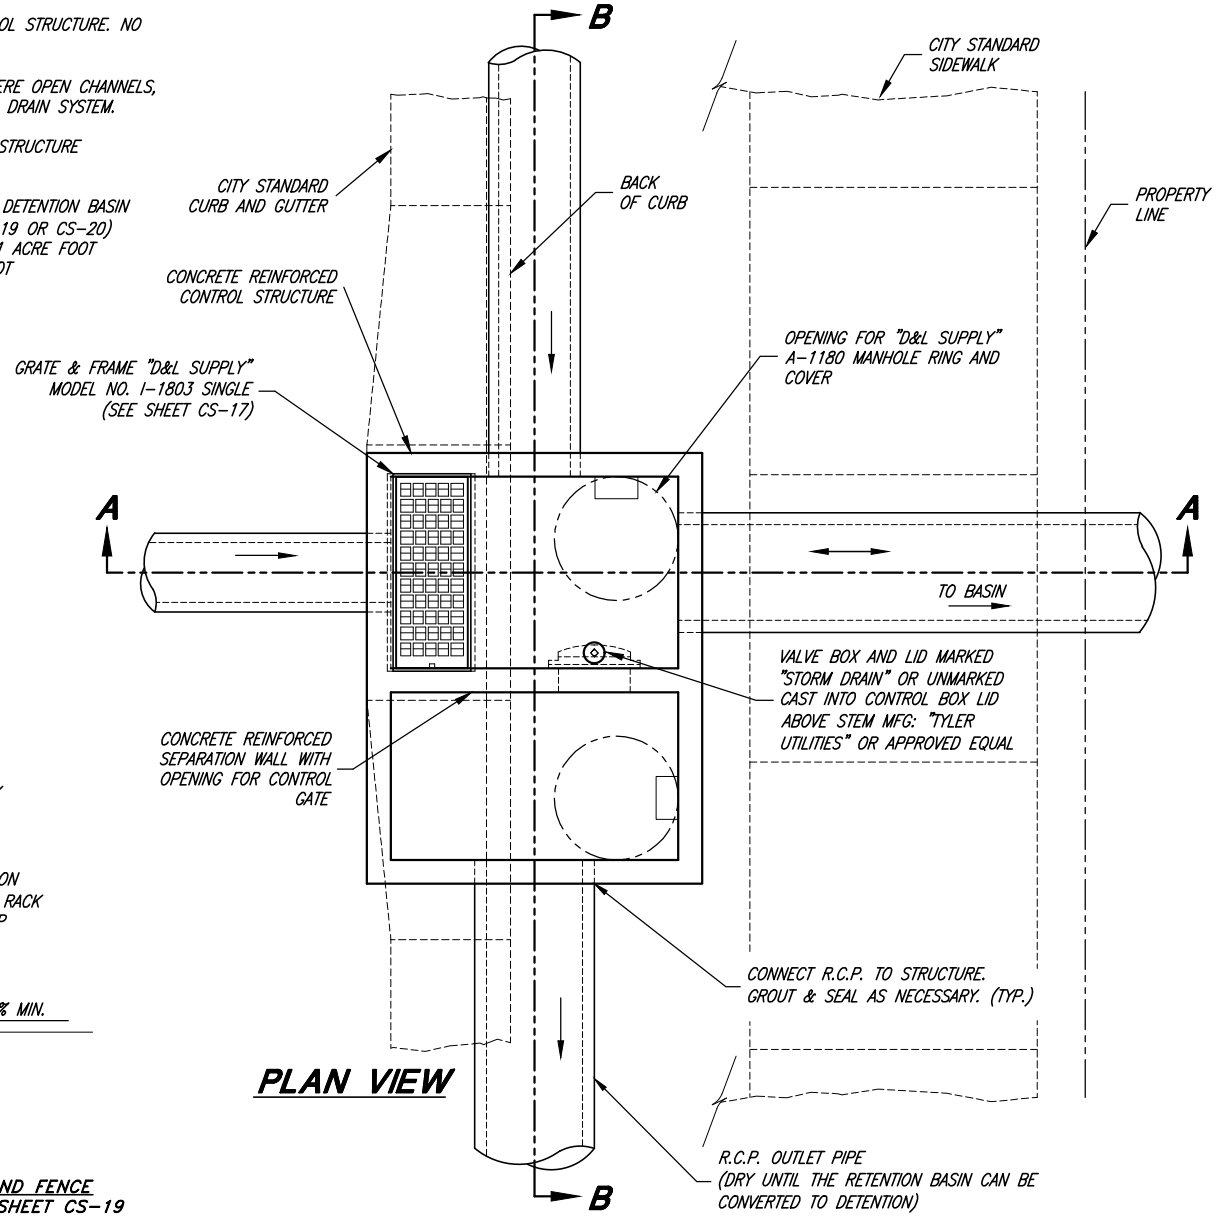

**PLAN VIEW**

**INLET/OUTLET CONTROL STRUCTURE**

(PRECAST OR CAST-IN-PLACE)

REGISTERED PROFESSIONAL ENGINEER  
 BRANDON KENT JONES  
 No. 5148758  
 State of Utah  
 PROJECT ENGINEER  
 DATE 2-12-2019


REV.	DATE	APPR.

SCALE:  
 N.T.S.  
 DESIGNED BKJ  
 DRAWN BEB  
 CHECKED BKJ


**JA JONES & ASSOCIATES**  
 CONSULTING ENGINEERS  
 6080 Fashion Point Drive  
 South Ogden, Utah 84403 (801) 476-9767  
 www.jonescivil.com

**SOUTH WEBER CITY CORPORATION**  
**PUBLIC WORKS STANDARDS**  
**STORM DRAIN - SMALL DETENTION BASIN DETAILS**


SHEET:  
**CS-20**  
 OF 24 SHEETS  
 0

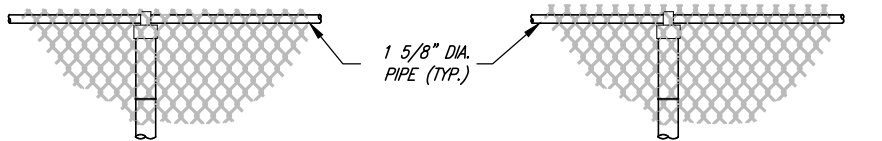


**KNUCKLED SELVAGE  
TYPE I**

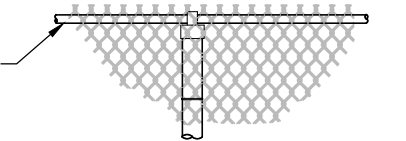


**TWISTED & BARBED SELVAGE  
TYPE II**

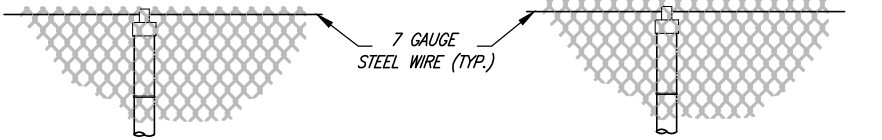


**KNUCKLED SELVAGE  
W/ TENSION WIRE  
TYPE III**

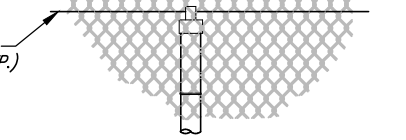


**TWISTED & BARBED  
SELVAGE W/ TENSION WIRE  
TYPE IV**

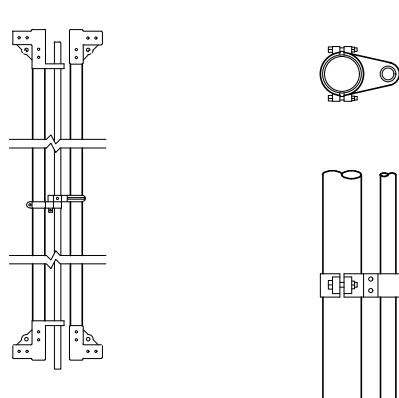

**DROP ROD  
ASSEMBLY**




**TOP GATE HINGE**

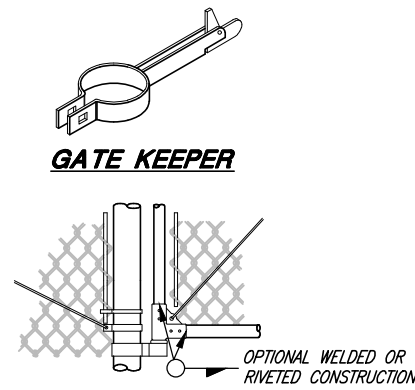


**GATE KEEPER**


**BOTTOM GATE HINGE  
AND GATE DETAIL**

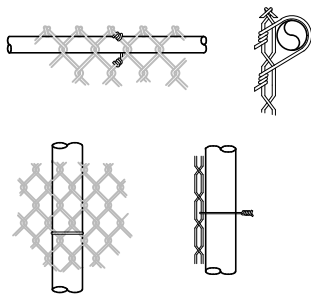


**PIPE POST TIE**

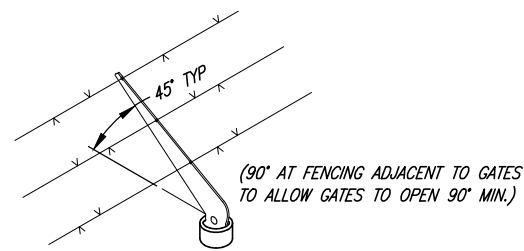


**COMBINATION CAP AND  
BARBED WIRE SUPPORTING ARM**

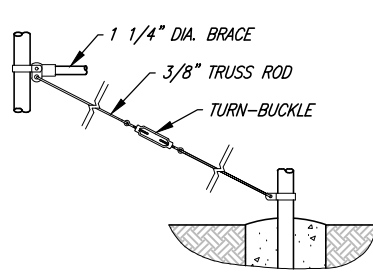

**BRACE & TRUSS CONNECTIONS**



**CENTER GATE STOP  
AND GATE DETAIL**

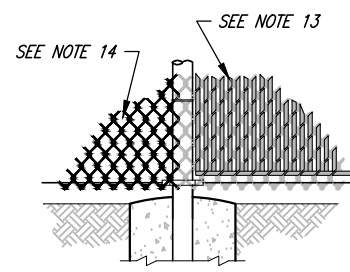


**SLATS & VINYL  
COATING DETAIL**

**GENERAL NOTES:**

1. MATERIALS, CONSTRUCTION, AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH PROJECT STANDARD SPECIFICATIONS.
2. THE TYPE OF TOP SUPPORT IS SPECIFIED IN THE BIDDING SCHEDULE, TYPES I AND II TUBULAR RAIL, TYPES III AND IV TENSION WIRE.
3. BARB WIRE SHALL BE USED ONLY WHEN DESIGNATED ON THE PLANS OR IN THE SPECIFICATIONS.
4. TWISTED AND BARBED SELVAGE TOP AND BOTTOM SHALL BE USED ON FENCES 5- FEET HIGH OR GREATER.
5. KNUCKLED SELVAGE ON TOP AND TWISTED AND BARBED ON BOTTOM SHALL BE USED ON FENCES LESS THAN 5- FEET.
6. ALL STEEL PIPE MEMBERS SHALL CONFORM TO ASTM A53 HOT DIPPED ZINC COATED HIGH TENSILE STEEL PIPE.
7. POSTS SHALL BE SCHEDULE 40 PIPE.
8. LINE POSTS SHALL BE LOCATED AT EQUAL SPACING FOR EACH SEGMENT WITH A MAXIMUM SPACING AS FOLLOWS:
  - a. TANGENT SECTIONS TO 500-FOOT RADIUS NOT MORE THAN 8- FEET.
  - b. UNDER 500-FOOT RADIUS TO 200-FOOT RADIUS NOT MORE THAN 8- FEET.
  - c. UNDER 200-FOOT RADIUS TO 100-FOOT RADIUS NOT MORE THAN 6- FEET.
  - d. UNDER 100-FOOT RADIUS NOT MORE THAN 5- FEET.
9. TRUSS RODS AND BRACES SHALL NOT BE REQUIRED FOR FABRIC HEIGHT LESS THAN 5- FEET.
10. TENSION WIRE SHALL BE 7 GAUGE ZINC- OR ALUMINUM- COATED COIL SPRING STEEL TENSION WIRE.
11. ALL POSTS SHALL BE SET IN 3000 PSI CONCRETE AND SHALL BE TOPPED WITH BALL TYPE OR OTHER APPROVED ORNAMENT.
12. ALL FABRIC SHALL BE 2" GALVANIZED 9 GAUGE MESH.
13. WHITE VERTICAL SEMI-PRIVACY VINYL SLATS WITH BOTTOM-LOCKING SLAT, WHEN REQUIRED BY THE CITY.
14. BLACK VINYL COATED CHAINLINK FENCING WHEN REQUIRED BY THE CITY.
15. ALL FENCING SHALL CONFORM TO LOCATION AND HEIGHT LIMITATIONS AS STATED IN SOUTH WEBER CITY FENCING ORDINANCE.

HEIGHT	GATE OPENING	GATE POST	GATE FRAME
UNDER 6 FEET	SINGLE TO 6' OR DOUBLE TO 12'	2"	1"
	SINGLE OVER 6' TO 8' OR DOUBLE OVER 12' TO 16'	2 1/2"	
	SINGLE OVER 8' TO 12' OR DOUBLE 16' TO 24'	4"	1 1/2"
6 FEET AND OVER	SINGLE TO 6' OR DOUBLE TO 12'	3 1/2"	
	SINGLE OVER 6' TO 12' OR DOUBLE OVER 12' TO 24'	4"	1 1/2"
	SINGLE OVER 12' TO 18' OR DOUBLE OVER 24' TO 36'	6"	
	SINGLE OVER 18' OR DOUBLE OVER 36'	8"	

HEIGHT OF FABRIC	DEPTH OF POSTS	LENGTH OF END, CORNER OR PULL POST	LENGTH OF LINE POST	SIZE OF POSTS	
				END, CORNER, & PULL POSTS	LINE POST
				NOM. SIZE	NOM. SIZE
7'	3'	10'	9'-8"	2 1/2"	2"
6'	3'	9'	8'-8"	2 1/2"	2"
5'	3'	8'	7'-8"	2"	1 1/2"
4'	3'	6'	5'-8"	2"	1 1/2"
3'	3'	5'	4'-8"	2"	1 1/2"

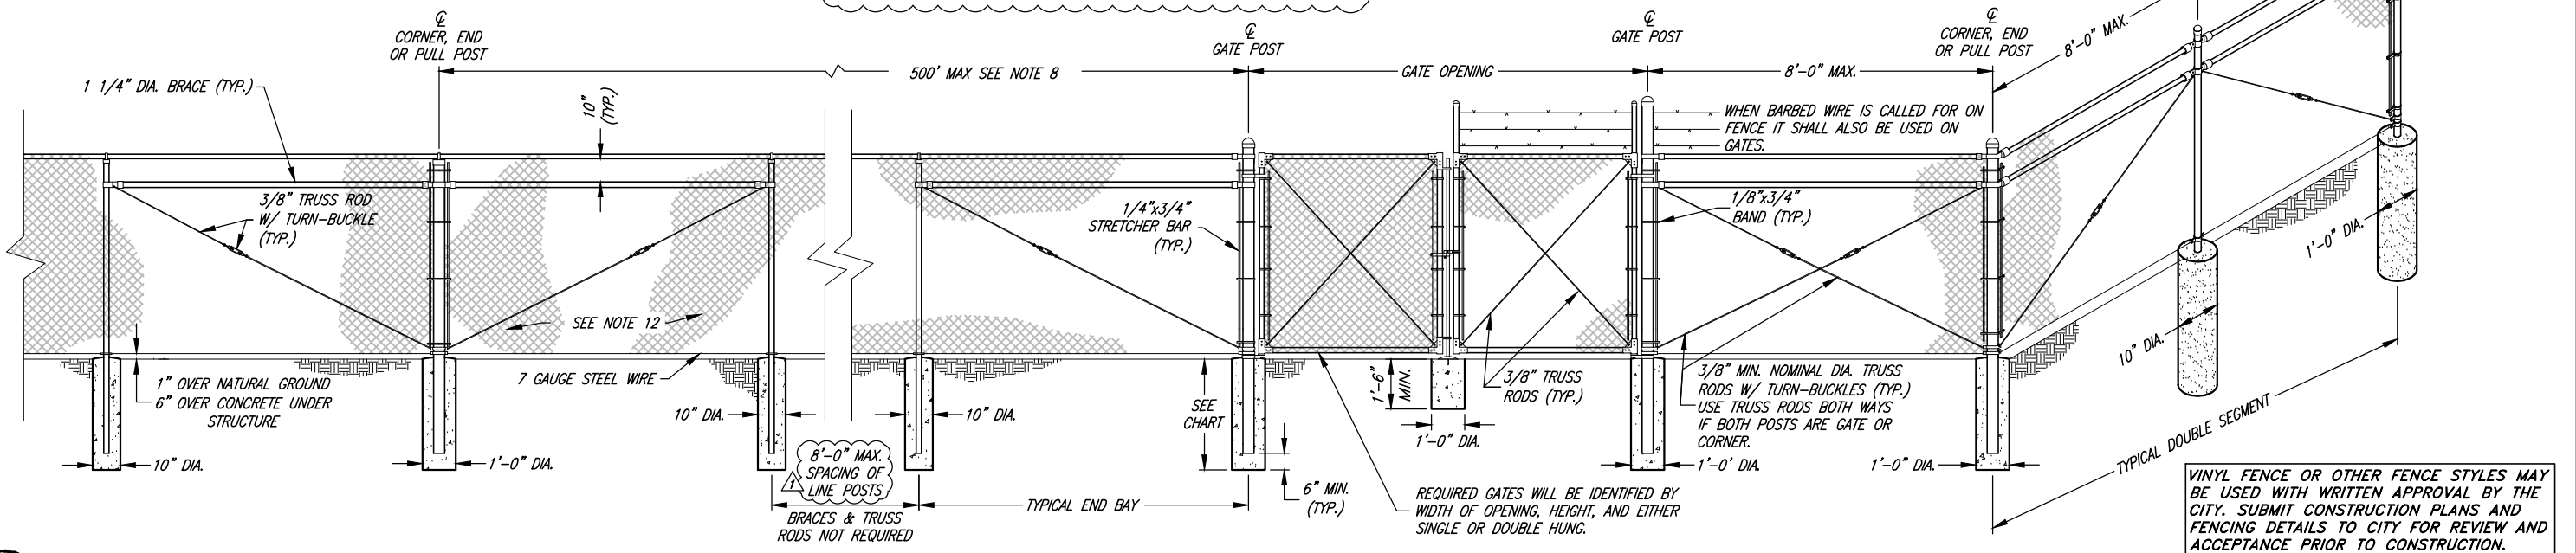

VINYL FENCE OR OTHER FENCE STYLES MAY BE USED WITH WRITTEN APPROVAL BY THE CITY. SUBMIT CONSTRUCTION PLANS AND FENCING DETAILS TO CITY FOR REVIEW AND ACCEPTANCE PRIOR TO CONSTRUCTION.

REGISTERED PROFESSIONAL ENGINEER  
BRANDON KENT JONES  
No. 5148758  
State of Utah  
PROJECT ENGINEER  
DATE 2-12-2019

REV.	DATE	APPR.	DESCRIPTION
1	JAN '19	BKJ	ADDED DIMENSION; MODIFIED TABLE & NOTES.

SCALE: N.T.S.  
DESIGNED: BKJ  
DRAWN: BEB  
CHECKED: BKJ

**JA JONES & ASSOCIATES**  
CONSULTING ENGINEERS  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
www.jonescivil.com

**SOUTH WEBER CITY CORPORATION**  
PUBLIC WORKS STANDARDS  
**GENERAL - CHAIN LINK FENCE DETAILS**

SHEET:  
**CS-21**  
OF 24 SHEETS  
0

## STREETLIGHT STYLES AND LOCATIONS

### RESIDENTIAL (SL-1):

- FIXTURE STYLE: LAMP POST
- POLE HEIGHT: 14 FEET
- SPACING: MAXIMUM 400 FEET, ON ALTERNATING SIDES OF THE STREET
- LOCATION: CUL-DE-SACS, MID-BLOCK, AND MINOR INTERSECTIONS (WHEN APPROVED)

### INTERSECTION (SL-2):

- FIXTURE STYLE: OVERHEAD WITH STRAIGHT DECORATIVE MAST ARM
- POLE HEIGHT: 18 FEET
- SPACING: INTERSECTIONS
- LOCATION: INTERSECTIONS AND PARKING LOTS (OR AS OTHERWISE DIRECTED)

### CORRIDOR (SL-3):

- FIXTURE STYLE: OVERHEAD WITH CURVED DECORATIVE MAST ARM
- POLE HEIGHT: 18 FEET
- SPACING: MAXIMUM 300 FEET, ON ALTERNATING SIDES OF THE STREET
- LOCATION: ALONG THE SOUTH WEBER DRIVE AND SOUTH BENCH DRIVE CORRIDORS (OR AS OTHERWISE DIRECTED)
- ADDITION DECORATIVE FEATURES: BANNER POLES, FLOWER BASKETS, ETC. (AS APPROVED)

## STREETLIGHT REQUIREMENTS

### POLES:

1. ALL POLES MUST BE SEMI-GLOSS BLACK
2. ALL POLES MUST BE THE SAME DIAMETER (NON-TAPERED), BUT HEIGHT VARIES AS STATED ABOVE
3. ALL POLES MUST BE MOUNTED TO A CONCRETE FOOTING PER MANUFACTURER RECOMMENDATIONS
4. ANCHOR BOLTS MUST NOT CONFLICT WITH THE BASE
5. INTERSECTION AND CORRIDOR POLES MUST HAVE A GFCI LOCATED 2 FEET BELOW THE TOP OF THE POLE

### BASES:


6. ALL BASES MUST BE SEMI-GLOSS BLACK
7. ALL BASES MUST BE THE SAME STYLE AND SIZE
8. ALL BASES MUST BE TWO-PIECE CAST ALUMINUM
9. ALL BASES MUST CONTAIN THE CITY NAME IN SANDED ALUMINUM TEXT, AS APPROVED BY THE CITY
10. ALL BASES MUST HAVE A HANDHOLE WITH COVER

### LIGHT FIXTURE:

11. ALL STREETLIGHT FIXTURES MUST BE LED
12. ALL STREETLIGHT FIXTURES MUST BE FULLY DARK-SKY COMPLIANT

### GENERAL NOTES:

13. THE COST OF ALL NEW DEVELOPMENT STREETLIGHTS IS THE RESPONSIBILITY OF THE DEVELOPER, AND IS PAID DIRECTLY TO THE CITY, PRIOR TO THE RECORDING OF THE PLAT
14. THE CITY IS RESPONSIBLE FOR INSTALLATION OF ALL STREETLIGHTS
15. THE DEVELOPER IS RESPONSIBLE TO PROVIDE ALL POWER INFRASTRUCTURE FOR THE DEVELOPMENT, INCLUDING COORDINATION WITH THE POWER COMPANY FOR CONNECTION AND SERVICE TO THE PROPOSED STREETLIGHTS
16. ALL PROPOSED STREETLIGHT TYPES AND LOCATIONS MUST BE SHOWN ON THE APPROVED IMPROVEMENT PLANS
17. THE JUNCTION BOX MUST BE FLUSH TO GRADE AND LOCATED WITHIN A MINIMUM OF 4' AND MAXIMUM OF 10' FROM THE BASE OF THE POLE
18. FOR SAFETY PURPOSES, STREETLIGHTS MUST CONTAIN BREAK-AWAY STYLE FEATURES
19. ALL STREETLIGHTS MUST BE DESIGNED TO MEET ALL BUILDING CODE STRUCTURAL REQUIREMENTS
20. ALL STREETLIGHTS SHOULD BE LOCATED ON LOT LINES WHEN NOT LOCATED AT AN INTERSECTION
21. ALL STREETLIGHTS SHOULD BE LOCATED 2.5 FEET BEHIND THE BACK OF CURB OR BACK OF SIDEWALK

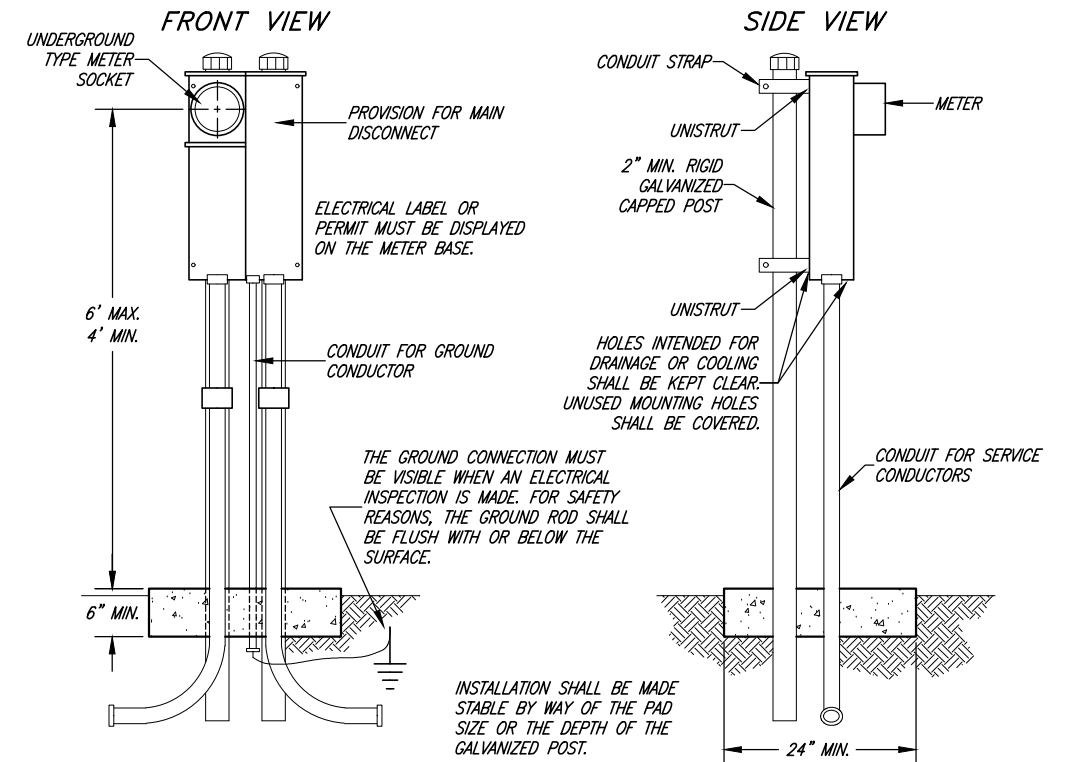

## UNDERGROUND SERVICE TO A FREE-STANDING METER BASE

(STEEL POLE)

INSTALLATION PER ROCKY MOUNTAIN POWER ELECTRIC SERVICE REQUIREMENTS MANUAL

### DEVELOPER/CONTRACTOR WILL FURNISH AND INSTALL:

- A. METER SOCKET ENCLOSURE (UNDERGROUND TYPE WITH MANUAL-LINK BYPASS)
- B. PEDESTAL HARDWARE
- C. CONDUIT
- D. RIGHT-OF-WAY OR EASEMENT
- E. TRENCH EXCAVATION AND BACKFILL
- F. GROUNDING PER NEC
- G. CONCRETE PAD 24" x 24" x 6" DEPTH
- H. LONG RADIUS SWEEP
- I. 36" SWEEP

### FREE-STANDING METER BASE REQUIREMENTS:

- A1. THE DEVELOPER/CONTRACTOR SHALL MEET WITH THE POWER COMPANY TO DETERMINE THE LOCATION OF THE FREE-STANDING METER BASE.
- B1. THE FREE-STANDING METER BASE SHALL BE LOCATED ADJACENT TO, OR IN, THE POWER COMPANY EASEMENT.
- C1. THE FREE-STANDING METER BASE SHALL MEET ALL LOCAL ORDINANCE REQUIREMENTS.
- D1. THE METER SOCKET SHALL BE PROTECTED FROM DAMAGE BY USE OF BARRIER POSTS OR OTHER SUITABLE PROTECTION APPROVED BY THE POWER COMPANY.
- E1. THE DEVELOPER/CONTRACTOR SHALL FURNISH, INSTALL AND MAINTAIN AN APPROVED PEDESTAL OR POLE POST.
- F1. THE ACCESS DOOR TO POWER COMPANY CONNECTIONS SHALL BE KEPT FREE OF OBSTRUCTIONS A MINIMUM OF 6" ABOVE THE FINAL GRADE, WITH A SEALABLE PROVISION FOR THE POWER COMPANY.
- G1. THE UNMETERED SERVICE CONDUCTOR AND THE METERED SERVICE CONDUCTOR SHALL NOT BE RUN IN THE SAME CONDUIT, RACEWAY, OR GUTTER.
- H1. THE METER SOCKET AND SERVICE EQUIPMENT SHALL BE NEMA TYPE 3R (RAINPROOF), IN GOOD CONDITION WITH NO HOLES, DENTS OR DAMAGE, AND PLUMB IN ALL DIRECTIONS. THE INSTALLATION SHALL BE MADE WITH SUFFICIENT MATERIALS AND INSTALLED SUCH THAT IT REMAINS PLUMB FOR THE DURATION OF THE SERVICE.
- I1. CONDUIT AND CONDUCTOR TRENCHERS SHALL BE LOCATED AWAY FROM (AND NEVER UNDERNEATH) THE PAD AND FOUNDATION. FOR MOBILE HOMES, TRENCHES SHALL BE LOCATED CLEAR OF THE AREA PROVIDED FOR THE DWELLING.
- J1. WHERE TWO OR MORE METERS ARE LOCATED SIDE-BY-SIDE (SUCH AS WITH DUPLEXES OR IN MOBILE HOME PARKS), THE METER SOCKET ENCLOSURE SHALL BE PERMANENTLY LABELED WITH THE SPACE OR BERTH NUMBERS.



BRANDON KENT JONES  
No. 5148758  
PROJECT ENGINEER  
DATE 2-12-2019

REV.	DATE	APPR.	DESCRIPTION
1	JAN '19	BKJ	DELETED EX. LIGHT DETAILS; UPDATED STREETLIGHT NOTES.

SCALE:  
N.T.S.


DESIGNED BKJ  
DRAWN BEB  
CHECKED BKJ



CONSULTING ENGINEERS  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
www.jonescivil.com

SOUTH WEBER CITY CORPORATION  
PUBLIC WORKS STANDARDS  
GENERAL - STREET LIGHTING STANDARDS

SHEET:  
CS-22  
OF 24 SHEETS  
0

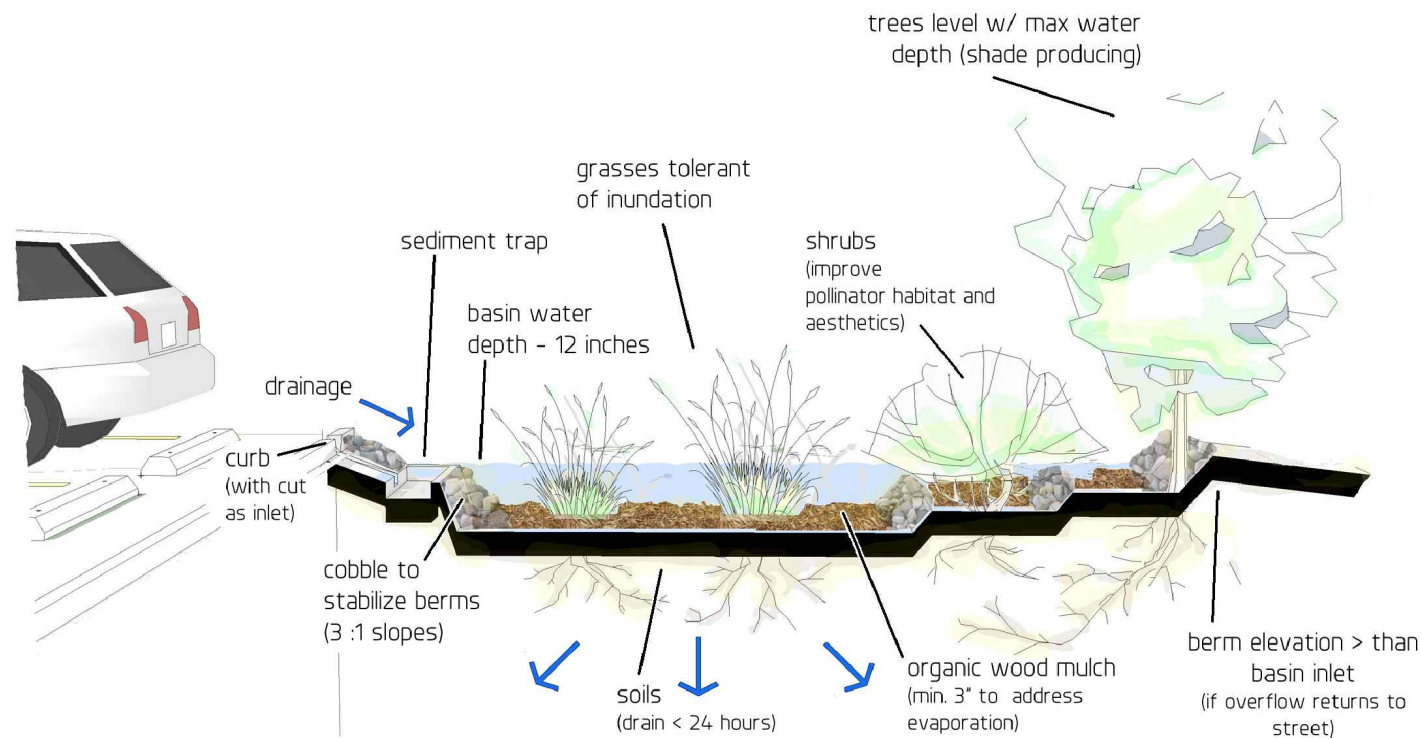

Basic Basin Design Considerations

**RAIN GARDEN**

\*\*\* [http://www.lid-stormwater.net/site\\_map.htm](http://www.lid-stormwater.net/site_map.htm) \*\*\*


diagram by  
Paul Navrot  
for SUH



**RAIN BARREL**


\*\*\* <http://www.goodideasinc.com/products/rain-barrels/rain-wizard-50/> \*\*\*

**DISCLAIMER:**  
ALL LID EXAMPLES SHOWN ON THIS SHEET ARE FOR REFERENCE PURPOSES ONLY. ANY SPECIFIC WEBSITES, COMMERCIAL PRODUCTS, PROCESS OR SERVICE BY TRADE NAME, TRADEMARK, MANUFACTURER, OR OTHERWISE, DOES NOT CONSTITUTE OR IMPLY ITS ENDORSEMENT, RECOMMENDATION, OR FAVORING BY SOUTH WEBER CITY. THE PURPOSE OF PROVIDING SPECIFIC PRODUCT INFORMATION IS TO ENSURE THAT THE CONTRACTOR AND/OR DEVELOPER HAS ALL THE APPROPRIATE INFORMATION AND REFERENCES TO ASSESS THE USEFULNESS OF THE PRODUCT.

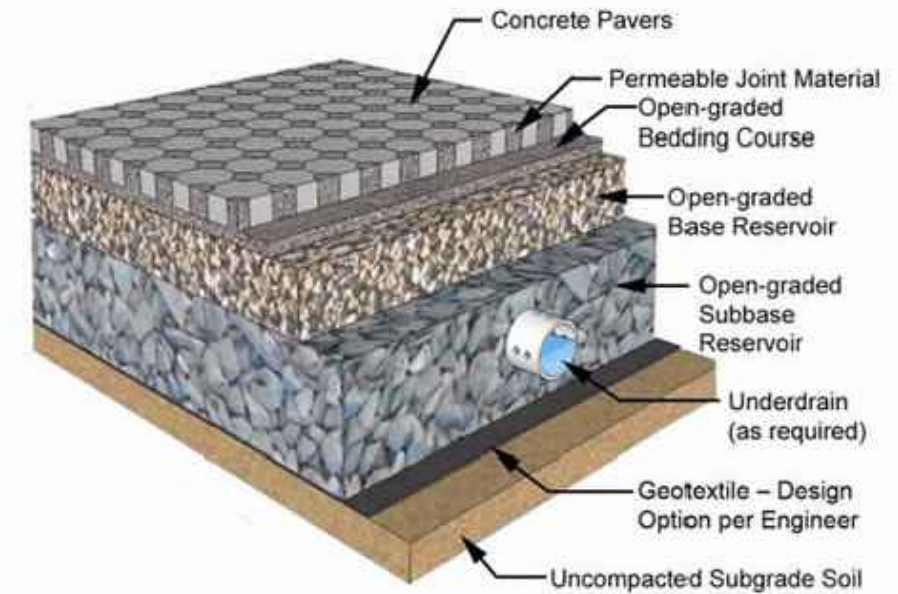

**PERMEABLE PAVER**

From Smith, D. 2006. *Permeable Interlocking Concrete Pavement—selection design, construction and maintenance. Third Edition.* Interlocking Concrete Pavement Institute. Herndon, VA

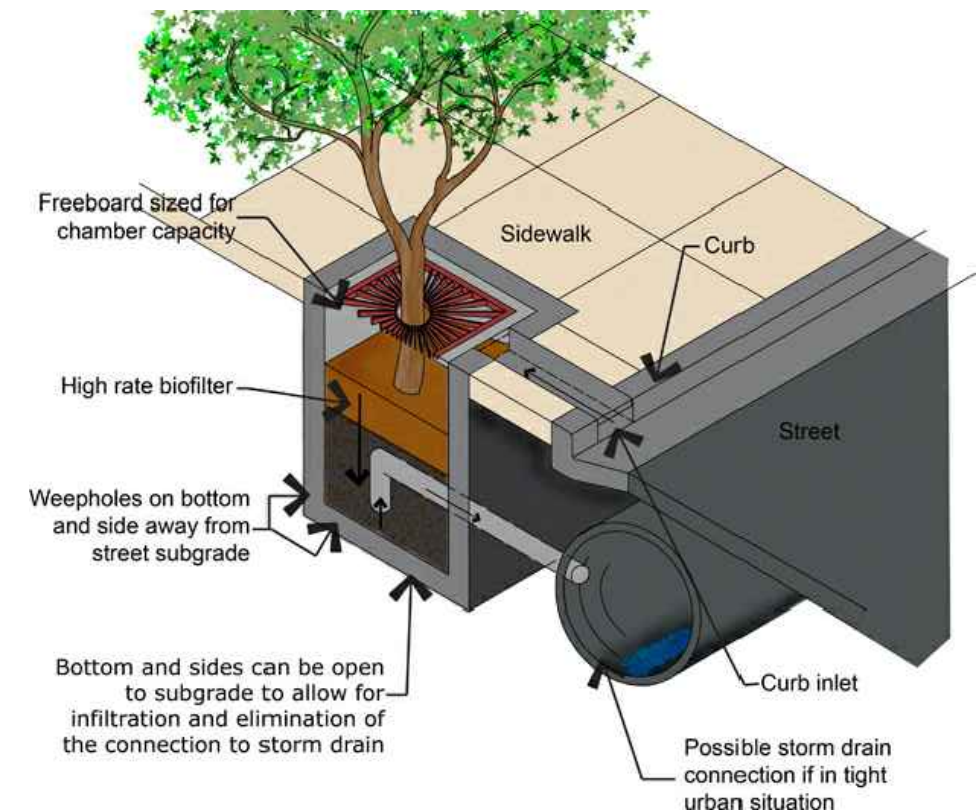

**TREE BOX FILTER**

From [www.wbdg.org](http://www.wbdg.org)



BRANDON KENT JONES  
No. 5148758  
PROJECT ENGINEER  
*Brandon K. Jones*  
DATE 2-12-2019

REV.	DATE	APPR.

SCALE:  
N.T.S.

DESIGNED BKJ  
DRAWN BEB  
CHECKED BKJ



**CONSULTING ENGINEERS**  
6080 Fashion Point Drive  
South Ogden, Utah 84403 (801) 476-9767  
[www.jonescivil.com](http://www.jonescivil.com)

**SOUTH WEBER CITY CORPORATION**  
**PUBLIC WORKS STANDARDS**

**GENERAL - LID (LOW IMPACT DEVELOPMENT) EXAMPLES**

SHEET:  
**CS-23**  
OF 24 SHEETS  
0

